THE COST-EFFECTIVENESS OF COMMERCIAL-BUILDINGS COMMISSIONING

A Meta-Analysis of Energy and Non-Energy Impacts in Existing Buildings and New Construction in the United States

Evan Mills¹ Hannah Friedman² Tehesia Powell³ Norman Bourassa¹ David Claridge³ Tudi Haasl² Mary Ann Piette¹

¹Lawrence Berkeley National Laboratory ²Portland Energy Conservation Inc. ³Energy Systems Laboratory, Texas A&M University

December 15, 2004

LBNL - 56637 (Rev.)

Acknowledgments. This work was sponsored by the Assistant Secretary for Energy Efficiency and Renewable Energy, Building Technologies Program, U.S. Department of Energy under Contract No. DE-AC03 76SF00098. In addition to information gathered by the authors, project data, other useful case-study information and review comments were provided by Edward Allen and David Jump (Quantum Consulting), Adam Benzuly (Affiliated Engineers, Inc.), Daren Goody (PECI), Martha Hewett (Minnesota Center for Energy & Environment), John Jennings (Northwest Energy Efficiency Alliance), Bing Tso (SBW Consulting), Jeffrey Warner and Philip Haves (Lawrence Berkeley National Laboratory), Phoebe Caner Warren (Seattle City Light), and David Hansen and John Ryan (U.S. Department of Energy). Naoya Motegi of LBNL developed an early version of the "Measures Matrix" (under a project sponsored by the Sacramento Municipal Utility District and the California Energy Commission through the California Institute for Energy and Environment), which we expanded and adapted for this study. Meetings and prior work of the California Commissioning Collaborative provided helpful ideas on methodology and feedback on our early results.

> An electronic version of this document and data input forms are available at http://eetd.lbl.gov/emills/PUBS/Cx-Costs-Benefits.html

DISCLAIMER

This document was prepared as an account of work sponsored by the United States Government. While this document is believed to contain correct information, neither the United States Government nor any agency thereof, nor The Regents of the University of California, nor any of their employees, makes any warranty, express or implied, or assumes any legal responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by its trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof, or The Regents of the University of California. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof or The Regents of the University of California.

CONTENTS

SUMMARY	1
INTRODUCTION	3
GOALS OF THIS STUDY	
HISTORICAL ROOTS AND CURRENT DRIVERS OF COMMISSIONING	
CURRENT STATE-OF-THE ART	
THE ROLE OF COMMISSIONING IN BUILDING PERFORMANCE	
PRIOR COST-BENEFIT ASSESSMENTS	
STRUCTURE OF THIS REPORT	
METHODOLOGY	14
ESTABLISHING STANDARD DATA DEFINITIONS AND PERFORMANCE METRICS	14
DATA COLLECTION AND METHODOLOGICAL APPROACHES TO COST-BENEFIT ANALYSIS	
Characterizing Building Features	
Describing the Scope of Commissioning	
Quantifying the Costs of Commissioning	
Quantifying Energy Savings	
z Soluting Energy Savings	
Characterizing Non-energy Impacts: Costs and Benefits	
RESULTS	25
SAMPLE CHARACTERISTICS	
SAMPLE CHARACTERISTICS	
KEY FINDINGS	
Drivers, Scope, and Expenditures	
Impacts	
Deficiencies and measures	
Energy savings and cost-effectiveness	
Formation and persistence of savings	
Non-energy impacts	
New Construction	
Drivers, Scope, and Expenditures	
Impacts	47
Deficiencies and measures	
Energy savings and cost-effectiveness	
Formation and persistence of savings	
Non-energy impacts	
COMPARATIVE ASSESSMENT OF COMMISSIONING IN EXISTING BUILDINGS VERSUS NEW CONSTRUCTION	
CAVEATS AND UNCERTAINTIES	54
POTENTIAL SOURCES OF UNCERTAINTY OR OVER-PREDICTION OF SAVINGS	54
POTENTIAL UNDER-ESTIMATION OF BENEFITS	
EXTRAPOLATING OUR RESULTS TO THE U.S. BUILDINGS STOCK	56
CONCLUSIONS & RECOMMENDATIONS	58
Major Findings	50
MAJOR FINDINGS IMPLICATIONS FOR ENERGY PLANNING & POLICY	
Knowledge Gaps and Research Needs	
The Way Forward	
REFERENCES	
APPENDICES	
Appendix A. Data Instrument	
APPENDIX B. ANALYTIC ASSUMPTIONS	
APPENDIX C. MEASURE DEFINITIONS	
APPENDIX D. PERFORMANCE MEASUREMENT & VERIFICATION DEFINITIONS APPENDIX E. CATALOG OF PROJECTS (SUMMARY INFORMATION)	
APPENDIA E. CATALUG OF EKUJECTS (SUMMAK I INFORMATION)	ð∠

LIST OF FIGURES

Fig 1. DOE High-Performance Buildings Case Studies: Goals vs. Actual	8
Fig 2. Example of Energy Impacts of Existing-Buildings Commissioning	
Fig 3. States Represented by Projects in the Study	
Fig 4a-b Location of Projects: Existing Buildings - New Construction	
Fig 5. Sample versus U.S. Stock, by Floor Area (Existing Buildings and New Construction)	
Fig 6. Sample Depth	
Fig 7. Existing Buildings Commissioning: Costs, Savings, and Payback Times	29
Fig 8. New Construction Commissioning: Costs, Savings, and Payback Times	
Fig 9. Key Results by Building Type (Existing Buildings)	
Fig 10. Key Results by Building Type (New Construction)	
Fig 11. Reasons for Existing Buildings Commissioning	34
Fig 12. Scope of Existing Buildings Commissioning	35
Fig 13. Commissioning Cost Allocation (Existing Buildings)	
Fig 14. Number of Deficiencies Identified by Building System (Existing Buildings)	
Fig 15. Frequency of Recommended Measures (Existing Buildings)	
Fig 16. Commissioning Savings Verification Methods (Existing Buildings)	
Fig 17. Energy Cost Savings: Existing Buildings	
Fig 18. Commissioning Payback Time vs. Building Size (Existing Buildings)	
Fig 19. Payback Time vs. Pre-Retro-Commissioning EUI (Existing Buildings)	
Fig 20. Electricity Savings vs. Pre-Commissioning Intensities (Existing Buildings)	
Fig 21. Natural Gas Savings vs. Pre-Commissioning Intensities (Existing Buildings)	
Fig 22. Purchased Thermal Energy Savings vs. Pre-Commissioning Intensities (Existing Buildings)	
Fig 23. Total Energy Savings vs. Pre-Commissioning Intensities (Existing Buildings)	
Fig 24. Emergence & Persistence of Energy Savings (weather-normalized)	
Fig 25. Reported Non-Energy Impacts (Existing Buildings)	
Fig 26. Reasons for New-Construction Commissioning	
Fig 27. Scope of New-Construction Commissioning	45
Fig 28 Commissioning Cost vs. Project Cost (New Construction)	
Fig 29. Commissioning Cost Ratio vs. Project Cost (New Construction)	
Fig 30. Commissioning Cost Allocation (New Construction)	
Fig 31. Number of Deficiencies Identified by Building System (New Construction)	47
Fig 32. Frequency of Recommended Measures (New Construction)	
Fig 33. Payback Time vs. Building Size (New Construction)	
Fig 34. Commissioning Cost vs. First-Cost Savings in New Construction	
Fig 35. Reported Non-Energy Impacts (New Construction)	
Fig 36. Total Commissioning Cost vs. Building Size (excluding non-energy impacts)	
Fig 37. Normalized Commissioning Cost vs. Building Size (excluding non-energy impacts)	
Fig 38. Savings vs. Depth of Commissioning (Existing Buildings)	60

LIST OF TABLES

Table 1. Example of Measures Matrix used to characterize commissioning projects	16
Table 2. Rules for inclusion of costs in scope of commissioning	
Table 3. Energy and non-energy impacts (positive or negative) of commissioning	23
Table 4. Commissioning providers, by floor area	25
Table 5. Sample by building type, number, and floor area	27
Table 6. Summary of results	
Table 7. Results summary with quartile analysis: Existing buildings	
Table 8. Results summary with quartile analysis: New construction	
Table 9. Results from Measures Matrices: Existing buildings	
Table 10. Results from Measures Matrices: New construction	49

LIST OF BOXES


Box 1. Common Deficiencies	4
Box 2. Fingerprints of Deficiencies	5
Box 3. Commissioning Metrics	15

SUMMARY


Building performance problems are pervasive. Deficiencies such as design flaws, construction defects, malfunctioning equipment, and deferred maintenance have a host of ramifications, ranging from equipment failure, to compromised indoor air quality and comfort, to unnecessarily elevated energy use or under-performance of energy-efficiency strategies. Fortunately, an emerging form of quality assurance—known as building commissioning—can detect and remedy most deficiencies.

Scattered case studies and anecdotal information form the basis of the conventional wisdom among energy-management professionals that commissioning is highly cost-effective. However, given the lack of standardized information on costs and benefits of detecting and correcting deficiencies, it is perhaps of no surprise that the most frequently cited barrier to widespread use of commissioning is decisionmakers' uncertainty about its cost-effectiveness.

Designed as a "meta-analysis," this report compiles and synthesizes extensive published and unpublished data from buildings commissioning projects undertaken across the United States over the past two decades,

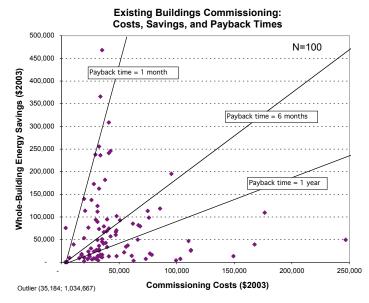

establishing the largest available collection of standardized information on commissioning experience. We analyze results from 224 buildings across 21 states, representing 30.4 million square feet of commissioned floor area (73 percent in existing buildings and 27 percent in new

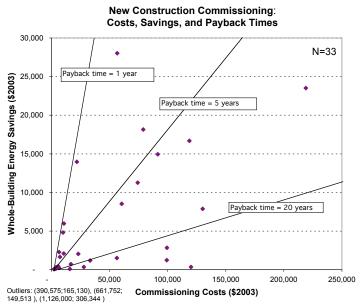

construction). These projects collectively represent \$17 million (\$2003) of commissioning investment. The newconstruction cohort represents \$1.5 billion of total construction costs.

We develop a detailed and uniform methodology for characterizing, analyzing, and synthesizing the results. For existing buildings, we found median commissioning costs of $0.27/\text{ft}^2$, whole-building energy savings of 15 percent, and payback times of 0.7 years. For new construction, median commissioning costs were $1.00/\text{ft}^2$ (0.6 percent of total construction costs), yielding a median payback time of 4.8 years (excluding quantified non-energy impacts).¹

¹ Percentage savings are generally not available for new construction, as there is no opportunity to measure energy use in the hypothetical (not built) non-commissioned building.

These results are conservative insofar as the scope of commissioning rarely spans all fuels and building systems in which savings may be found, not all recommendations are implemented, and significant first-cost and ongoing non-energy benefits are rarely quantified. Examples of the latter include reduced change-orders thanks to early detection of problems during design and construction, rather than after the fact, or correcting causes of premature equipment breakdown. Median one-time non-energy benefits were - $0.18/ft^2$ -year for existing buildings (10 cases) and - $1.24/ft^2$ -year for new construction (22 cases)–comparable to the entire cost of commissioning.

Deeper analysis of the results shows cost-effective outcomes for existing buildings and new construction alike, across a range of building types, sizes and pre-commissioning energy intensities. The most cost-effective results occurred among energy-intensive facilities such as hospitals and laboratories. Less cost-effective results are most frequent in smaller buildings. Energy savings tend to rise with increasing comprehensiveness of commissioning.

The projects identify 3,500 deficiencies (11 per building, 85 projects reporting) among existing buildings and 3,305 (28 per building, 34 projects reporting) among new construction. HVAC systems present the most problems, particularly within air-distribution systems. The most common correctional measures focus on operations and control.

There are material differences between our results for existing buildings and new construction. This can be seen in the "bottom-line" results per unit floor area—six-fold greater energy savings and four-fold lower commissioning costs for existing buildings. It should be noted, however, that median payback times are attractive in both cases, especially when non-energy impacts are accounted for. Larger median building floor areas in our existing-buildings sample (151,000 square feet) tended to favor lower costs compared to the new-construction cases (69,500 square feet). New-construction commissioning is more strongly driven by non-energy objectives such as overall building performance, thermal comfort, and indoor air quality, whereas existing-building commissioning is more strongly driven by energy savings objectives. The need for commissioning in new construction is indicated by our observation that the number of deficiencies identified in new-construction exceed that for existing buildings by a factor of three.

Some view commissioning as a luxury and "added" cost, yet it is only a barometer of the cost of errors promulgated by other parties involved in the design, construction, or operation of buildings. Commissioning agents are just the "messengers"; they are only revealing and identifying the means to address pre-existing problems.

We find that commissioning is one of the most cost-effective means of improving energy efficiency in commercial buildings. While not a panacea, it can play a major and strategically important role in achieving national energy savings goals—with a cost-effective savings potential of \$18 billion per year or more in commercial buildings each year across the United States. Commissioning is under-attended in public-interest deployment programs as well as research and development activities. As technologies, controls, and their applications change and/or become more complex in an effort to capture greater energy savings, the risk of under-performance will rise and with it the value of commissioning. Indeed, innovation driven by the desire for increased energy efficiency may itself inadvertently create energy waste if those systems are not designed, implemented, and operated properly. The ultimate impact of energy efficiency research and development portfolios, as well as deployment programs, lies in no small part in the extent to which they are coupled with cost-effective quality assurance.

INTRODUCTION

Goals of this Study

Few buildings perform as intended. Numerous pervasive and chronic performance deficiencies stem from design flaws, construction defects, malfunctioning equipment, and deferred maintenance. These deficiencies—exemplified in Boxes 1 and 2—have a host of ramifications, ranging from equipment failures to compromised indoor air quality and comfort to unnecessarily elevated energy use. For similar reasons, energy-saving design concepts for new buildings or retrofits for existing ones often fail to deliver predicted savings.

In response to a growing awareness of these problems, quality assurance techniques collectively known as commissioning² have emerged over the past two decades to address deficiencies in new construction and existing buildings alike. In its highest form, the commissioning process treats the building as a system, and uses inspection and functional testing to implement measures designed to optimize overall energy and non-energy performance. Energy-oriented commissioning is one of the newest fields within the overall energy management arena, offering greater and more cost-effective energy savings than many traditional "hardware" strategies.

According to an estimate from the late 1990s, less than five percent of buildings are commissioned when built—the majority for non-energy reasons—and less than 0.03 percent of existing buildings are commissioned each year (PECI 1998). Lack of information on costs and benefits is often cited among the top-most reasons that market penetration remains low (PECI 1998; Willems 1999; Altwies and McIntosh 2001; Veltri 2002; SBW and Skumatz 2003; Friedman *et al.* 2004). As suggested by slow market uptake, there remains an acute need to better understand the economics of commissioning.

Designed as a "meta-analysis," this report synthesizes existing data from real-world commissioning projects across the United States and over the period 1984 to 2003. By examining a large body of primary data (e.g., commissioning agents' project files) and published reports, we delve more deeply into certain areas—e.g., the structure of commissioning costs and findings—than has been done in past studies. We also analyze reported reasons for commissioning and non-energy impacts, as they are important indicators of benefits and hence integral to any comprehensive cost-benefit analysis (Mills and Rosenfeld 1996). We develop a detailed and uniform methodology and benchmarks for characterizing the results of projects and normalizing the data to facilitate meaningful inter-comparisons. The resulting database represents the largest available collection of standardized information on commissioning experience in actual buildings. Our assessment enables building owners and policymakers to make more definitive conclusions about cost-effectiveness and other impacts than has been possible up until now.

² The vocabulary associated with commissioning has ballooned. The terms "retrocommissioning",

[&]quot;recommissioning", and "continuous commissioning" are commonly applied to existing buildings and "commissioning" to new construction. We use the more literal (and hopefully accessible) terms "existing buildings" or "new construction" to differentiate between the two major branches of commissioning. In this report, instances of the term "commissioning" without these modifiers generally refer to both types collectively, unless the context of usage supports a clear distinction.

Box 1. Common deficiencies with adverse energy ramifications identified during existing-buildings commissioning. Courtesy Martha Hewett, Minnesota Center for Energy & Environment.



Condensation damage from DX fan coil unit due to plugged filter and low air flow. Large high school.



Broken actuator arm on dampter of multizone unit. Elementary school.





Inadequate cooling and excessive fan power consumption due to poor fit between light troffer diffusers and duct boot provided by a different supplier, allowing up to 25% of flow at diffuser to bypass directly into ceiling plenum. Highrise office tower.



Damage to brick facade of pool building due to lack of specification for (a) sealing of air leakage paths in exterior envelope and (b) balancing to assure negative pressurization of pool area. Large newer middle school.

Box 2. Fingerprints of deficiencies identified during retro-commissioning. Building automation systems and associated data-acquisition and diagnostics techniques help pinpoint building performance symptoms, and verify that interventions have been effective. Courtesy Martha Hewett, Minnesota Center for Energy & Environment.

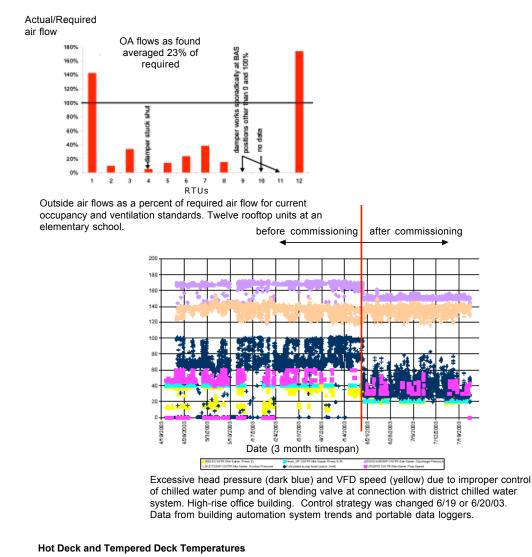



Hunting of hot deck temperatures in triple-duct system (hotcold-neutral; three distribution systems) with pneumatic control due to sensor thermal mass, steam valve sizing, and controller proportional band. Data collected with portable data loggers. Older high-rise office building.

Historical Roots and Current Drivers of Commissioning

The notion of commissioning is said to have been born in the shipbuilding industry, subsequently emerging within the buildings sector in the late 1980s, with emphasis on indoor air quality and reconciling mechanical system performance with design intent (Piette *et al.* 1995). Only in the past decade has commissioning been routinely applied to energy-related considerations. Results from the Energy Edge program in the Pacific Northwest were one of the first significant "wake-up calls" that energy efficiency measures did not often work as well in practice as suggested by engineering calculations (Piette *et al.* 1994).

Commissioning has far broader relevance for energy management than simply optimizing energy-efficient systems. In new and existing buildings alike, energy efficiency can be enhanced in two major ways, either by ensuring and maximizing the performance of specific energy efficiency measures or by correcting problems that cause unnecessarily elevated energy use in "conventional" systems. Historically, the original focus of buildings energy commissioning efforts was centered on the former case—i.e., limited to specific energy efficiency measures—but has expanded to address the significant opportunities in typical buildings.

Recent trends in the buildings construction and operations arena are elevating the importance of commissioning. For example, construction observation is less common today than in the past, and value engineering increasingly results in ill-informed, last minute design changes (as a result of efforts to trim project budgets) that can have adverse and unintended impacts on building performance and energy use.³ The industry has become more fragmented and an increasingly competitive market environment has forced buildings-sector professionals to reduce fees and "streamline" services (Friedman *et al.* 2002). As a result of the preceding factors, building documentation and functional testing—the grist of the commissioning process—have been drastically curtailed. Meanwhile rising energy expenses, concerns about moisture problems, increasingly complex mechanical and control systems, and even resistance to terrorism, are creating a greater need for systematic approaches to design and performance assurance.

Following are some of the major initiatives that have been mounted to expand the use of energyoriented commissioning in commercial buildings. These include utility programs, national voluntary programs, promotion by professional societies, inclusion in building codes, and direct initiatives from building owners.

- The federal government played a leading role in creating the market for buildings commissioning in the United States by requiring federal agencies to develop a commissioning plan for their buildings under the U.S. Energy Policy Act of 1992 and Executive Order 12902.
- One of the earliest scoping documents was Portland Energy Conservation, Inc.'s National Strategy for Building Commissioning (PECI 1998).

³ As a likely indicator of this phenomenon, insurance companies are seeing greater incidences of claims related to mechanical systems among newer buildings (Richard Jones, Hartford Steam Boiler Inspection & Insurance Company, Presentation, September 17, 1998).

- The American Society of Heating, Refrigerating and Air Conditioning Engineers (ASHRAE) has focused on commissioning, and issued an HVAC commissioning guideline (ASHRAE 1989).
- Numerous energy utilities have established commissioning incentive programs, the first of which was probably PacifiCorp (beginning in 1991), in which full rebate payments were not provided until major deficiencies were corrected. Utility initiatives for existing buildings have recently become more widespread, with programs in Oregon, California, Minnesota, Colorado, Connecticut, and Texas (e.g., see Gunn *et al.* 2004).
- The ENERGYSTAR Buildings Program was the first national voluntary initiative to integrate commissioning, as one of its five core steps.
- More recently, commissioning has become part of the "green buildings" movement, most notably as a prerequisite for LEED Certification (2000). LEED is probably the single most significant driver of new-construction commissioning in the U.S. today.
- In recognition of the erosion of energy savings caused by construction deficiencies, California building codes will soon require acceptance testing for certain systems.
- Commissioning has assumed a role in energy efficiency R&D at both the federal and state levels (e.g., the California Energy Commission's Public Interest Energy Research Program's activity on High-Performance Commercial Building Systems).
- The International Energy Agency has operated Annex 40, "Commissioning of Building HVAC Systems for Improved Energy Performance."⁴
- "In-house" commissioning directives are also emanating from the private sector. For example, Johnson & Johnson has set an enterprise-wide goal of 14% greenhouse-gas emissions reductions by 2010. Among its top-10 mandates to business units are building tune-ups (#2) and commissioning (#7). Other early adopters in the private sector include Westin Hotels, Boeing, Chevron, Kaiser Permanente, Disney Development Corporation, and Target (PECI 1998).
- The Building Commissioning Association is the first professional society of commissioning practitioners.⁵
- PECI organizes a well-attended national commissioning conference each year.

Commissioning has received increasing attention as the evaluation of energy efficiency programs has focused on measurement and verification of estimated and anticipated savings estimates. The commissioning movement has attained considerable momentum, and, as pointed out by Ryan and Nichols (2004) the issue is becoming more important as building energy management strategies become more sophisticated:

Even at the building component level, actual performance in real buildings may differ from predicted performance because of differences in installation, operation and other factors. This can lead to much lower energy savings than an optimal analysis would predict. Systems integration approaches, because they are considerably more complex than component approaches, present greater challenges. More complexity increases the probability for errors in design and execution, and thereby for greater divergence between design intent and actual building performance.

⁴ The 14 participating countries include: Belgium, Canada, Finland, France, Germany, Hong Kong PRC, Hungary, Japan, Korea, Netherlands (Observer), Norway, Sweden, Switzerland, USA. See http://www.commissioning-hvac.org/

⁵ See http://www.bcxa.org

Figure 1 exemplifies the problem, in the context of limited success in efforts to design and build six "high-performance" buildings." Issues included inaccurately stipulated insulation levels, installation of incorrect window frames, thermal short-circuits in building envelope, deficient lighting control calibration and algorithms, malfunctioning ventilation controls, poorly located exhaust dampers, and temperature setbacks out of compliance with design intent. While commissioning would not have entirely closed the gap between expected and actual performance for these buildings, it would have made a significant contribution towards doing so.

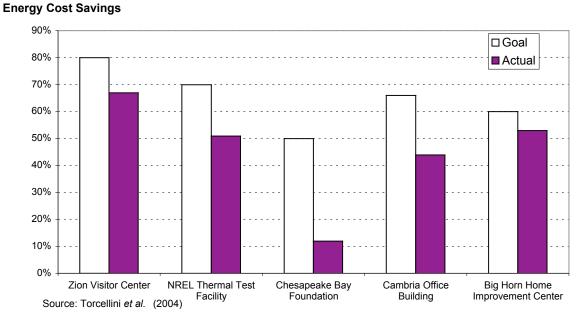


Fig 1. DOE High-Performance Buildings Case Studies: Goals vs. Actual

A specific case study of the need for and effectiveness of energy-oriented commissioning in existing buildings is provided in Figure 2. Here, a 165,000 square-foot building at Texas A&M University was found in an initial state with extensive simultaneous heating and cooling. By the time commissioning was completed, 64-percent chilled water savings and 84-percent hot water savings were achieved, with a value of \$314,000 per year in reduced energy bills. The corresponding payback time was well under one year.

Current State-of-The Art

While individual building components are commonly tested or rated in a standardized factory setting (e.g., COP ratings for heat pumps), integrated assemblages of such technologies—which include important "connective" systems such as thermal distribution or controls systems—are rarely tested in the field. In its broadest sense, the practice of commissioning involves a series of systematic procedures and tests to ensure that new and existing building processes, technologies, and systems are applied and function in an integrated fashion as intended by the designer and desired by the owner. However, in practice, commissioning is rarely comprehensive (e.g., focusing only on specific pieces of equipment, or, in the case of new construction, hampered by lack of budget or late commencement of the process).

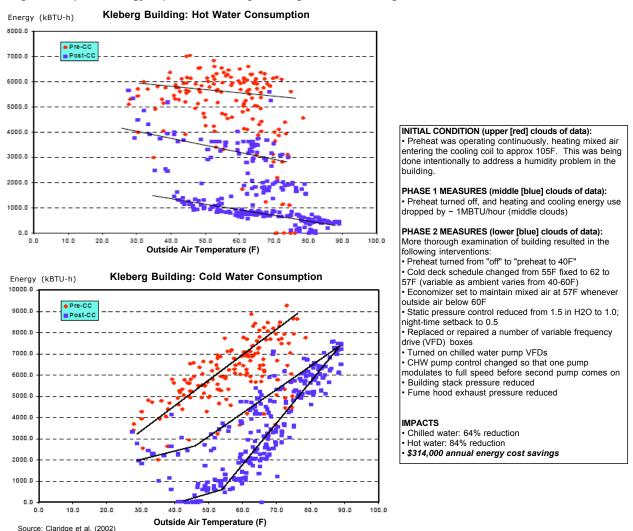


Fig 2. Example of Energy Impacts of Existing-Buildings Commissioning

Commissioning is critical to ensuring the new technologies function and achieve optimal energy savings while maintaining or improving other aspects of building performance. More specific approaches to energy-oriented commissioning differentiate between applications in new construction and existing buildings as follows:

• New-construction commissioning (either of a new building or major renovation) involves a quality assurance process ideally beginning at project inception and continuing through documentation of design intent, construction, startup, and operator training. The emphasis is on holding contractors to the requirements of their contract documents, and, in its ideal form, enabling clients (building owners) to articulate verifiable expectations for performance and quality assurance up front. From a technical standpoint, new-construction commissioning goes beyond conventional testing-and-balancing, with emphasis on systems-level interactions and functional testing to determine how well systems are working and to verify that design intent has been met or enhanced (and, if not, to make corrections). Examples of problems identified during commissioning

include: design problems (e.g., equipment sizing errors), installation problems (e.g., construction debris blocking ventilation pathways), software problems (incorrect sequence of operations or control algorithms), hardware/manufacturing problems (inaccurate sensors), component failure (e.g., faulty control boards in building automation systems), or improper start-up (e.g., air in water systems resulting in cavitation or improperly adjusted daylighting controls).

• Existing-buildings commissioning involves identifying and remedying problems in specific components or systems and the optimization of these systems. The scope can be quite broad. Much as cars are "tuned up" on a regular basis, so too can buildings be commissioned with some frequency. Examples of problems identified during commissioning include: simultaneous heating and cooling, frozen valves, stuck dampers, fouled filters, over-ridden or malfunctioning variable speed drives, sub-optimized temperature controls, and excessive equipment cycling (damper operation, compressors, etc.). In some cases, the deficiencies are inadvertent, while in others they are the result of intentional efforts to circumvent other malfunctioning systems or to implement stop-gap attempts to address occupant complaints. Existing-buildings commissioning has also shown to save considerable amounts of energy, even when performed after energy-savings retrofits have been implemented (Claridge *et al.* 2002).

There is of course a continuum across which both new-construction and existing-buildings commissioning techniques and perspectives are relevant. For example, when a new HVAC system is installed as a "retrofit" to an existing building, many of the issues normally associated with new-construction commissioning apply. Several important factors are held in common, e.g., in both cases the building owner must be the core proponent and driver, design intent documentation should be prepared or updated, and construction observation and functional testing serve as valuable tools for identifying deficiencies and verifying performance. Also, many owners initiate commissioning late in the construction process, the result of which can be that the recommendations involve correcting existing mistakes rather than intercepting them early in design or during construction.

Commissioning is on the one hand common sense, yet is uncommon in practice. The philosophy of commissioning is tailored to achieve several overarching objectives: clear definition of construction or retrofit goals, performing work properly the first time, assignment of responsibility, verification of completion, and paying attention to operations once construction is completed (Dorgan *et al.* 2002).

The Role of Commissioning in Building Performance

As distinct from routine operations and maintenance, the particular power of commissioning is in looking at systems-level problems, e.g., interactions between control systems and HVAC equipment. The scope of commissioning can span all aspects of buildings, including security, safety, structural integrity, indoor environmental quality, and energy performance.

The emphasis in this report is on energy performance, although many other areas are necessarily related. While commissioning is often done primarily for non-energy reasons (e.g., to address

indoor air quality concerns), it is not necessary to decouple the two. For example, in case studies of commissioning activities in existing schools in Minnesota that were primarily intended to address indoor environment concerns (inadequate air supply), energy objectives were integral such that increased ventilation did not create a burdensome energy penalty (MNCEE 2001c-e).

With an aggregate annual energy bill of \$120 billion in 2002 (USDOE 2004), the U.S. commercial buildings sector holds a considerable potential for savings. The sector is also worthy of attention given that it is the only energy end-use sector that has shown steady growth in energy intensity, with 17-percent growth between 1985 and 2000 and projected growth of 1.7% per annum to the year 2025 (Ryan and Nicholls 2004). For these reasons, building commissioning can play a major and strategically important role in attaining national energy savings goals, while helping to manage the risk of under-achievement. As technologies and applications change and become more complex in the effort to capture greater energy savings, the risk of under-performance will rise and the value of building commissioning will increase. Indeed, innovation driven by the desire for increased energy efficiency may itself inadvertently create energy waste if those systems are not designed, implemented, and operated properly.⁶

Commissioning offers different types of value for different actors in the buildings arena. For the owner or occupant, commissioning provides a third-party assessment of project quality, helping ensure a safe, healthy, and high-performance (low-operating-cost) environment. For the building trades, commissioning can improve information flow among team members, avoid costly callbacks or change-orders, and increase the likelihood of client satisfaction. For the planner, policymaker, or utility official with a macro-level perspective, it serves as a risk-management strategy to ensure that programmatic goals (e.g., anticipated energy savings) are attained in fact (Mills *et al.* 2004).

Prior Cost-Benefit Assessments

Scattered case studies and anecdotal information form the basis of "conventional wisdom" within the buildings energy community that commissioning is highly cost-effective, i.e., with payback times ranging from several months to one or two years in most cases.

There is a growing body of literature documenting individual commissioning case studies for individual buildings, much of which is drawn upon in this study. In addition, we compiled information from several previous studies that assembled data from multiple projects:⁷

- Stum and Haasl (1994) performed what may be the first study comparing multiple buildings.
- Piette *et al.* (1995) performed a detailed cost-benefit study of 16 (mostly new and small) buildings commissioned under the PacifiCorp utility program. It was largely limited to

⁶ Examples noted by Friedman *et al.* (2002) included evaporative cooling, demand-controlled ventilation, dimmable ballasts, dessicant cooling, and natural ventilation.

⁷ Many of the earliest works did not isolate the costs of commissioning from those of the energy-efficiency measures being commissioned (e.g., Yoder 1994) and hence provide insufficient information of the type of analysis performed in this study.

the commissioning of 46 specific energy efficiency measures (as distinct from wholesystem commissioning).

- Gregerson (1997) compiled data on commissioning of 43 existing buildings, mostly in the Northwest (from Portland Energy Conservation, Inc., PECI) and Texas (from Texas A&M University, TAMU). Minimal data were reported.
- A variety of agencies in the Pacific Northwest sponsored a compilation of new and existing buildings commissioning experience (PECI 1997a). About 175 buildings were examined, although only summary data were published in an extended brochure. No cost-effectiveness information was included and the results were collapsed into ranges, reported by building type.
- Wilkinson (2000) described 19 new-construction projects. Minimal data were provided.
- The Minnesota Center for Energy & Environment assembled 6 case studies of new and existing buildings in the state, some of which include cost-benefit information (MNCEE 2001a-f).
- As part of their "EBIDS" decision support tool, the Center for Building Performance and Diagnostics (CBPD) at Carnegie Mellon in partnership with the Lawrence Berkeley National Laboratory compiled and compared 11 case studies of existing-building commissioning, using the results to establish rules-of-thumb about best practices and the potential economic benefits of commissioning.⁸
- Most recently, the Northwest Energy Efficiency Alliance (NEEA) has conducted a major multi-year study of public buildings throughout the Pacific Northwest. The 13 new and 8 existing buildings were analyzed in great detail, including a thorough cost-benefit study (SBW and Skumatz 2003).

As described in the remainder of this report, we compiled approximately 7000 largely energyrelated deficiencies identified across 224 buildings. The good news is that, once identified, many of these problems were remedied in a cost-effective manner, yielding higher performance buildings – in some cases even exceeding the original aspirations of their designers.

Structure of This Report

We begin by outlining our methodology, generalizing the discussion in order to provide a recommended practice for others embarking on such analyses. We discuss data collection and analytical methods, decision rules, describing the commissioning process and scope, quantifying costs, valuing energy savings, and characterizing non-energy impacts. The establishment of quantitative metrics is a key underpinning for the process.

We then proceed to a presentation of our results. This begins with various summary statistics, in which we characterize the buildings in our sample and their geographical distribution, with comparisons to the overall U.S. buildings stock, and provide top-level cost-effectiveness results. A detailed matrix of results, by metric, is provided, along with a quartile analysis showing median, min, max, and upper/lower 25th percentile results for each commissioning metric. We then separately present detailed results for existing buildings and new construction. These sections first describe drivers (reasons cited for commissioning), scope of the commissioning

⁸ See http://cbpd.arc.cmu.edu/ebids

process and commissioning costs. We provide an in-depth look at the specific types of deficiencies discovered and the measures to remedy them. We analyze total energy savings and savings by fuel type. Using the results, we analyze various relationships, e.g., the cost and cost-effectiveness of commissioning as a function of building size. The results sections include discussion of available data on the rate at which savings materialize following commissioning as well as the persistence of those savings over time, and conclude with an analysis of the non-energy benefits reported by many of the projects.

Reflecting on the results, we compare the results for existing buildings and new construction and then offer a discussion of caveats and conservatisms, such as sources of uncertainty or overprediction of savings, as well as reasons why savings may be systematically underestimated. We complete the analysis with a scoping estimate of the national energy savings potential.

We conclude with a recap of major findings and implications for energy policy, which includes discussions about extrapolating our results to the broader U.S. buildings stock, the cost effectiveness of commissioning compared to other energy efficiency measures, and future research needs. The appendices provide specimen copies of our data instrument, documentation of various analytical assumptions, descriptions of commissioning measures logged in the Measures Matrices, performance measurement and verification definitions, and a catalog of summary information for the projects analyzed.

METHODOLOGY

Establishing Standard Data Definitions and Performance Metrics

In this section, we present our methodology and generalize the discussion in order to provide a recommended practice for others embarking on such analyses. The full data-collection instrument is shown in Appendix A, and the key assumptions and data decision rules in Appendix B. We evaluate existing buildings and new construction separately, as the issues and costs are qualitatively different.

Our approach begins with defining desired metrics and indicators (Box 3), and, from these endpoints, the types of data required to enable the analysis. It is important to consider and define the desirable metrics in advance of data collection efforts. Given the tendency towards extreme but rare outliers for many of the metrics, we utilize the median values rather than the average to characterize the central tendency for indicators summarizing the data, and quartile analysis to provide a sense of the variability in results.⁹

As commissioning is a highly variable process, it is important to develop a consistent and sufficiently specific framework for describing the problems (deficiencies) discovered through the commissioning process and the measures applied to address them. We developed the "Measures Matrix," shown in Table 1, which captures information on deficiencies and characterizes a specific commissioning measure with a unique code; field definitions are provided in Appendix C.¹⁰ Many of the fields were derived from the data collection protocols for new and existing buildings developed by an Experts Workshop held by the California Commissioning Collaborative (Friedman *et al.* 2004), from which we extracted data elements relevant to our analysis objectives. As the CCC database is limited to California buildings, requires extensive documentation, and its analytical routines are not yet implemented, it was not used directly for this study. We completed Measures Matrices for 71 existing-building projects and 20 for new construction.

Comparing numbers of deficiencies and measures across projects is problematic given the semiarbitrary ways in which they can be counted (e.g., is an installation error affecting 100 terminal boxes counted as one or one-hundred deficiencies?). Moreover, sometimes only a subset of measures is included in commissioning documentation or evaluations. For example, SBW and Skumatz (2003) tabulated 1616 deficiencies across 21 projects, but only tabulated and analyzed the subset of 235 (14.5%, and as few as 3% for one project) that were considered to be "significant".¹¹

⁹ The median a value in an ordered set of values below and above which there is an equal number of values, or the arithmetic mean of the two middle values if there is no one middle number. The median is thus less distorted by extreme upper or lower limits than is the average.

¹⁰ Naoya Motegi of LBNL developed an early version of the "Measures Matrix", which we expanded and adapted for this study.

¹¹ The study's definition of significance included all issues that affected a large area or number of people in the building, and/or resulted in major costs to resolve or major benefits over time.

Box 3. Commissioning Metrics

Building Characteristics and Demographics

- Building type (using DOE/CBECS definitions), vintage, location
- Year building commissioned
- Reasons for commissioning, deficiencies identified, measures recommended

Energy utilization intensity (use or savings)

- Electricity: kWh/building-year,¹² kWh/ft²-year
- Peak electrical power: kW/building; W/ft²
- Fuel: MMBTU/building; kBTU/ft²-year
- Purchased thermal energy: MMBTU/building-year; kBTU/ft²-year
- Total energy: MMBTU/building-year; kBTU/ft²-year¹³
- Energy cost: \$/building-year; \$/ft²-year (based on local or standardized energy prices; nominal [not corrected for inflation] and inflation-corrected to a uniform year's currency)
- Percent energy use savings (total and by fuel)
- Percent total energy cost savings
- Persistence index: Post-commissioning energy use in a given year/pre-commissioning energy use (unitless ratio)

Commissioning cost

- \$/building; \$/ft² (based on nominal costs or, preferably, inflation-corrected to a uniform year's currency levels. Can be gross value or net, adjusting for the quantified value of non-energy impacts)
- Commissioning cost ratio, for new construction (commissioning cost / total building or renovation construction cost, %).¹⁴
- Costs are tabulated separately for the commissioning agent and other parties
- Allocation of costs by source of funds (building owner, utility, research grant, other)
- Total building construction cost (denominator for commissioning cost ratio)

Cost effectiveness

Undiscounted payback time (commissioning cost/annualized energy bill savings). This
indicator is preferably normalized to standard energy prices; costs and benefits are
inflation corrected to a uniform year's currency levels

Deficiencies and measures

- Deficiencies/building; Deficiencies/100kft²
- Measures/building; Measures/100kft²
- Unique codes to identify combinations of deficiencies and measures (described in more depth below) [see Measures Matrix]

Commissioning scope

 Presence of pre-defined "steps" (yes/no), with different criteria for existing buildings and new construction

Non-energy impacts

- Туре
- Quantified (when possible), \$/building-year; \$/ft²-year [can be positive or negative] onetime or recurring
- Yes/No (when not quantified)

¹² In some cases, multiple buildings will be aggregated, in which case data must be analyzed at the "project" level.

¹³ Throughout this report, electricity is counted in "site" energy units, excluding losses in generation, transmission, and distribution, i.e., 3412 BTU/kWh.

¹⁴ Commissioning cost as a percentage of total electrical or mechanical costs is often used as well (Wilkinson 2000).

Table 1. Example of Measures Matrix used to characterize commissioning projects.

Project A. Hospital Facility

	Co	mpo	nen	ts (lo	cus	of f	ault	t)								Me	ası	ires										
									In	Desi stall Retro plac	atior ofit,	ĺ.		(Opei	ration	s & I	Cont	rol			Ma	ainte	nano	ce			
	eating and cooling)		distribution				EMCS or utility related)			ations	replacement		ed reset	Start/Stop (environmentally determined)	ancy determined)		foneratione		Behavior modification/manual changes				onance	DCe				
	HVAC (combined heating and cooling)	Heating plant	8	Terminal units	Envelope	Plug loads	Facility-wide (e.g. EMCS	Other	Design change	Installation modifications	Retrofit/equipment replacement	Other	Implement advanced reset	Start/Stop (environ	Scheduling (occupancy	Modify setpoint	Equipment staging Modify sequence of onerstions		Behavior modificati	to operations	Other	Calibration Mochanical fiv	Mechanical IIX Heat transfer maintenance	Filtration maintenance	Other			
	> 0	<u>-</u>	۲		ш	<u>م</u>	L.	0	5	5	D3	4	6	002	SC3	004		007	ů		003	٤ s	M3	2 4	M5	Measure Code	[Y;N;?]	Detail problems and remediation measures
																										11.144	Y	Only sint assigning as he lies down out of a like time to 005
-		×	x	_		-	-				-		-		-		- ×			_	_	x		-	-	H-M1 A-OC6	Y Y	Setpoint controller on boiler 1 was out of calibration by 20F Night low limit should only control perimeter boxes with reheat, not core boxes
-			Â	x											x		Ť	<u> </u>				-				L-0C3	Y	All exterior lighting ON all night per programming. Changed outside lighting to OFF at
	_	-	x								_	_	x					-			-	-	_	-	-	A-0C1	Y	2:45 am. Discharge air temperature reset schedule was not programmed. Added reset schedule.
-		-		_		-						_	_		_			_	_	_	_	_	_	_	_			Cooling-only VAV box min setting supposed to be 0, but set at 56%. Simultaneous
-			x													x										A-OC4	Y	heating and cooling with an adjacent zone.
			x													x										A-OC4	Y	Differential omitted from night high limit sequence and night low limit sequence. Causes cycling of AHU.
			х														×	:								A-OC6	Y	Outside air dampers don't close during optimal start and night low limit
	x																								x	V-M5	Y	Poor system documentation. Unclear and incomplete control sequences. Did not includ flow rates for control valves or location of duct smoke detectors and backflow preventer: [moroved documentation for O&M manuals]
		x														x										H-OC4	Y	Firing rate controller setting on both boilers were wrong. High limit supposed ot be 20F>low limit. It was reversed.
			x														×									A-OC6	Y	Confusion as to what the BAS will control and what the Trane RTU will control. Got it
		+					x														x					F-OC9	Y	<u>straight and programmed.</u> Current trending capability is limited to 1 parameter per trend and can only be viewed one parameter at a time. Inconvenient for troubleshooting and fine tuning.Got new
Ī		x				-				x			-		-	+		+			-	+		+		H-D2	Y	interface with full graphing capabilities. Isolation valves to boilers missing. HW supply temp cannot be controlled or maintained
-				x																		x				T-M1	Y	by mixing valve when only 1 boiler is on. Valves and controls added. Nine out of the nine thermostatis were out of calibration. JCI didn't use a calibrated thermometer and used +/. 2F as acceptable. JCI sensors used are rated to +/. 0.5F,
F		x										_				_					x					H-OC9	Y	specs call for +/- 0.5F calibration. Alarms on boilers had been disabled. Enabled alarms.
-		^	x							x											^					A-D2	Y Y	ASU-1 & 2 didn't have duct static pressure sensors hooked up.
	x		~							~												x				V-M1	Y	OAT sensor calibration 2.5 degrees off. Recalibrated.
	x									x																V-D2	Y	Installation problems: : ductwork high SP loss fittings, duct sealing, sheetrock dust on coils, exhaust fan not wired, valve not hooked up, timeswitch doesn't start fan, fan coil won't start by adjusting thermostat, TU zero calibration not enabled, exhaust duct not connected, disconnects on boilers missing
							х										×	:								F-OC6	Y	Power outage sequences: not programmed correctly
				x						x																T-D2	Y	Duct crushed 12" from TU inlet to make room for sprinkler pipe. Erratic TU flow control. Sensor relocated.
																		+									Y	93 Other findings not tabulated
7																												
																		_			_							
d r total:	3	0 4	7	2	1 0	0 () 2	0	0	4	0	0	1	0	1	3	0	4	0	0	2	3	0	0	0 1			

Note: "Measure Code" is a unique code assigned based on each measure's corresponding deficiency and type. The full Measures Matrix also contains fields for persistence, savings measurement method, and energy impacts.

There are many figures of merit for characterizing commissioning cost-effectiveness. These include net present value, benefit/cost ratio, return on investment, levelized cost of conserved energy, increased asset value, and simple or discounted payback times. For the purposes of the analysis described in this report, we have chosen the simple payback time. This indicator is intuitive and familiar to the intended audience. Given the short payback times typically associated with commissioning, discounting adds little precision and introduces uncertainties and points of debate regarding the "correct" discount rate. In addition, the cost-effectiveness level of measures with relatively short payback times (as encountered in this review of commissioning experience) is not influenced by changes in energy savings beyond the payback time, whereas "life-cycle" indicators such as net present value must include treatment of the highly-uncertain issue of savings persistence. Finally, use of payback time does not require stipulation of commissioning measure lifetime, a highly uncertain factor. The key shortcomings of payback time, on the other hand, are that benefits beyond the payback period are not quantified and the magnitude of savings is not visible (as is the case for other indicators, such as net present value.)

Data Collection and Methodological Approaches to Cost-benefit Analysis

We reviewed publications from the open archival and grey literature and commissioningprovider project files to identify commissioning projects that were sufficiently well documented to enable an analysis of cost-effectiveness and other factors of importance in this study. Use of the grey literature is essential for a study such as this, given that property owners who obtain commissioning services rarely fund formal publication of the process and results. Not surprisingly, some of the most well documented material is brought to light when projects are conducted under public-interest sponsorship, as illustrated by the case of Bonneville Power Administration's funding of case study reports on commissioning at the University of Washington (Caner 1996; 1997).

Conducting cost-benefit analysis of commissioning is arguably more difficult than for conventional hardware-oriented energy efficiency strategies. There are more factors on both the costs and benefits side of the equation—particularly non-energy impacts—and definitional issues are not as clear-cut. Quantifying energy savings can be more difficult, as the measures typically involve multiple systems and controls within the building as distinct from a single piece of equipment. Analyzing new construction is particularly difficult, given the absence of a measurable "no-commissioning" baseline. Commissioning measures are less likely to persist than are hardware measures.

Only in the past few years have efforts been made to establish a robust framework for commissioning cost-benefit analysis.¹⁵ Some of the previous efforts have been conceptual in nature, while others have developed and applied an explicit methodology. Wilkinson (2000) pointed out the need for consistent methods of estimating new-construction commissioning costs. Altweis and McIntosh (2001) and Cohan and Willems (2001) appear to be among the first to have articulated specific frameworks for characterizing commissioning costs and benefits. Willems encouraged analysts to present a range bounded by "most likely" costs and the "least-

¹⁵ As mentioned above, Friedman *et al.* (2004) are developing such a framework for use in the California context.

cost" solution. Veltri (2002) also offered a methodology. The most thorough framework we have encountered is that developed for evaluation of the "Costs and Benefits of Commissioning in Public Buildings Project" being conducted in the Pacific Northwest (SBW and Skumatz 2003). Their framework included consideration of one-time and ongoing costs and benefits, a detailed methodology for valuing non-energy impacts, and use of standardized energy prices.

Friedman *et al.* (2004) provide an extensive discussion of determining which costs should and shouldn't be ascribed to the commissioning process. We summarize and augment that work in Table 2. While in some cases the costs arising from the commissioning process (e.g., correcting design flaws) should not be included in the costs of commissioning, the benefits are, in principle, associated with the commissioning process if the issue would not otherwise have been identified and remedied – this, however is very difficult to determine in practice.

Next Franker			
Cost Factor	Include Cost?	Construction, Existing buildings)	Examples
Cx provider's fixed costs	Yes	N; E	Costs of developing commissioning spec, reviewing design documents, conducting inspections, construction observation
Other contractors' costs	NI-		O sus stars at he siteling as in stall as sate as
Contract compliance	No	N; E	Construct building; install systems
Testing and balancing (TAB)	No	N; E	Preceeds commissioning; separate service with separate fees
Coordination with commissioning provider	Yes	N; E	Assist in performing functional tests
Correcting design flaws	No	N	Included in design contract and warranty
mproving design or operations	Yes	Ν	Recommendations to reduce pressure- drop, improved control sequences
Non-billable" in-house operations staff fixed costs	As desired by owner	N; E	Staff time to work with commissioning provider
Functional tests	Yes	N; E	Validating intended damper positions or variable-speed drive operating cycle
Resolution costs related to optimizing systems	Yes	N; E	Corrections during start-up; tune-up
Costs related to ensuring other trades' adherence to contract locuments	Yes	N; E	Verifying as-built condition meets design intent
Resolution costs related to installing a system beyond project scope	No	Ν	Installing energy management and control systems; major capital retrofits
Resolution costs related to operations and maintenance	Yes	E	Cleaning fouled filters
Ainor capital improvements to resolve deficiencies	Yes	N; E	Operations and maintenance
Najor capital improvements to resolve deficiencies: new construction	No	Ν	Replacing incorrectly sized chiller
Najor capital improvements to resolve deficiencies: existing vuildings	Yes	E	Replacing faulty control system elements
raining or on-site staff	Yes, if in scope	N; E	
Jtility rebates, grants, or other external financial assistance	Yes	N; E	Represents part of true project cost
Research-related costs	No	N; E	Development of research reports; not essential to efficacy of commissioning
Travel	Yes	N; E	proiect To and from project site
Non-energy impacts	Yes	N; E	Often not guantified

Table 2. Rules for inclusion of costs in scope of commissioning.

While prior work in this area has identified and addressed many important considerations, none of the methodologies we encountered adequately considered the importance of normalizing economic analyses to common units when comparing among disparate project costs and savings. Two key elements include correcting for inflation so as to meaningfully compare projects occurring across long periods of time, and normalizing for variations in energy prices across projects. To illustrate the importance of this variable, nominal (non-inflation-corrected) energy prices varied widely across our sample: electricity from \$0.025 to \$0.159/kWh, fuel from \$2.50

to \$10.22/MBTU, and hot/chilled water from \$2.58 to \$8.30/MBTU. Commissioning project costs from 1985 are doubled when expressed in 2003 dollars.

Many studies normalized results by floor area, but were limited in their characterization of the breadth and depth of commissioning. Some studies combine results for new-construction and existing buildings; given the material differences between these two forms of commissioning we do not view this as appropriate or meaningful. Irrespective of the approach, documenting assumptions is of overarching importance, yet few published studies do so, rendering the analysis non-replicable and non-auditable.

A thorough approach to identifying and evaluating the cost and cost-effectiveness of commissioning has a number of major components, described in below.

Characterizing Building Features

When the aim is to compare projects, it is important to standardize the definitions used to characterize the buildings. As with most energy normalization and benchmarking activities, defining floor area is typically a key factor, as is the treatment of indoor parking areas. Consistent definitions must be adopted. In this study, we utilize only the area affected by the commissioning activity (which may be less than the entire building area). Where available, we utilize the area net of indoor parking space.

For comparisons to the broader building stock, building types must be defined. Given that the best national energy data for the commercial buildings sector are provided by the U.S. Department of Energy's Commercial Buildings Energy Consumption Survey (EIA 1999), we utilized their definitions, which divide the sector into 15 building types.

Describing the Scope of Commissioning

Commissioning activities need to be clearly defined, and those definitions applied consistently to ensure maximally inter-comparable results across projects. The commissioning process can range from being highly limited (either superficial and/or limited in scope, e.g., focusing on a single building sub-system or piece of equipment) to highly comprehensive.

There are also many possible steps of the commissioning process. For new construction, commissioning can follow the entire design-build-startup process, but is often introduced only at a late stage. The documentation of project scope—steps included in the commissioning process—was collected when available (this included 69 percent of the existing buildings studied and 38 percent of the cases of new construction). We identified fifteen potential steps for existing-buildings commissioning and sixteen steps for new-construction commissioning. There is no industry standard for characterizing commissioning scope.

Analysts often incorrectly include costs that are not appropriately ascribed to commissioning, e.g., testing-and-balancing, TAB, (which is a service in and unto itself, distinct from commissioning). However, commissioning may help reduce TAB costs and time requirements, in which case the benefit could be credited to commissioning (Caner 1996). Several

commissioning projects explicitly set out to improve the TAB process, e.g., by preparing an improved TAB specification (MNCEE 2001c-e). In this study, we exclude TAB costs when they are identified.

Quantifying the Costs of Commissioning

Care should be taken to include all relevant costs born by all parties (although it may be of interest to conduct sub-analyses to evaluate the implications for different actors). Commissioning may be funded by any combination of the building owner, tenant, utility, or other third parties such as providers of research grants. Commissioning may be implemented by various parties, including but not limited to the Commissioning Agent. An important "grey area" is the cost of labor for in-house participants. The Northwest Public Buildings study (SBW and Skumatz 2003) refers to these as "indirect" costs (but we include them as "core" costs here). However, if the owner does not consider in-house personnel costs as a additional costs, they are not included in our definition of commissioning costs, for example in the case of involving operators during functional testing as a method of training in-house staff. In this study, we utilize the construction labor cost index published by the U.S. Bureau of Labor Statistics (2004) (Appendix B) to normalize commissioning costs to year-2003 prices. Travel is another cost item that should be tabulated.

Commissioning costs can be normalized by floor area. For new construction, they are also often expressed as a percentage of the total construction cost and/or mechanical system cost.¹⁶ In either case, the construction cost should be normalized to a standard year's currency. In this study, we normalize costs and savings by the floor area commissioned and use the McGraw-Hill Construction Cost Index to inflation-correct costs (Appendix B).

Attention should also be paid to the fact that commissioning is often done for non-energy reasons (e.g., quality control for security systems). Respondents to a baseline survey in the Pacific Northwest ranked energy savings seventh among overall (energy and non-energy) perceived benefits of new-construction commissioning (Willems 1999). While energy savings are not always a prime motivator of commissioning, energy-using systems are often at the root of problems (e.g. comfort complaints) that commissioning providers seek to remedy. Commissioning costs thus typically encompass measures that do not save energy, yet the economic value of non-energy impacts is rarely quantified. This leads to an under-estimation of the cost-effectiveness of commissioning.

For existing buildings, costs for remedying deficiencies are often included–at least to a degree –given that the party responsible for the error is typically no longer under contract or otherwise available and liable to provide the remedy. Judgment needs to be applied in attributing these costs to commissioning versus routine maintenance or retrofit. Some studies (e.g., SBW and Skumatz 2003) have taken a conservative approach for some of their projects, heavily attributing these peripheral costs to the commissioning process. For new construction, many corrections can be recharged to the original contractor under warranty agreements, and thus should not be debited to the commissioning process.

¹⁶ See http://enr.construction.com/features/conEco/costIndexes/constIndexHist.asp.

Many commissioning projects are conducted under public- or privately-funded research programs. This incurs extra costs for experimental design, analysis, documentation, and perhaps instrumentation that would not ordinarily be called for. In these cases, the relevant research costs should be isolated from routine commissioning costs and, if deemed appropriate, excluded from the core analysis, as we have done in this study where the data were available.

From a practical perspective, there is no one single "correct" range of commissioning costs to be included. This will depend on the audience for the analysis, e.g., a building owner may want to exclude utility rebates or financial assistance from other parties, as it is not an out-of-pocket cost, whereas a policy analyst or program evaluator would likely want to include such costs. Of primary importance is that a standard definition is used when comparing multiple projects. Using the rules laid out in Table 2, we have standardized definitions, to the extent allowed by the source data.

Quantifying Energy Savings

Measuring buildings energy use and savings is clearly central to the question of assessing costeffectiveness. As this is a meta-evaluation, we did not perform primary energy data collection and analysis for all projects.¹⁷ However, we did capture information on the methods used to determine savings. Piette *et al.* (1995) and others provide detailed discussions about estimating commissioning energy savings for new or existing buildings. Various methodological issues are important to keep in mind when attempting to quantify energy savings from commissioning, including:

- When working with existing buildings, measured savings data may be available. We limited comparative pre-/post-commissioning analyses to cases with weather-normalized data, and used all data based on engineering estimates, as weather is not a confounding factor for comparisons.
- Where multi-year post-commissioning energy data are available, we noted that energy savings may not manifest fully in the first post-commissioning year, as implementation can be gradual. Once savings have fully emerged, they may subsequently decline (persistence problems). Although savings tend to last sufficiently long for the original commissioning costs to be recovered, it is desirable to monitor energy use over a multi-year period to track persistence and identify "flags" signaling the need for another cycle of commissioning.
- In rare instances, energy use can increase as a result of commissioning, e.g. when a nonfunctioning piece of equipment is discovered and repaired. Box 2 provides another example: the discovery of under-ventilation.
- The quality of energy data varies. In this study, we characterize the data as measured or estimated, and, within the former category, record the category of measurement per the

¹⁷ Primary data from commissioning project files were collected for projects in Appendix E commissioned by PECI, Quantum, TAMU, and those reported by Bourassa *et al.* (2004).

International Performance Measurement and Verification goals, as shown in Appendix D (IPMVP 2001).

- Savings cannot be directly measured in the case of new-construction commissioning, as the baseline building represents one completed without remedying the deficiencies found by the commissioning process. In this case, post-commissioning energy use may be measured, but savings can only be estimated, e.g., by engineering calculations or more sophisticated modeling of the proposed building with and without the deficiencies resolved (Piette *et al.* 1995). Because of the difficulty in establishing a meaningful simulated baseline, percentage energy savings are rarely estimated for new construction. One study that did so for 16 buildings focused almost exclusively on commissioning the energy-efficiency measures (EEMs) in new construction (Piette *et al.* 1995), finding that commissioning of these measures increased the electricity savings by 41 percent (for an average cost "adder" of 8 percent, compared to the direct cost of the energy efficiency measure. Stum *et al.* (1994) observed an average 22-percent increase in EEM savings.
- Irrespective of the method of determining energy savings, it should be kept in mind that the commissioning report's recommendations may be in the process of being implemented at the time energy savings data are collected. If estimates of ultimate savings are available, they should be incorporated in cost-benefit analyses. However, attention must be given to the fact that not all recommendations will necessarily be implemented as of the time of evaluation, especially since primary documents (e.g., commissioning reports) are typically created immediately upon delivery of the recommendations. In this study, we attempted to exclude savings for measures known not to have been implemented, but otherwise included savings for measures that had not yet been implemented as of the date the project was documented. An important caveat is that few of the primary sources quantified the benefits of all identified savings opportunities.

Valuing Energy Savings

Once the quantity of energy saved is determined, the economic *value* depends on the assumed energy pricing and tariffs. If commissioning cases are to be inter-compared, computing energy costs using a single set of energy prices is highly desirable. If it is preferred to retain local energy prices, those prices should at a minimum be inflation-adjusted to a common year using an energy price index. In this report, we do both, i.e., we derive a price index from the nominal historical price histories published by USDOE/EIA to normalize the local (project-specific) price to a common currency level (i.e., \$2003). We also provide an alternative normalization to standardized energy prices at year-2003 currencies (Appendix B). Cost-effectiveness indicators are computed using both of these prices. As noted above, variations in the nominal energy prices underlying the raw cost savings values were considerable, e.g., electricity prices varied by a factor of six.

Characterizing Non-energy Impacts: Costs and Benefits

Perhaps the largest caveat in any cost-benefit analysis for commissioning is that energy savings are only one of many quantifiable and non-quantifiable impacts (positive or negative) (Table 3). Non-energy impacts (NEIs) include changes in maintenance costs, changes in equipment lifetime, improved productivity, reduced change orders, and improved indoor air quality.

	Cost	Benefit	Comment
Direct			
Cost of (retro)commissioning service	х	х	Cost can be partially or completely offset by the indirect effects listed below
Energy consumption	x	х	In rare circumstances, energy use can increase if equipment is found in "off" or under-utilized state
Indirect			
Accelerated repair of a problem (assuming it would have been identified and corrected, eventually, without commissioning)		х	
Avoided premature equipment failure		х	
Changes in ioperations and maintenance costs	х	х	
Changes in project schedule	х	х	Can shorten or lengthen schedule
Clarified delineation of responsibilities among team members		х	5
Contractor call-backs		х	
Occupant comfort/productivity		х	
Equipment right-sizing	х	х	
Impacts on indoor environment		х	
Documentation	х	х	
In-house staff knowledge	х	х	
Disruption to occupancy and operations	х	х	Early detection of problems
More vigilant contractor behavior (knowing that Cx will follow their work)		х	
Operational efficacy		х	
Potential for reduced liability/litigation		х	
Change orders	х	х	Timely introduction of commissioning (early in process); otherwise potential for increase
Disagreement among contractors		х	
Testing and balancing (TAB) costs		х	Can be reduced by solving problems that the TAB contractor would otherwise have encountered
Safety impacts		х	
Warranty claims		х	
Water utilization		х	
Worker productivity		х	

Table 3.	Energy and non-	energy impacts (pos	itive or negative)	of commissioning.
14010 0.	Enorgy and non		navo or nogaavo,	or commodiating.

Non-energy impacts are important determinants of whether a building owner seeks commissioning services. As an example, a principal in the commissioning of four major laboratory buildings in Seattle, Washington noted that the primary goal of commissioning was occupant safety, followed by productivity of academic research, teaching, comfort and public relations, and *then* energy savings (Caner 1996 and 1997). Given the definitional and quantitative uncertainties surrounding non-energy benefits, analysts may elect to present costbenefit analyses with and without these factors, as we do in this study.

If non-energy impacts are quantified, they can be incorporated in cost-benefit analyses. A method for doing so was employed by SBW and Skumatz (2003) in their study of public buildings in the Pacific Northwest, and involved interviewing 97 commissioning team members across 21 projects and having them gauge the value/costs of non-energy impacts in relation to a

known direct cost associated with the project, i.e., the commissioning fees, and weighting the answers depending on the source of the vote and the qualitative level of importance that each respondent assigned to the impact. The study found average annual non-energy commissioning benefits of \$0.26 per square foot for existing buildings and benefits of \$0.17 per square foot for new construction (with energy savings of \$0.11 and \$0.14 per square foot).

Some specific case studies of non-energy impacts include:

- Altweis (2002) describes the results of six projects, in which change orders were reduced by 87%, contractor callbacks reduced by 90%, and reduced construction cost by an undetermined amount (estimated 4 to 9 percent).
- Tso *et al.* (2002) found an average of 12 measures per project in new construction that resulted in extended equipment life and 9 measures in the case of existing buildings.
- The commissioning strategy undertaken as part of the Pentagon Renovation Project (not included in our compilation) is estimated to have resulted in \$3 million per year in improved worker productivity benefits (Cox and Williams 2000).
- Perhaps the most elusive non-energy impact is reduced liability or insurance claims (Brady 1995; Tyler 1995; Martinez 1999; Mills 2003), as the outcomes of litigation are often confidential. Nelson (1999) states that twelve buildings-related claims—representing an aggregate award of \$60 million—could have been avoided by proper commissioning. Chen and Vine (1998) address insurance interests in improved indoor air quality, and insurers have endorsed commissioning as a way to avoid liability claims among architects and engineers, one of which offered a 10% premium credit to their insureds who receive training in commissioning (Mills 2003).

RESULTS

Sample Characteristics

The 104 projects providing the information represent the work of 18 commissioning providers (Table 4). The provider is unknown for 16 percent of existing building project's floor area and for 62 percent of new construction project's floor area.

Our data collection efforts yielded 175 projects, spanning 21 states and representing 30.4 million square feet of floor area (Figures 3 and 4a-b). Existing buildings projects are most common in Texas and California, while new-construction projects are most common in Washington, Oregon, and Montana. The median building size was 151,000 square feet for existing buildings (95,101 to 271,650 square feet inter-quartile range) and 69,500 square feet for new construction (32,268 to 151,000 square feet inter-quartile range). With the exception of the "religious worship" and "vacant" categories, our sample covered all major building types identified in the US Energy Information Administration's periodic Commercial Buildings Energy Consumption Surveys¹⁸ (Figure 5 and Table 5). As not all data elements were available for all projects, (Figure 6) summarizes the "sample depth" for a number of the key parameters.

Table 4. Commissioning pr	Existing	1001 ai	ea. New	
	Buildings		Construction	
	(square feet)	%	(square feet)	%
Affiliated Engineers, Inc. (Walnut	((
Creek, CA)	-	-	774,000	9.5%
CH2M Hill (Portland OR)	-	-	340,000	4.2%
Environmental and Engineering			,	
Services, Inc.	-	-	160,000	2.0%
Facility Dynamics (Baltimore,				
MD)	1,014,133	4.6%	-	-
Facility Improvement				
Corporation (Great Falls, MT)	64,000	0.3%	-	-
Farnsworth Group	-		1,083,758	13.3%
HEC (ESCO)	376,500	1.7%	165,000	2.0%
Herzog/Wheeler	44.000	0.2%		
Keithly/Welsch Associates Inc	44,000	0.270	-	-
(Burien WA)	65.000	0.20/	111 000	1 00/
Nexant (San Francisco, CA)	65,000	0.3%	144,000	1.8%
· · · · · · · · · · · · · · · · · · ·	210,406	0.9%	-	0.0%
Northwest Engineering Service, Inc.				
	213,000	1.0%	-	0.0%
PECI (Portland, OR)_	4,345,810	19.5%	371,000	4.5%
Quantum Energy Services and				
Technologies, Inc QuEST (Oakland, CA)	0 400 444	0.00/		
Sieben Energy	2,132,411 623,000	9.6% 2.8%	-	-
Systems West Engineers	623,000	2.0%	-	-
(Eugene, OR)	170 400	0.00/		
TAMU/ESL College Station TX)	172,400	0.8%	-	-
TAMO/ESE College Station TX)	9,439,042	42.5%	-	-
Test Comm LLC (Spokanne,	0, .00,0 IL			
WA)	-	-	60,000	0.7%
Western Montana Engineering	-	-	23,300	0.3%
Other	3,531,592	15.9%	5,046,400	61.8%
Total	22,231,294	100%	8,167,457	100%

Table 4. Commissioning providers, by floor area.

¹⁸ See http://www.eia.doe.gov/commercial.html

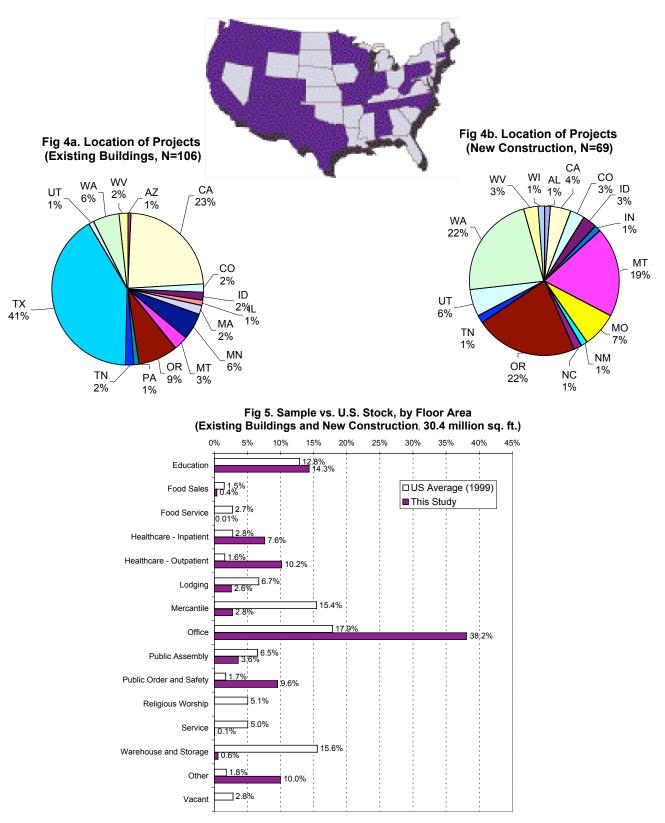


Fig 3. States Represented by Projects in this Study


Source for US Average: USDOE/EIA (2004)

	То	tal	Existing I	Buildings	New Construction		
	Number of Buildings*	Floor Area [1000ft ²]	Number of Buildings*	Floor Area [1000ft ²]	Number of Buildings*	Floor Area [1000ft ²]	
Education							
K-12	19	1,633	10	1,052	9	581	
Higher education	64	2,724	57	2,405	7	319	
Food Sales	4	127	-	-	4	127	
Food Service	1	4	1	4	-	-	
Health Care							
Inpatient	17	2,322	6	1,278	11	1,043	
Outpatient	13	3,102	8	2,895	5	206	
Laboratory	36	2,914	20	932	16	1,982	
Lodging	10	786	6	637	4	149	
Mercantile							
Retail	13	615	13	615	-	-	
Service	3	227	3	227	-	-	
Office	87	11,609	70	10,965	17	644	
Public Assembly	11	1,104	3	397	8	707	
Public Order and Safety	11	2,917	3	758	8	2,159	
Religious Worship	-	-	-	-	-	-	
Service	1	25	-	-	1	25	
Warehouse and Storage	10	175	7	14	3	162	
Other	2	127	1	67	1	60	
Vacant			-	-	-	-	
Total		30,413		22,247		8,165	

Table 5. Sample by building type, number, and floor area.

* Note in some cases more than one building type is encompassed by a single project.

Fig 6. Sample Depth

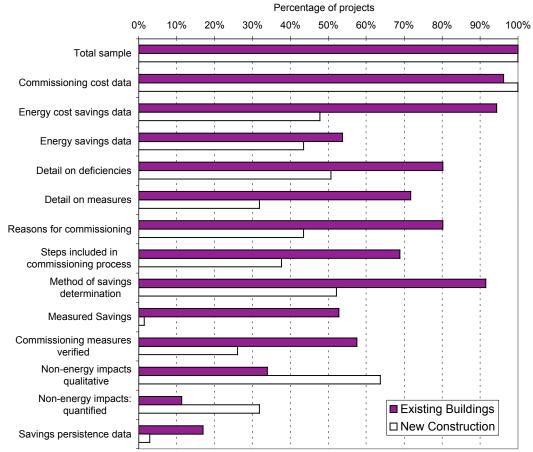

27

Key Findings

Table 6 and Figures 7 to 10 provide top-level findings for existing buildings and new construction, and Tables 7 and 8 provide more specific findings with min/max, median, average, and upper/lower quartile values. Our sample represents a total commissioning cost of about \$17 million (\$2003), for existing buildings and new construction combined.¹⁹ A catalog of summary information on the projects is provided in Appendix E.

	Al		Exist	ing Building	js	New	Constructio	n
	Total	Study sample size (Number of projects)	Total p	Median er project	Study sample size	Total p	Median er project	Study sample size
Number of projects	175	175	106		106	69		69
Number of buildings [1]	224	175	150	1.4	106	74	1.1	69
Number of states	21	175	15		106	15		69
Total project floor area	30.4	175	22.2	0.151	106	8.2	0.07	69
(million ft ²)								
Building age				1978	78		1996	59
Total new building construction costs (\$million) [2]						1,514	10.2	58
Number of deficiencies identified	6,805	120	3,500	11	85	3,305	26	35
Commissioning cost as a fraction of total building construction cost (excluding non-energy benefits) [%]							0.6%	65
Total commissioning costs (\$2003), excluding non-energy impacts [3] \$1,000 \$/ft2	16,984	171	5,223	34 0.27	102 102	11,760	74 1.00	69 69
Total Savings (\$2003) [3] \$1000/year[4] \$/ft2-year [4] Whole-building energy cost savings (%) [5]	8,840	133	8,022	45 0.27 15%	100 100 74	818	3 0.05	33 33
Simple payback time, local energy prices [years]				1.0	99		5.6	38
Simple payback time: standardized US energy prices, including some cases with non-energy impacts [years] [6]				0.7	59		4.8	35

Table 6. Summary of results.

[1] Actual values likely higher. For the many data sources that did not specify number of buildings, we stipulated one.

[2] All costs in this table are in inflation-corrected 2003 dollars.

[3] Payback time should not be inferred from these two rows, as sample sizes are different.

[4] Total based on inflation-corrected local energy prices; median based on inflation-corrected standardized energy prices (\$2003).

[5] Percentage savings are generally not available for new construction, as there is no opportunity to measure energy use in the hypothetical (unbuilt) un-commissioned building.

[6] A number of cases show commissioning costs partly or fully offset by resultant first-cost savings.

¹⁹ Unless otherwise noted, dollar values presented in the remainder of this report are normalized to year-2003 dollars, and savings calculations are only presented for projects with weather-normalized pre-/post-commissioning data.




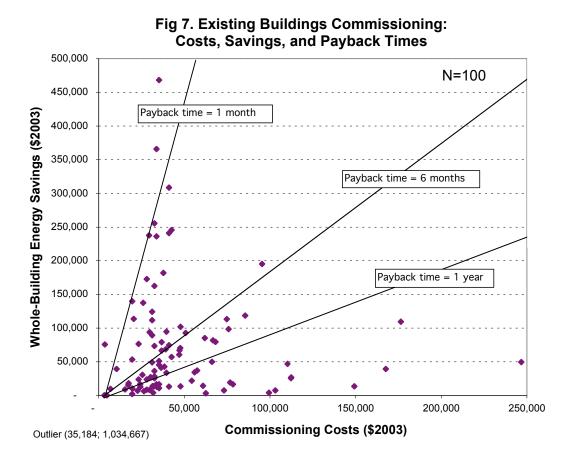



Fig 8. New Construction Commissioning: Costs, Savings, and Payback Times

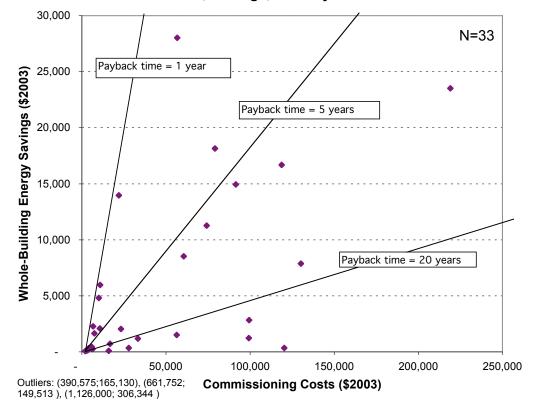

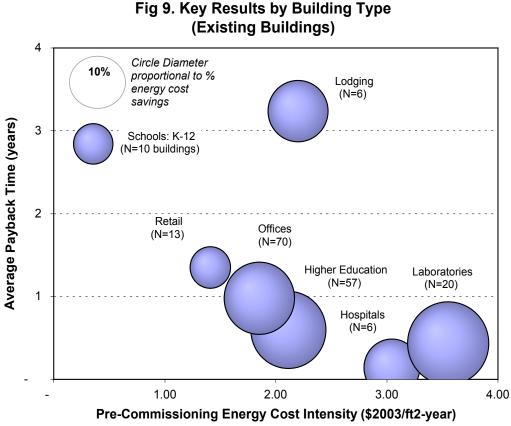

Excluding non-energy impacts



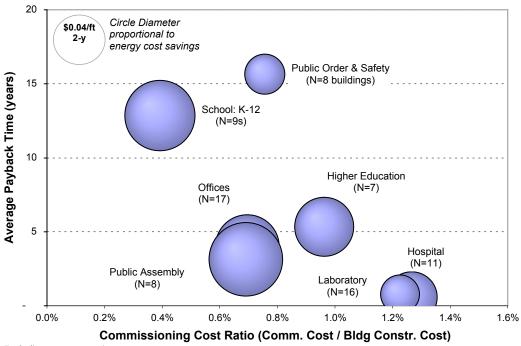

Excluding non-energy impacts

Table 7.	Results summar	v with quartile	analvsis:	Existing buildings.
		j		

Table 7. Results summary		Number of		Bottom 25%		,	Top 25%	Мах
		projects				5 -	•	
Commissioned floor area	ft²	106	5,690	95,101	151,000	209,729	271,650	1,014,133
Commissioning Costs								
Total	\$2003/building	102	3,214	26,112	33,696	46,442	45,862	476,554
Normalized - excluding non-energy impacts, NEIs*	\$2003/ft ²	102	0.03	0.13	0.27	0.41	0.45	3.86
Normalized - only for cases including non- energy impacts, NEIs*	\$2003/ft ²	11	-0.27	0.04	0.17	0.41	0.45	1.88
Cx agent fee as percentage of total commissioning fee	%	9	32%	35%	67%	57%	71%	76%
Costs paid by:								
Building owner	%	31	0%	32%	50%	47%	50%	100%
Utility (e.g. as rebate)	%	48	20%	50%	84%	75%	100%	100%
Other (e.g. research grant)	%	7	33%	100%	100%	90%	100%	100%
Utility rebates (included in above costs)	\$2003/building	48	917	11,932	20,500	23,685	25,000	76,725
as % of total costs	%	48	20%	50%	84%	75%	100%	100%
Deficiencies								
Per building	Number/building	85	0.7	5.0	11	32	21.0	640.0
Per 100kft2	Number/100kft ²	85	0.1	2.8	6	24	18.3	225.6
Measures								
Per building	Number/building	75	1.0	4.5	9.0	20.3	18.0	481.0
Per 100kft2	Number/100kft ²	66	0.1	2.5	5.9	8.6	12.7	218.6
Total Energy Cost Saving	n a secie a L (C/h i l slim a s	100	05 750	44 700		CC 400	75.040	070 404
Raw data (mixed energy prices and years)	nominal \$/building-yr	100	-25,752	11,739	33,629	66,489	75,940	879,101
Local energy prices Standardized US-average energy prices	\$2003/building-yr \$2003/building-yr	100 57	-26,595	13,351 14,646	37,376	75,393 105,156	80,615 98,708	1,034,667
Percent energy bill savings	\$2003/building-yi	74	-39,043	7%	44,629 15%	105,150	28%	54%
Normalized Energy Cost Savings								
Raw data (mixed energy prices and years)		100	-0.09	0.11	0.04	0.42	0.46	3.83
Local energy prices	nominal \$/ft ² -yr	100	-0.09	0.11	0.24	0.42	0.46	4.33
Standardized US-average energy price	\$2003/ft ² -yr \$2003/ft ² -yr	56	-0.09	0.11	0.27	0.47	0.52	3.23
Monetized non-energy Impacts (one-time)								
Per project	\$2003/project (1000s)	10	-281	-31	-17	-45	-11	-1
Normalized by floor area	\$2003/ft2-yr	10	-0.55	-0.45	-0.18	-0.26	-0.10	0.00
Energy Savings								
Electricity	kWh/ft²-yr	57	-0.70	0.64	1.7	2.2	2.76	9.72
Percent savings	%	46	-5%	5%	9%	11%	15%	36%
Peak electrical power**	W/ft ²	6	0.1	0.4	0.6	0.7	0.8	1.6
Percent savings	%	3	1%	2%	2%	7%	9%	17%
Fuel	kBTU/ft²-yr	29	-14.2	2.3	6.5		13.5	209.5
Percent savings	%	19	-16%	1%	6%	13%	23%	67%
Thermal (chilled water, hot water, steam)	kBTU/ft²-yr	19	6	32	64		122	356
Percent savings	%	16	13%	23%	36%	37%	48%	63%
Total	kBTU/ft ² -yr	57 46	-15 -7%	7%	<u> </u>	49.3 19%	56 29%	357 57%
Percent savings	%	-0	-7 70	1 70	13%	1370	23/0	517
Payback Times [undiscounted]								
Raw data (mixed energy prices and years)	years	99	-1.5	0.4	1.0	2.1	2.0	20.7
Local energy prices and inflation-corrected cx costs	years	99	-1.5	0.3	1.0	2.1	2.4	26.1
Standardized U.S. energy prices and inflation- corrected cx costs	years	59	-1.0	0.2	0.7	1.7	2.1	10.4

* Non-energy impacts (NEIs) include increases or decreases in first or operating costs due to changes in maintenance costs, contractor callbacks, equipment life, and ** Most are averaged over the entire year, hence true "peak" savings are significantly higher than shown here.

Table 6. Results summary	man quarano	Number of		Bottom 25%			Top 25%	Мах
		projects	(050				454.000	
Commissioned floor area	ft²	69	1,072	32,268	69,500	118,369	151,000	685,000
Commissioning Costs								
Total	\$2003/building	69	2,089	19,515	74,267	165,139	218,960	1,126,000
Normalized - excluding non-energy impacts, NEIs*	\$2003/ft ²	69	0.10	0.49	1.00		1.66	18.20
Normalized - only for cases including non- energy impacts, NEIs*	\$2003/ft ²	22	-7.82	-0.27	0.35	0.11	1.22	4.40
As % of construction cost (excl. NEIs) [%]*	%	65	0.1%	0.3%	0.6%	0.9%	1.1%	5.9%
As % of construction cost (incl. NEIs) [%]*	%	22	-5.2%	-0.2%	0.2%	0.03%	0.8%	1.5%
Cx agent fee as percentage of total commissioning fee	%	25	56%	74%	80%	78%	86%	94%
Costs paid by:								
Building owner	%		50%	50%	50%		100%	100%
Utility (e.g. as rebate)	%	31	50%	50%	100%	79%	100%	100%
Other (e.g. research grant)	%	2	-	-	-	-	-	-
Utility rebates (included in above costs)	\$2003/building	31	2,089	6,542	16,650	27,055	42,677	128,265
as % of total costs	\$2003/building		50%	50%	10,000		100%	100%
Defining in								
Deficiencies		24	0			67	75	705
Per building	Number/building	34	2		28	-	75	705
Per 100kft2	Number/100kft ²	34	5	16	37	90	81	1,010
Measures								
Per building	Number/building	21	2	3	7	55	30	705
Per 100kft2	Number/100kft ²	22	5	13	20	13	43	285
Total Energy Cost Soving								
Total Energy Cost Saving	nominal ¢/huilding ur		20	252	4.044	22.604	14 6 2 9	200.000
Raw data (mixed energy prices and years)	nominal \$/building-yr \$2003/building-yr	33	39 46	352	1,944		14,628	300,000
Local energy prices		33 27	-88		2,288			306,344
Standardized US-average energy prices Percent energy bill savings	\$2003/building-yr %		-00	622	2,533	9,220	13,722	61,288
Normalized Energy Cost Savings								
Raw data (mixed energy prices and years)	nominal \$/ft ² -yr	. 33	0.00	0.02	0.05	0.25	0.13	3.20
Local energy prices	\$2003/ft ² -yr		0.00	0.02	0.05	0.29	0.16	3.84
Standardized US-average energy price	\$2003/ft ² -yr	20	0.00	0.02	0.05	0.11	0.19	0.44
Monetized non-energy Impacts								
Per project	\$2003/project (1000s)	22	-1418	-138	-51	-177	-15	17
Normalized by floor area	\$2003/ft2-yr	22	-43.93	-6.96	-1.24	-6.11	-0.23	0.43
Energy Savings								
Electricity	kWh/ft²-yr	29	-0.49	0.20	0.5	1.2	1.36	5.63
Percent savings	%		8%	8%	8%		11%	13%
Peak electrical power**	W/ft ²	11	0.0	0.03	0.1		0.2	0.6
Percent savings	%	-	-	-		-	-	-
Fuel	kBTU/ft²-yr		-3.6	0.2	2.2	2.1	3.4	13.5
Percent savings	%		-	-	-	-	-	-
Thermal (chilled water, hot water, steam)	kBTU/ft²-yr		-	-	-	-	-	
Percent savings	%		-	-	-	-	-	-
Total	kBTU/ft²-yr	30	-1	2	3.2	6.2	8	26
Percent savings	%	-	-	-	-	-		-
Payback Times [undiscounted]								
Raw data (mixed energy prices and years)	years	39	0.0	1.9	6.5	23.0	19.5	303.1
Local energy prices and inflation-corrected cx	years		0.0				22.6	175.4
costs Standardized U.S. energy prices and inflation-	years	35	0.0	1.2	4.8	14.0	16.6	105.0
corrected cx costs	,							

Table 8. Results summary with quartile analysis: New construction.

* Non-energy impacts (NEIs) include increases or decreases in first or operating costs due to changes in maintenance costs, contractor callbacks, equipment life, and ** Most are averaged over the entire year, hence true "peak" savings are significantly higher than shown here.

Existing Buildings

Drivers, Scope, and Expenditures

Our compilation includes existing-buildings commissioning results for 150 existing buildings (106 projects) in 15 states, representing 22.2 million square feet of floor space. The median building size was 151,000 square feet and the median year constructed was 1978.

The 85 cases providing information on reasons for commissioning reported a wide range of drivers, the most important being energy savings (94%), with more general performance considerations, thermal comfort, occupant productivity, and ensuring indoor air quality also ranking high (Figure 11).

The scope of commissioning varied from project to project. Figure 12 presents our characterization of fifteen distinct steps in the process (for 73 reporting projects), and indicates the share that included each given step. No one project included every step, although most developed a formal commissioning plan, performed trend analysis, estimated cost savings, and implemented operations and maintenance improvements.

The total investment in existing-buildings commissioning (in inflation-corrected 2003 dollars) was \$5.2 million with a median value of about \$33,696 per project (\$46,442 average; N=102 projects), or \$0.27 per square foot (range of \$0.13 to \$0.45 from the first to third quartiles). The full range of costs was much wider, from a minimum value of \$0.03 to \$3.86 per square foot. For the subset (11 projects) with quantified non-energy impacts, the median cost was \$0.17 per square foot (with an inter-quartile range of \$0.04 to \$0.45 per square foot). Commissioning agent fees ranged from 35 percent to 71 percent (first to third quartiles) of total commissioning costs, with a median value of 67 percent (with 9 projects reporting this information).

For the 55 projects reporting, the primary usage of commissioning funds was for investigation and planning (69 percent), followed by actual implementation of measures (27 percent), with reporting and the verification and persistence tracking had important but more minor roles (Figure 13). Building owners, utilities, and other third parties (e.g., government grants) have all played important roles in funding and co-funding commissioning projects (details in Table 7). In the 48 projects reporting utility funding, the median contribution by utilities was 84 percent of total costs commissioning costs, corresponding to a median incentive of \$20,500 per project.

For existing buildings, normalized commissioning costs expectedly scaled downwards with floor area, dropping considerably for buildings above 200,000 square feet. Possible reasons for this will be discussed below.

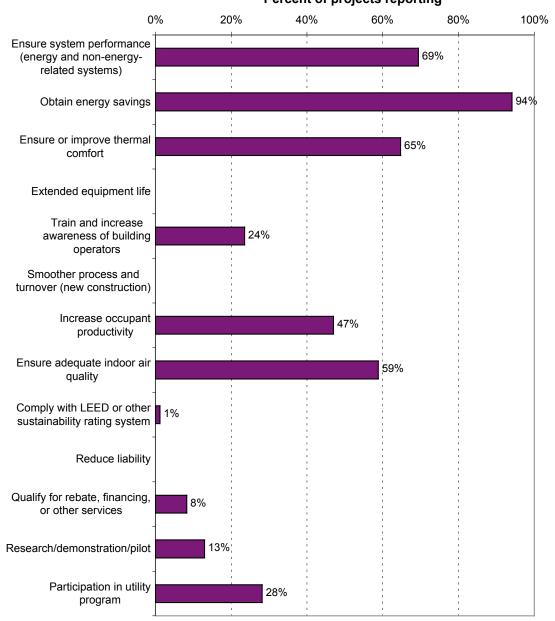


Fig 11. Reasons for Existing Buildings Commissioning (N=85) Percent of projects reporting


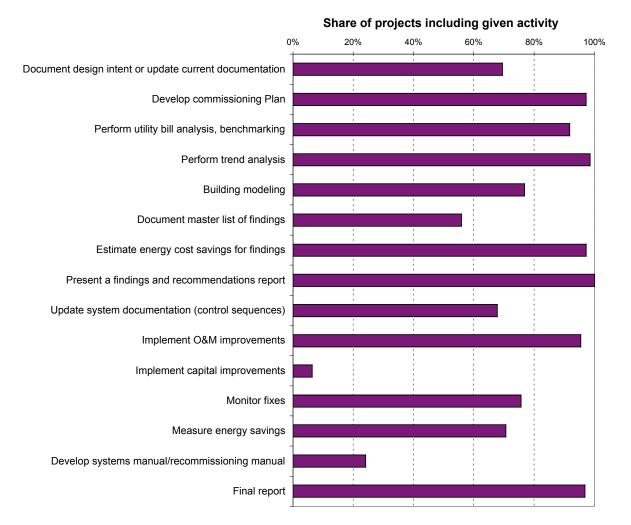


Fig 12. Scope of Existing Buildings Commissioning (N=73)



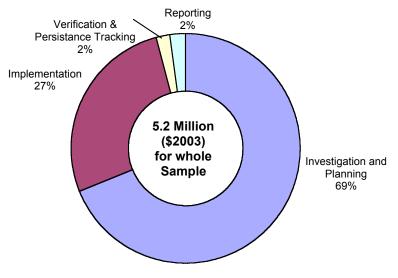

Impacts


We find that investments in existing-buildings commissioning have yielded considerably positive results, as outlined below.


Deficiencies and measures

Among the 85 studies reporting, 3500 deficiencies were found in the process of existingbuildings commissioning, with a median value of 11 deficiencies per building (average of 32), ranging as high as 640. Problems with air-handling and distribution were the most prevalent, followed by cooling and then heating plant (Figure 14). Approximately 85% of the characterized deficiencies were related to the overall HVAC system. A significant proportion of the total were not characterized.

The number of corresponding measures was somewhat lower, although counting conventions make it difficult to compare the two datasets, and there is not necessarily a one-to-one correspondence between the number of deficiencies and measures (Figure 15). The leading measure within the Design, Installation, Retrofit, Replacement category involved some form of equipment retrofit/replacement (e.g., replacing faulty sensors) (216 cases). Within the Operations and Control category, the leading measure was implementing advanced reset (131 cases), and within the Maintenance category, the leading measure was mechanical fixes (147 cases), closely followed by calibration (114 cases).

We compiled Measures Matrices for 69 of the existing-buildings projects analyzed in this study. These matrices show the correspondence between the building component or system in which a deficiency was found and the type of measure implemented. Approximately 700 measures were mapped against their corresponding deficiencies (Table 9). Again, the greatest prevalence of measures is seen in air handling and distribution systems, 357 in all (followed by cooling plant), with implementation of advanced reset the most popular measure. Other particularly frequent measures include modification of set-points, scheduling, and control sequences; calibration; mechanical fixes: and equipment replacements. The overall category of "Operations and Control" is clearly the epicenter of commissioning measure implementation. The



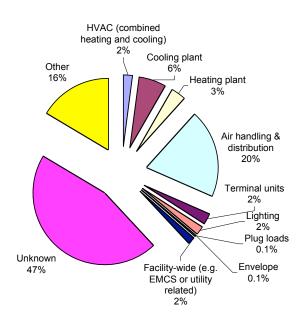

small number of measures in the "Other" categories suggests that the matrix adequately accommodates the types of issues that arise in existing buildings. In our judgment, the virtual absence of measures in building envelopes and plug loads (and perhaps lighting) is probably more reflective of a lack of inspection in these areas than the actual absence of deficiencies.

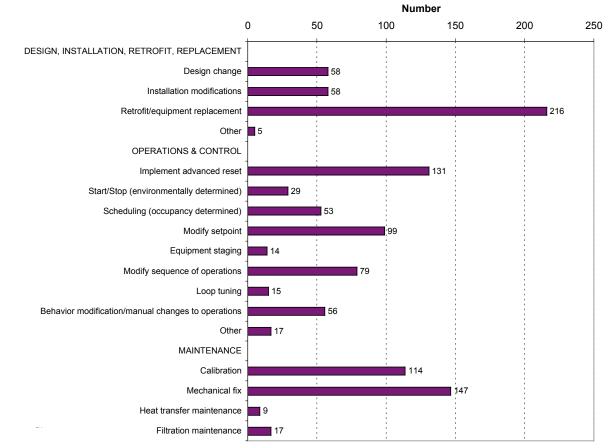


Fig 15. Frequency of Recommended Measures (Existing Buildings, N=1606)

Table 9. Results from Measures Matrices: Existing buildings (69 projects) [yellow highlights indicate most common measures, deficiencies, and combinations].

		nstal Ret	aign, lation, rofit, cemen				Oper	atior	ıs &	Conti	rol			Maiı						
N (paired) = 702	Design change	Installation modifications	Retrofit/equipment replacement	Other	Implement advanced reset	Start/Stop (environmentally determined)	Scheduling (occupancy determined)	Modify setpoint	Equipment staging	Modify sequence of operations	Loop tuning	Behavior modification/manual changes to operations	Other	Calibration	Mechanical fix	Heat transfer maintenance	Filtration maintenance	Other	Deficiency unmatched to specific measure	
Deficiencies	5	D2	ß	D4	0C1	002	0C3	004	005	900	007	008	003	μ	M2	МЗ	M 4	M5	Defic	Total
HVAC (combined heating and cooling)			8	1	1	1	5	3	1	5		0	2	5		1	5	2	12	61
Cooling plant C			19	0	26	5	4	10	4	27	3	12	2	4	10	1	0	0	13	155
Heating plant H			5	0	<mark>15</mark>	7	1	4	0	7	1	5	1	4	7	1	0	0	18	80
Air handling & distribution A			19	3	80	9	21	25	4	24	12	14	6	40	27	3	4	2	40	357
Terminal units T			2	1	4	0	3	14	0	4	1	2	1	7	10	0	0	0	8	61
Lighting L			17	1	1	2	4	0	0	0		5	0	2	1	0	0	0	1	38
Envelope E			0		0	0	0	0	0	0		0	0	0	0	0	0	0	0	0
Plug loads P			0		0	0	0	0	0	0	-	1	0	0	0	0	0	0	0	1
Facility-wide (e.g. EMCS or utility related) F				0	1	0	7	0	0	1	1	7	2	2	2	1	0	0	3	34
Other C	0	0	2	0	0	0	0	2	0	1	0	1	0	0	3	0	0	1	12	22
Deficiency unmatched to specific measure	10	9	7	0	2	2	1	29	2	7	2	4	1	12	10	0	0	0		809
Total	39	38	81	6	130	26	46	87	11	76	20	51	15	76	77	7	9	5	800	

Energy savings and cost-effectiveness

The underlying energy data represent a mix of measured and engineering estimates. Approximately 40 percent of the cases were based strictly on estimates, while the balance involved some degree of measurement (often in combination with estimation methods). We describe the type of measurement, using the terms of the International Performance Measurement and Verification Protocols (Appendix D), as show in Figure 16. Wholefacility measurement (mastermetering) was by far the most common, although sub-metering or calibrated simulation were used in some cases.

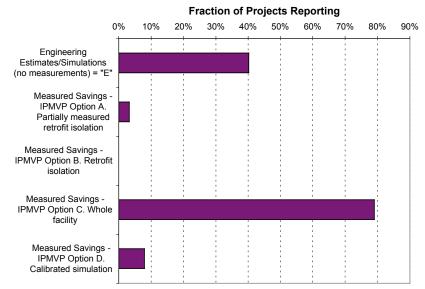


Fig 16. Commissioning Savings Verification Methods (Existing Buildings, N=97)

Amounts total more than 100% because more than one method used in some cases


Figures 17 to 23 provide a variety of vantage points on the cost-effectiveness analysis for existing-buildings commissioning. Only one project experienced an overall increase in energy use, which could result, for example, from fixing a broken (non-operating) piece of equipment. Most projects achieved energy savings in each form of energy targeted by commissioning (95 percent of projects achieved electricity savings, 79 percent in the case of gas, and 100 percent in the case of purchased thermal energy). Median total (whole-building) savings were 17 kBTU/ft²-year (15%) [and 1.7 kWh/ft²-year (9%) for electricity, 0.6 W/ft² for peak electric power (2%), 6.5 kBTU/ft²-year (6%) for natural gas, and 64 kBTU/ft²-year for purchased thermal energy (36 %, e.g., metered hot water]. These include a mix of projects for which commissioning ranged from limited (e.g., to a particular energy efficiency measure) to comprehensive (whole-building). The upper quartile of total energy savings was significantly higher in each case (Table 7). In individual cases, savings ranged to over 50 percent of whole-building energy use.


Notably, the cost-effectiveness of existing-buildings commissioning projects using measured data (N=55) was significantly higher than for those relying only on engineering estimates (N=35): $0.58/ft^2$ -year energy bill savings (0.4 year payback time) versus $0.22/ft^2$ -year (1.3 year payback time). Possible explanations include that savings measurement correlated with greater care in the commissioning process generally—and revealed additional deficiencies that were in turn corrected—or that estimates were conservative by design. However, the cohort with measured savings contained more energy-intensive buildings, most of which were located in Texas. These observations are thus inconclusive.

Median standardized annual energy cost savings were \$44,629 per building (average 105,156 per building, N = 57 projects). Median normalized energy cost savings were $0.26/\text{ft}^2$ -year. Savings

ranged as high as \$1.8 million per building per year (\$3.83/ft²-year). Savings approached or exceeded 50 percent of whole-building energy costs in a number of cases (Figure 17). Energy cost savings, energy savings, and corresponding payback times did not correlate strongly with pre-commissioning energy intensity (Figure 19), indicating that commissioning of "ordinary" or even "efficient" existing buildings can be effective, while payback times declined with increasing building size, especially for buildings with floor area above 100,000 square feet. This is shown in Figure 18, which also provides an opportunity to see the effect of normalizing raw data to standardized energy prices and correcting for inflation. While many small buildings achieved cost-effective commissioning, it is clearly more challenging for this cohort.

Most projects were highly cost effective. Median payback times of 1 year (N=99 projects) were achieved based on the raw data (un-normalized for energy prices or inflation), dropping to 0.7 years (N=59) when data were normalized to standardized average U.S. energy prices and commissioning costs and savings are inflation-corrected (all in \$2003). Upper-quartile paybacks were approximately 2 years, and 0.2 years for the lower quartile. While, on average, normalization for energy prices and inflation did not have a large absolute effect, adjusted values varied by up to a factor of four in individual cases.

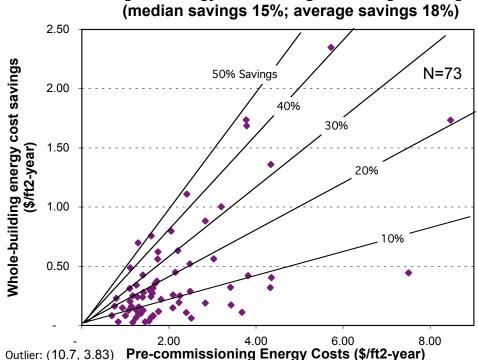



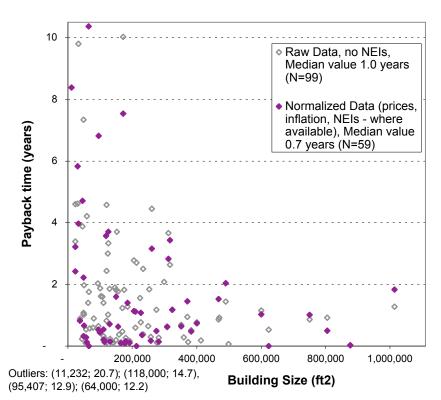
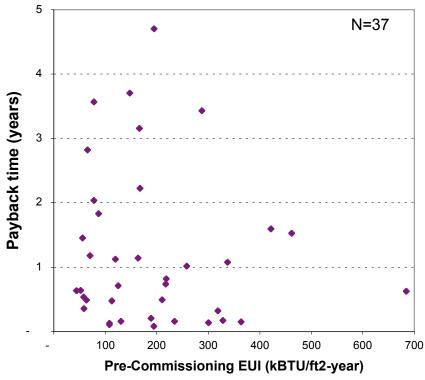


Fig 18. Commissioning Payback Time vs. Building Size (Existing Buildings)

Fig 19. Payback Time vs. Pre-Retro-Commissioning EUI (Existing Buildings)



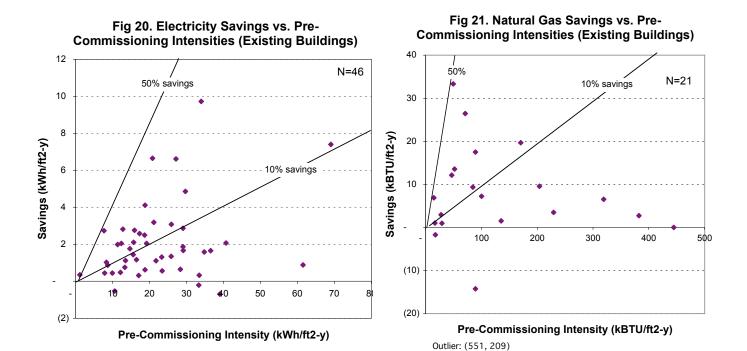


Fig 22. Purchased Thermal Energy Savings vs. Pre-Commissioning Intensities (Existing Buildings)


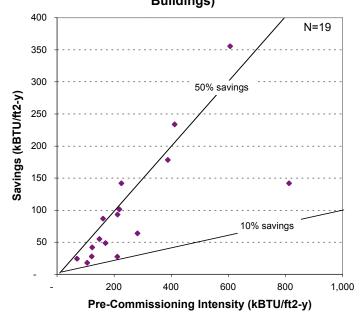


Fig 23. Total Energy Savings vs. Pre-Commissioning Intensities (Existing Buildings)

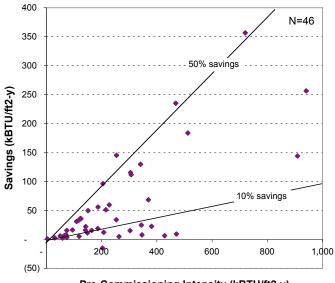

Pre-Commissioning Intensity (kBTU/ft2-y)

Formation and persistence of savings


For the cases where multi-year data were available on energy use and savings trends, it is clear that that savings can manifest gradually and thus analysts may underestimate savings if using data only from the first post-commissioning year. This caveat is applicable in cases where the commissioning agent makes recommendations that are only subsequently (and potentially gradually) implemented by in-house personnel.


On the other hand, savings are also not permanent, and can erode as the building falls back into disrepair or otherwise "out of tune." Similarly, measure life can also be quite finite (e.g., when replacing a fouled filter). Figure 24 illustrates these effects for 20 projects over a four-year period. Electricity savings were both most shallow and most likely to persist, while those for steam or hot water were deepest, but least likely to persist. Payback times were shorter than the period over which savings are observed to erode.

Only two formal studies have been conducted on the persistence of existing building commissioning, for a total of 18 existing buildings (Turner *et al.* 2001; Bourassa *et al.* 2004). Those results are included in our compilation. Repeated or follow-up commissioning of existing

buildings is likely to be indicated when consumption increases significantly. This was necessary in two buildings of a ten-building study within four years (Claridge *et al.*, 2002).

For the ten cases provided by the Energy Systems Laboratory at Texas A&M University, almost 75% of the increase in energy use was caused by significant component failures and/or control changes (related to other building problems) that did not compromise



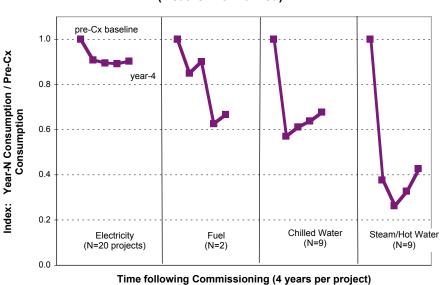

comfort, but caused large changes in consumption. The remainder (25% of the observed increase) was due to control changes implemented by the operators. This suggests that tracking consumption for evidence of significant consumption increases is the most important means of determining the need for follow-up commissioning. It also suggests that hidden component failures are a major (possibly *the* major) culprit in persistence problems.

Non-energy impacts

Of the existing projects in this compilation, information on 81 perceived non-energy benefits was available for 36 cases. Extended equipment lifetime was reported in one-third of the cases, and

improved thermal comfort in one-fifth of the cases (Figure 25). Other benefits, in order of decreasing incidence, involved indoor air quality, first-cost reductions, labor savings, productivity/safety, change orders and warranty claims, and liability reduction. Where the economic value of these impacts (10 cases) was quantified (median value of -\$17,000 per project – negative value corresponds to savings, positive value to increased cost), we included it in the cost-benefit analysis. The median NEI value was -\$0.18/ft² with an inter-quartile range of -\$0.10 to -\$0.45/ft².




Drivers, Scope, and Expenditures

Our compilation includes commissioning results for 69 new-construction projects (74 buildings), in fifteen states, representing 8.2 million square feet of floor space. The median building size was 69,500 square feet and the median year constructed was 1996. The total construction value of these buildings exceeded \$1.5 billion (\$2003).

The 30 cases providing information on reasons for commissioning reported a wide range of drivers, the most important of which was ensuring system performance (87%), with ensuring comfort, indoor air quality, operator training, and energy savings also ranking high (Figure 26).

The scope of new-construction commissioning varied from project to project. Figure 27 presents our characterization of sixteen distinct steps in the process (for 26 reporting projects), and indicates the share of projects that included each step. No one project included every step. Most projects included developing a written commissioning specifications and preparing a formal commissioning plan, verification checks, functional testing, training, and review of O&M manuals.

The total investment in new-construction commissioning (in inflation-corrected 2003 dollars) was \$11.8 million with a median value of \$74,000 per project (N=69 projects), or \$1.00 per square foot, or 0.6% of total construction cost (an inter-quartile range of \$0.49 to \$1.66 from the first to third quartiles). The full range of costs was much wider, from a minimum value of \$0.10 to \$18.20 per square foot. Commissioning agent fees ranged from 74 percent to 86 percent of the total commissioning investment (first to third quartiles), with a median value of 80 percent (with 25 projects reporting this information).

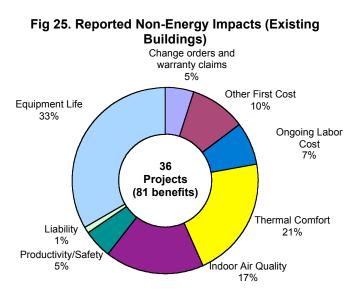

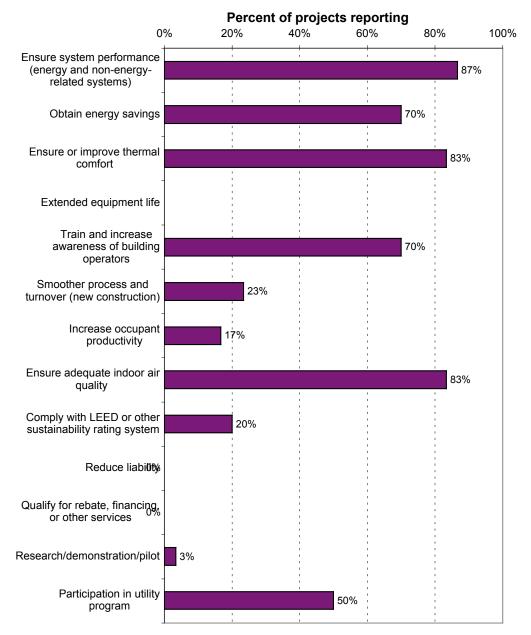


Fig 26. Reasons for New-Construction Commissioning (N=30)

Direct commissioning costs (excluding non-energy impacts) had a median value of 0.6 percent of total construction costs (N=65), ranging from 0.3 to 1.1 percent (Figures 28 and 29). These costs are often zero or negative if non-energy benefits (e.g., equipment downsizing) are included. In one case, first-cost savings achieved through commissioning resulted in a five-percent overall reduction in construction cost. The cost ratio shows a steady downward trend as building size increases, especially for buildings over 50,000 square feet in size. When first cost-savings are included, the median net cost ratio declined to 0.2 percent of total construction costs (average value 0.0 percent), and 7 cases out of 22 reporting had negative net costs.

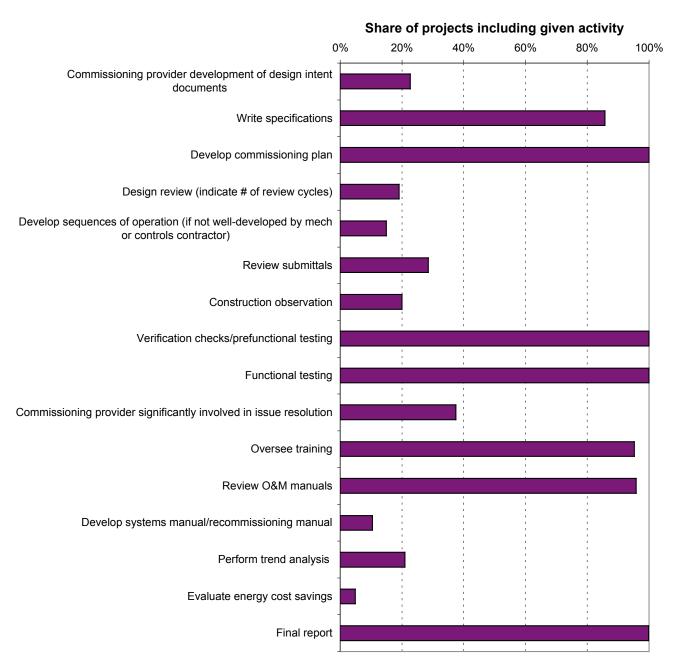


Fig 27. Scope of New-Construction Commissioning (N=26)


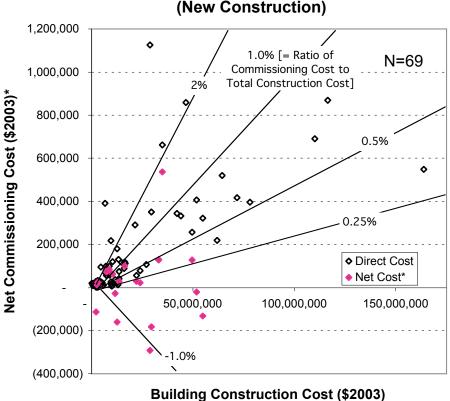


Fig 28. Commissioning Cost vs. Project Cost (New Construction)



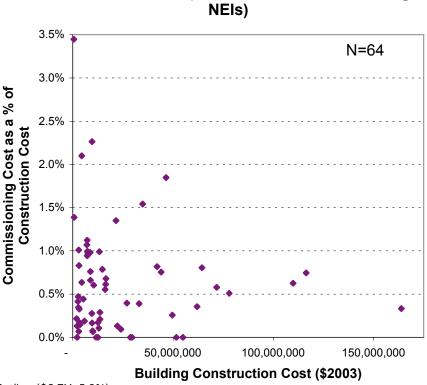


Outlier: (\$6.7M, 5.9%)

For the 5 projects reporting, the primary usage of commissioning funds was for acceptance testing (64%), followed by design review (18%), with construction observation and warranty

making up the balance (Figure 30). Building owners, utilities, and other third parties (e.g., government agencies) have all played important roles in funding and co-funding the newconstruction commissioning projects. Utility rebates were widely used, with a median value of \$16,650 across the 31 reporting projects.

For new construction, normalized commissioning costs did not scale downwards with increasing floor area, suggesting that the fixed cost is lower than the variable cost. This is a notable difference when compared with existing buildings commissioning.



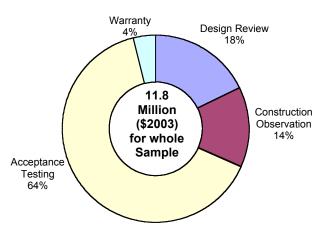


Impacts

We find that investments in commissioning have yielded positive results, as outlined below.

Deficiencies and measures


Among the 35 new-construction studies reporting, 3305 deficiencies were found in the process of commissioning, with a median value of 28 per building (average 67), ranging as high as 705. Deficiencies with airhandling and distribution were the most prevalent, followed by lighting and then HVAC plant (Figure 31). Approximately two-thirds of the characterized deficiencies were related to the overall HVAC system. A significant proportion of the total were not characterized.

The number of corresponding measures was lower, although counting conventions make it difficult to compare the two datasets (Figure 32).²⁰ The leading measures within the Design, Installation, Retrofit, Replacement category involved installation modifications (143 cases), within Operations and Control involved loop tuning (139 cases), and within Maintenance involved mechanical fixers (174 cases).

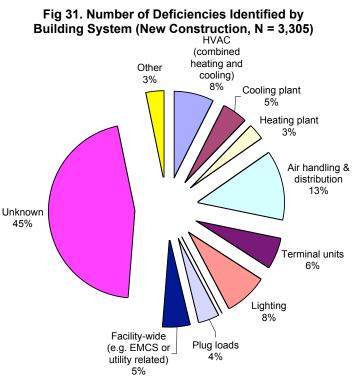

²⁰ There is not necessarily a one-to-one correspondence between deficiencies and measures.

In our judgment, the virtual absence of measures involving the building envelope is probably more reflective of a lack of inspection in these areas than the actual absence of deficiencies. The low level of design changes likely reflects the relatively late stage at which commissioning services are sought.

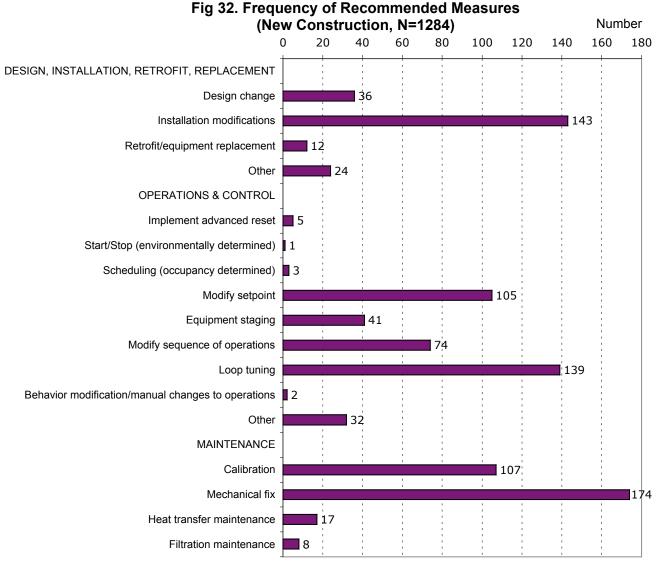

We compiled Measures Matrices for a subset of new-construction projects analyzed in this study (20 of 69 new-construction commissioning projects). The matrices show the relationship between the building component and system within which a deficiency was found and the type of measure implemented. Among new construction, 157 measures (of a total 1284 tabulated in the study) were mapped in this fashion (Table 10). The table shows the most common combinations of deficiencies and measures. Again, air-handling and distribution ranked as the highest source of deficiencies.

Table 10. Results from Measures Matrices: New construction (20 projects) [yellow highlights indicate most common measures, deficiencies, and combinations]

		Measures																			
			Design, Installation, Retrofit, Replacement Operations & Control Maintenance									ice									
N (paired) = 157		Design change	Installation modifications	Retrofit/equipment replacement	Other	Implement advanced reset	Start/Stop (environmentally determined)	Scheduling (occupancy determined)	Modify setpoint	Equipment staging	Modify sequence of operations	Loop tuning	Behavior modification/manual changes to operations	Other	Calibration	Mechanical fix	Heat transfer maintenance	Filtration maintenance	Other	Deficiency unmatched to specific measure	
Deficiencies		5	5	B	D4	001	0C2	003	004	005	006	007	008	ဗ္ဗ	Ā	M2	M3	M4	M5	Defic	Total
HVAC (combined heating and cooling)	V	0	8	0	0	-			3	1	0	1	0	3	6	9	1	2	2	108	146
Cooling plant	С	0	3	0	0	0	1	0	1	0	1	1	0	1	1	2	0	0	0	84	95
Heating plant	н	1	1	0	0	0	0	0	1	1	1	1	0	1	2	0	0	0	0	49	58
Air handling & distribution	Α	0	7	2	0	1	0	0	3	0	7	2	0	4	2	14	1	0	3	222	268
Air nanuling & distribution					-																
Terminal units	т	1	5	0	0	0	0	2	5	0	2	1	0	0	3	1	0	1	0	98	119
	T L	1	5 0	0	0	-	-		5 0	0	2 0	1 0	0	0 0	3 8	1 1	0	1 0	0	98 161	119 171
Terminal units	T L E		-	0 0	-	0	0	1						-					-		
Terminal units Lighting	L	0	0	0 0	0	0	0	1 0	0	0	0	0	0	0	8	1	0	0	0	161	171
Terminal units Lighting Envelope	L E	0	0 0 1	0 0 0	0	0 0 0	0	1 0 0	0 0	0	0	0 0	0 0	0	<mark>8</mark> 0	1 0	0	0	0	161 0	171 0
Terminal units Lighting Envelope Plug loads	L E P	0 0 0	0 0 1 1	0 0 0 0	0	0 0 0	0 0 0 0	1 0 0	0 0 0	0 0 0	0 0 1	0 0 0	0 0 0	0	8 0 2	1 0 0	0 0 0	0 0 0	0	161 0 81	171 0 85
Terminal units Lighting Envelope Plug loads Facility-wide (e.g. EMCS or utility related)	L E P F	0 0 0 0	0 0 1 1	0 0 0 0	0000	0 0 0 0	0 0 0 0 0	1 0 0 0	0 0 0	0 0 0	0 0 1 2 0	0 0 0	0 0 0	0 0 0 8	8 0 2 0	1 0 0 3	0 0 0 0	0 0 0 0 0	0 0 0	161 0 81 69	171 0 85 84

Energy savings and cost-effectiveness

It is more difficult to quantify energy savings resulting from new-construction commissioning than is the case for existing buildings. This is largely because there is no actual precommissioned building to measure, and simulating the building without the commissioningrelated corrections is costly. Instead, engineering calculations are commonly used to estimate differential savings (e.g., by reducing the number of full-load hours that a fan runs). In our sample neither whole-building pre- nor post-commissioning energy use were reported, only savings. Thus, we present absolute savings but not percentage savings.

As many of the new-construction projects emphasized a small number of measures, rather than a whole-building effort, many of the savings are small – the median standardized value is 2,533 per year ($0.05/ft^2$ -year). The average value is much higher at 9,226 ($0.11/ft^2$ -year), because the relatively small number of comprehensively commissioned cases has greater weight. When local energy prices are used, average savings rise to approximately 25,000 per year (because the local prices for this cohort tend to be significantly higher than the national-average value used in deriving our normalized estimates). Savings ranged as high as 306,000 per building per year. Median normalized energy cost savings were $0.05/ft^2$ -year (average $0.11/ft^2$ -year).

Median estimated total energy savings for our sample was 3.2 kBTU/ft^2 -year [0.55 kWh/ft}^2-year for electricity, 0.1 W/ft}^2-year for peak electrical demand, and 2.2 kBTU/ft^2 -year for natural gas]. These include a mix of projects for which commissioning ranged from limited (e.g., to a particular energy efficiency measure) to comprehensive (whole-building).

Median payback times of 6.5 years (N=39 projects) were achieved based on the raw data (unnormalized for energy prices or inflation, excluding non-energy impacts), dropping to 4.8 years (N=35) for standardized average U.S. energy prices and inflation-corrected commissioning costs (i.e., all costs in \$2003). Upper-quartile paybacks were 19.5 and 16.6 years, respectively, while lower-quartile paybacks were 1.9 and 1.2 years, respectively. Normalization for energy prices (including inclusion of non-energy impacts) had a considerable effect on outcomes (Figure 33). Non-energy savings were documented for one-third of the projects, and average payback times for most members of that group were zero (Figure 34). Dorgan *et al.* (2002) assert that, properly done, new-construction commissioning costs will be recovered through avoided (non-energy) first costs. Achieving cost-effective savings was more challenging for smaller buildings.


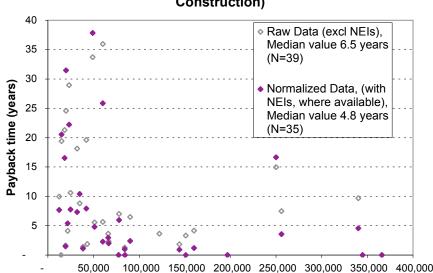


Fig 33. Payback Time vs. Building Size (New Construction)

Building Size (ft2)

Note: zero values reflect zero net cost (direct commissioning cost minus non-energy savings) Outliers: (69,500; 303), (64,500; 136), (58,000; 77), (29,371; 63)

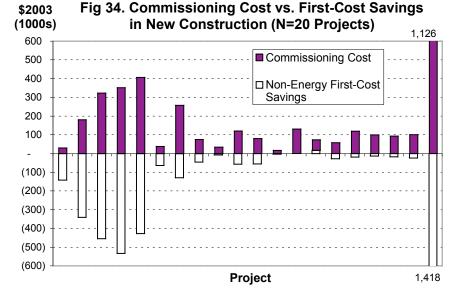


50

Formation and persistence of savings

Friedman *et al.* (2002 and 2003) present qualitative examples of the persistence of measures fixed during new-construction commissioning. Of 52 items analyzed in ten buildings, 37 were found to persist after several years. The authors note that there is a bias in favor of measures least likely to persist, as they were chosen as the focus of the study. The study suggests that changes in building scheduling and cooling plant control strategies are the most common sources of problems, compounded by limited institutional support of building operators, high operator turnover rates, poor information uptake from the commissioning process itself, and a lack of systems to help operators track energy use and system performance over time (Friedman *et al.* 2002). Only two new-construction projects in our sample provided information on the persistence of savings (and are included in Figure 24).

Non-energy impacts

For 44 new-construction projects in this compilation, information on 95 non-energy benefits were reported by the owner or commissioning provider (Figure 35). Improved equipment lifetime was the most commonly reported: 19 percent of the cases.²¹ Other benefits had roughly comparable frequency, including improved indoor air quality, first-cost reductions, labor savings, productivity/safety, and change orders and warranty claims. Ongoing labor-cost impacts are rarely cited. Where the economic value of these impacts (22 cases) was quantified (median value -\$51,000 project – negative value corresponds to savings, positive value to increased cost), we included it in the cost-benefit analysis. The median NEI value was - $1.24/ft^2$ with an inter-quartile range of -0.23 to - $6.95/ft^2$.

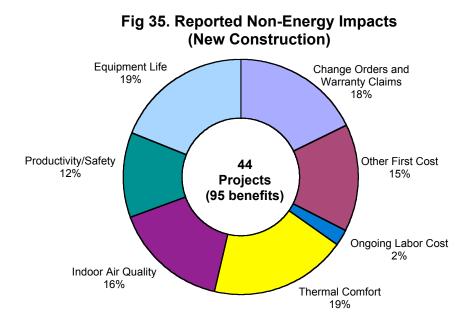


²¹ This is often accomplished by reductions in hunting or cycling.

Comparative Assessment of Commissioning in Existing Buildings versus New Construction

There are material differences between our results for existing buildings and new construction. This can be seen in the "bottom-line" results per unit floor area—six-fold greater median energy savings and four-fold lower commissioning costs for existing buildings. The combination of higher commissioning expenditures and lower floor areas as well as lower energy savings per unit floor area results in lower overall cost-effectiveness for new-construction commissioning than for existing buildings commissioning. Another reason for lower savings is that, for many of the new-construction cases, commissioning targeted only certain components (e.g. energy-efficiency measures), rather than the building as a whole, which skews the results. Due to the relative weights of a small number of high-savings projects, the average savings based on local energy prices are ten-fold greater than median values (\$2,500 versus \$25,000 per year). Standardizing to national average energy prices reduces the average to approximately \$9,200 per year. It should be noted, in any case, that median payback times (even excluding non-energy benefits) are attractive for existing buildings as well as new construction.

Judging from our sample, building owners appear to exercise different decision rules when determining how much to invest in existing buildings versus new construction commissioning. As seen in Figures 36 and 37, expenditures for new construction commissioning services rise generally along with building size, whereas, with few exceptions, expenditures for existing buildings tend to level out below \$50,000. The inference is that in the case of new construction, there is greater willingness to link the level of outlay to the total project cost, whereas larger existing buildings are not usually allocated proportionately more resources for commissioning than are small buildings. In both groups of building normalized costs tended to be highest for small buildings (and also show the greatest range), suggesting that the fixed costs of commissioning play an important role in overall outcomes. Commissioning for small new-construction projects is often less costly than for small existing-buildings projects.

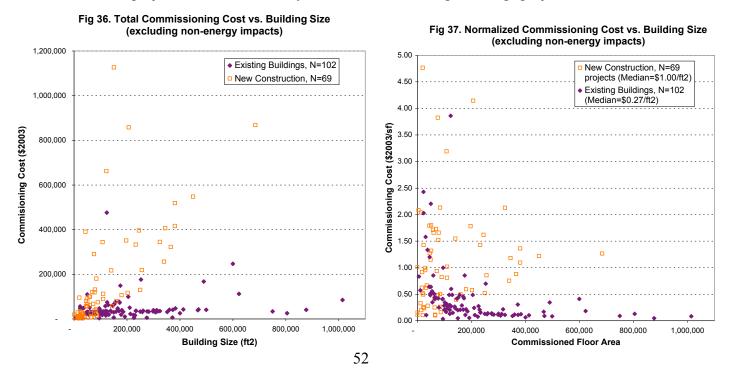

For projects included in this compilation, the practice of commissioning appears to be more comprehensive for existing buildings than in new construction, as shown previously in Figures 12 and 27. Critical steps are included in only a minority of new-construction projects, a key example of which is design review, which is included in only 20 percent of our sample. Comparably important steps—development of design intent documents and control sequences, reviewing submittals, and construction observation—have similarly low levels of incidence.

As suggested in Figures 11 and 26, new-construction commissioning is more strongly driven by non-energy objectives such as overall building performance, thermal comfort, and indoor air quality whereas existing-building commissioning is more strongly driven by energy savings objectives. This is consistent with our observation that the floor-area-normalized non-energy impacts were seven-fold greater in the case of new construction (Tables 7 and 8).

Reported non-energy benefits are vastly greater for the new-construction cases we compiled than for existing buildings. In fact, in cases where these benefits have been estimated, they often equal or exceed the cost of commissioning (rendering the effective payback time instantaneous). Thus, if fully valued, commissioning of new construction can be equally if not more cost-effective than that for existing buildings.

In both cases, problems with air-distribution systems and correctional measures focusing on operations and control were more pervasive than those with specific pieces of equipment. The need for commissioning in new construction is indicated by our observation that the number of deficiencies identified in new-construction exceed that for existing buildings by a factor of six.

The cohort of existing building projects is nearly twenty years older than our new-construction projects (median age of 1978 versus 1996). The newer buildings are presumably more energy efficient, which can be expected to moderate the savings potential to some degree. However, it is precisely the problems with the energy-efficiency systems in these buildings that commissioning is uniquely able to detect and remedy.

CAVEATS AND UNCERTAINTIES

Meta studies are always imperfect, as they rely on the availability, quality, and comparability of disparate primary data sources. While on the one hand, our compilation represents a "sample of convenience", it does also represent the majority of published studies, and a significant cross section of unpublished data from commissioning practitioner files. Following are caveats regarding the completeness or uniformity of the data as well as ways in which our results may capture only a portion of the true savings. We conclude that, on balance, our results underestimate the true economic benefits.

Potential Sources of Uncertainty or Over-prediction of Savings

- *Non-homogeneity of data.* As this is a meta-analysis, we compiled data originally collected by a variety of individuals, and representing many commissioning providers. As discussed under the Methodology section, above, we standardized and normalized data to the degree possible. To diminish the effect of extreme cases, we emphasize median (as opposed to average) results and provide a quartile analysis to reveal central tendencies.
- *Persistence of energy savings.* We were only able to analyze 20 cases of savings persistence over time only two of which were new construction. It is important to note that the fast payback times for commissioning measures are most likely significantly shorter than the period of erosion of savings, i.e., commissioning tends to pay for itself even if savings are not permanent. Only two of these studies applied to new construction, and hence more analysis is particularly needed in that arena. To conduct more extensive studies of persistence, a variety of tools are needed, e.g., improved performance monitoring and tracking systems.
- Inclusion of benefits for measures believed to have been implemented. Unless all recommendations are implemented "on the spot" by the commissioning provider, time must elapse before it is known which measures were implemented and, thus, what degree of anticipated energy savings captured. In this way, there is a potential that measures underpinning some of the savings reported were not implemented (58% of the existing-buildings projects partially or fully verified their measures to have been implemented—28% for new construction—others did not report one way or the other), or that savings reported exclude measures that may indeed have ultimately been implemented. Our perspective, however, is that the (sometimes arbitrary) choice by a building owner as to whether or not to implement the commissioning agent's recommendations is not an intrinsic reflection of the value of effectiveness of the commissioning process itself, and, thus, the merits of commissioning should be assessed based on the cost-effectiveness of proposed deficiency resolutions.

Potential Under-estimation of Benefits

• *Inappropriate attribution of costs to the commissioning process.* While commissioning providers identify new-construction deficiencies arising from non-adherence of other parties to the terms of their contracts (e.g., mechanical contractors improperly installing

equipment), the costs of correcting them should not be debited to the commissioning process. However, the costs associated with correcting deficiencies identified in existing buildings *are* ascribed to the commissioning process. For new and existing buildings alike, major energy-efficiency upgrades that go beyond the correction of a deficiency should be considered "retrofit" costs rather than commissioning costs. These accounting conventions, however, are not always adhered to, resulting in some degree of improper attribution of costs to the commissioning process.

- Energy savings from all possible measures not captured. Commissioning is not always applied to the entire building but, rather, may be limited to a given system (e.g., ventilation), given end-use equipment (e.g., to a chiller), or to recently installed energy efficiency measures, especially in new construction. Thus, the average results documented in this report reveal less than the true potential for comprehensive commissioning. Moreover, not all recommended measures are necessarily implemented and those that are implemented are often completed slowly. For example, Piette *et al.* (1995) excluded 92 measures among 16 buildings for which they were unable to estimate energy savings. For seven buildings described by Stum *et al.* (1994) potential energy savings for recommendations not implemented exceeded the savings for those that were implemented. Some sources exclude the energy savings from un-verified measures.
- Non-energy impacts (NEIs) are usually not expressed in monetary terms. This can lead to
 an underestimation of benefits or of costs; the tendency is towards the former. As we saw
 in Figures (25 and 25), non-energy factors are a big driver for commissioning and are
 often perceived as the primary benefits. In cases where NEIs have been estimated, they
 are significant often more so than the energy savings. As shown in this study, the
 payback times were shorter for cases where NEIs were included. In the case of new
 construction commissioning, we have seen that the value of NEIs can exceed the costs of
 commissioning, rendering an effectively instantaneous (if not "negative") payback time.
- Underestimation of predicted savings. In their in-depth study of commissioning in eight buildings (included in our compilation), Bourassa *et al.* (2004) observed that actual savings were, on average 28 percent above predicted levels (based on a one-to-one comparison of implemented measures). Other projects in our compilation exhibited this as well. Thus, measurement of savings seems to be positively associated with greater savings, however the limited available data suggest that more study of this question is required.
- *Financial benefits not fully captured by engineering economics*. Lastly, the most traditional engineering-economics figures of merit (including the simple payback time used in this study) systematically undervalue energy efficiency. This occurs, from the perspective of the building owner/investor, because a building's true market value is a multiple of net operating income (NOI, gross income minus expenses, which include energy). As NOI rises, so does the building's resale value, and reduced energy costs are one way in which significant increases in NOI can be attained. Excluding this effect tends to "miss" approximately two-thirds of the value created by energy efficiency (Mills 2004).

Extrapolating our Results to the U.S. Buildings Stock

To assess the applicability of our results to the U.S. buildings stock, three core issues regarding bias and the sample's value as a proxy for the greater building stock deserve consideration: (1) the physical characteristics of projects in the sample, (2) the presence of deficiencies, and (3) the depth and cost-effectiveness of the benefits.

While our compilation was not designed to be a statistically representative sampling of commissioning practices or building types, it captures the work of a large number of practitioners (at least 18) over a wide geographical area. As shown in Figures 3 to 5, our compilation includes buildings across 21 states and most of the major building types as defined by USDOE's "CBECS" survey (USDOE/EIA 2004). Our sample also spans a wide range of building sizes.

Tuffo *et al.* (2004) enumerate reasons why one would expect pervasive problems in commercial buildings, and describe the corresponding presence of barriers and lack of market structures needed to remedy the situation. Owners are generally not aware of problems and are unequipped to identify the symptoms, diagnose their causes, and implement the correct remedies. For example, only one in ten buildings have the types of energy management and control systems necessary to follow trends that provide an early warning for many types of problems (USDOE/EIA 2004). Historical utility efforts have focused primarily on hardware measures rather than operations and maintenance, and thus have, until recently, overlooked this opportunity. Leyard *et al.* (1999) found extensive potential for O&M savings across 266 facilities in eight utility service territories. Perhaps most importantly, even buildings that are in ideal operating condition at a given point in time are unlikely to remain that way.

In the case of new-construction commissioning, the subject buildings we evaluated were—essentially by definition—not known to have particular problems before commissioning. Hence, our sample (representing \$1.5 billion of construction value) has a considerable degree of randomness. In fact, the new-construction subset includes a number of LEED-rated buildings, which it can be argued are subject to more scrutiny and care in design than ordinary buildings. One commissioning practitioner we interviewed stated that they have found deficiencies in every LEED as well as non-LEED building commissioned.

Indications from the field are that building owners and commissioning providers also routinely encounter existing buildings with problems. A meta-analysis of four field studies found widespread problems even with in a single end-use area (rooftop units) at 181 commercial buildings in 5 states throughout the Pacific Northwest and California (Cowan 2004). We spoke to many commissioning providers who find problems in most buildings they examine. For example, programs run by Quantum Consulting conduct pre-screening of buildings to determine whether they are good candidates for commissioning, and find that 70 to 90 percent of existing buildings are candidates. As an indicator of the perspectives of large property owners, Marriott International has initiated an *enterprise-wide* major effort to commission each building in their inventory (Marriott Hotels & Resorts, The Ritz-Carlton, Renaissance Hotels & Resorts, Courtyard, Fairfield Inn, SpringHill Suites, Residence Inn, TownePlace Suites, and Marriott ExecuStay) (Quantum Consulting 2004).

Of the eight buildings evaluated by Bourassa *et al.* (2004), most of the building owners had no prior knowledge of problems before commissioning was undertaken. Six of these buildings achieved savings (all eight were included in our compilation, so the non-savings cases are included in our median results). The authors note that institutional buildings tend to be less in need of commissioning than are privately-owned ones. As our sample contains a large proportion of institutional buildings, this could suggest a potential conservatism in our results.

As the existing buildings in our sample were drawn from the literature and from commissioning practitioner files, it is appropriate to ask whether practitioners tend to report "worst-case" (highest savings) projects. For projects submitted to our compilation by TAMU and PECI, the criterion was data availability and completeness, as opposed to depth of savings. In many other cases we entered all available buildings. As a non-trivial number of the projects in our compilation achieved low levels of savings (negative savings in some cases) and identified small numbers of deficiencies, our median values as reflective of the wide range of impacts that can be expected to occur over a large population of buildings. Moreover, our use of median values gives less weight to high-savings cases than does the use of averages. While our sample may involve buildings that are more-energy intensive than national averages, cost effectiveness or percentage energy savings in the sample (see Figures 19 to 23) do not tend increase with the energy utilization index (EUI).

The most significant bias in our sample is the large number of buildings that utilize purchased thermal energy (hot water, chilled water, or steam). Most of these buildings are located in Texas, and were commissioned by Texas A&M University's Energy Systems Laboratory. This cohort achieved median energy savings of 36 percent. Excluding this group from our analysis lowers median energy savings from 15 percent to 10 percent (and increases median payback times from 0.7 years to 1.2 years). The actual "building-stock-weighted" savings would be somewhere in between these values.²²

If the results observed across our sample are representative of the practice and potential of commissioning, significant energy savings could be achieved nationally. Specifically, if our median project performance were to be achieved over the entire building stock (essentially an economic-potential, not adjusted for partial penetration rates) the full cost-effective potential would amount to 15-percent savings of the \$120-billion annual energy bill for the sector (as of 2002, see USDOE 2004). This translates into savings of \$18 billion annually among existing commercial buildings. In practice, an unknown fraction of the full stock could be reached.

As noted above, our median savings numbers are certainly less than would be achieved if all buildings had been comprehensively commissioned and all recommended measures implemented. The upper-quartile savings value is twice the median (29 percent; or 20 percent without the buildings with purchased thermal energy), which may be closer to a best-practice level of savings. Finally, consideration of potential benefits must consider trends in the baseline. As buildings become more complex and utilize more advanced technologies, the incidence of problems and need for commissioning will only increase, hence amplifying the need for and value of commissioning.

²² Approximately 13 percent of the U.S. building stock (by floor area) receives district heat or chilled water, versus 35 percent of our existing-buildings sample. None of our new-construction cases utilized purchased thermal energy.

CONCLUSIONS & RECOMMENDATIONS

We have assembled and synthesized the largest sample of real-world data on the energy and nonenergy impacts and cost-effectiveness of commercial building commissioning. The following discussion summarizes major findings, implications for energy planning and policy, knowledge gaps and research needs, and some closing thoughts on the way forward.

Major Findings

The performance of today's commercial buildings is compromised by a remarkably diverse array of physical deficiencies, approximately 7,000 examples of which were associated with the buildings included in our compilation. Quality assurance procedures such as those used in building commissioning can, however, address many of these issues, and do so in a cost-effective manner. HVAC systems present the most problems, particularly air-distribution systems. The most common correctional measures focus on operations and control.

Across our sample of 150 existing buildings, we found median whole-building energy savings of 15 percent (average 18 percent) and a corresponding payback time of 0.7 years. Median savings were approximately \$45,000 per building (\$2003), ranging as high as \$1.8 million, Applying these results to the national commercial building stock would correspond to \$18 billion in annual energy savings.

For the 74 new-construction cases, we found a median payback time of 4.8 years. Quantifying energy cost savings for new construction is confounded by the lack of baseline data (hypothetical energy use if not commissioned). Addition of non-energy impacts can drastically reduce these payback times, to or below zero in many cases.

We observed cost-effective results across a wide range of building types and sizes, with the best results seen among energy-intensive facilities such as hospitals and laboratories. Our results are conservative, insofar the scope of commissioning rarely spans all fuels and building systems in which savings may be found, as not all commissioning recommendations are implemented, and significant first-cost and ongoing non-energy benefits are rarely quantified.

While not a panacea, we find that building commissioning is one of the most cost-effective and far-reaching means of improving the energy efficiency of buildings, with applications across a large segment of the U.S. building stock. For example, the "Five-Lab Study" (Interlaboratory Working Group 1997) provided a major assessment of U.S. buildings energy savings potential, and found an electricity savings potential of approximately 180 billion kilowatt-hours per year in the commercial sector by the year 2010 at a levelized cost of conserved energy (CCE)²³ of approximately 0.01/kWh. Assuming a conservative five-year measure life, the median CCE of our existing building sample is one-tenth of that for the aforementioned "hardware" measures, i.e., 0.001/kWh.

²³ The cost of conserved energy (CCE) is defined as the annualized discounted measure cost divided by the annualized energy savings.

Implications for Energy Planning & Policy

While the potential is enormous and highly cost-effective, a vanishingly small fraction of the U.S. commercial buildings stock has as yet been commissioned. The challenge for policymakers and market actors is to design strategies for capturing this potential.

Commissioning is perhaps best understood as a form of risk management. At the individual facility level, it helps ensure that funds are spent wisely and that the intended energy savings targets are achieved in practice. At the regional or national level, commissioning essentially ensures and safeguards macro-level goals for energy savings and other benefits such as the reduction of greenhouse-gas emissions. The ultimate efficacy of energy efficiency research and development portfolios, as well as deployment programs, lies in no small part in the extent to which they are coupled with quality assurance in design and delivery. As we saw earlier in the case of US Department of Energy "high-performance building" demonstrations, it can be difficult to attain projected savings in practice, especially when sophisticated strategies are employed (Torcellini *et al.* 2004).

Coupled with design intent documentation, commissioning provides a way to define measurable performance targets and evaluate as-built and as-operated system conditions (Mills *et al.* 2002). It is, however, important not to view commissioning in isolation, but rather as part of an integrated strategy for improving building energy performance. For example, commissioning interoperates with traditional operations and maintenance, tune-ups, diagnostics, end-use monitoring, and the implementation of the entire spectrum of energy-efficiency measures.

Knowledge Gaps and Research Needs

Although this is the most comprehensive study to date, there remains value in compiling more case studies in a manner consistent with the methodology developed here. This would fortify the existing compilation, allowing more detailed analyses (e.g., outcomes by type of building) and more definitively determine actual costs in practice. This would naturally be complemented with activities to determine best practices in terms of minimizing costs and maximizing energy savings, cost-effectiveness, and market uptake of commissioning practice. It is also important to internationalize the data collection effort.

The current sample has a high proportion of public buildings (schools, hospitals, public order and safety, etc), and should be expanded to include more privately owned and operated facilities. Additional building types, e.g., cleanrooms, data centers, industrial facilities, and multi-family buildings should also be explored–and are today remarkably absent from the commissioning literature. Similarly, particular cohorts (e.g., LEED buildings and building-integrated renewable energy systems) should be analyzed. Analyzing the types and number of problems with high-performance buildings as well as their energy use compared to a modeled goal will make the effectiveness of advanced energy savings technologies clearer and enhance understanding of the importance of commissioning these facilities.

Using data like those collected here, models could be developed to predict commissioning costs and savings as a function of building location, characteristics, fuel choices, etc. Our existing database would also support analysis of the cost-effectiveness of specific commissioning measures in specific building systems. Such analysis would help prioritize and target commissioning deployment and market-transformation efforts.

Few if any commissioning efforts today focus on peak electrical demand, and none in our compilation focused on a new generation of "demand-responsiveness" technologies and strategies, which, due to their complexity and novelty, will no doubt present even a greater need for commissioning than conventional systems.


Commissioning takes many forms, both in the breadth and depth with which it is applied to a given project. A key outstanding question is the appropriate level of effort, and the relative benefits of in-depth versus superficial commissioning efforts. Figure 38 presents whole-building energy savings versus the number of steps (from Figure 12) involved in the existing-building

commissioning projects in our database. The relationship suggests that savings rise with increasingly comprehensive commissioning, but the question deserves more investigation. Payback times do not correlate with depth of commissioning. (Insufficient data were available to do the analysis for newconstruction commissioning.)

As a part of this ongoing costbenefit research, the persistence of benefits should also continue to be analyzed, both from the bottom-up (do individual measures persist?) and top-down (how does energy use change over time?).

Energy-efficiency R&D portfolios—be they in the public or private sector—routinely focus on specific technologies

Fig 38. Savings vs. Depth of Commissioning (Existing Buildings)

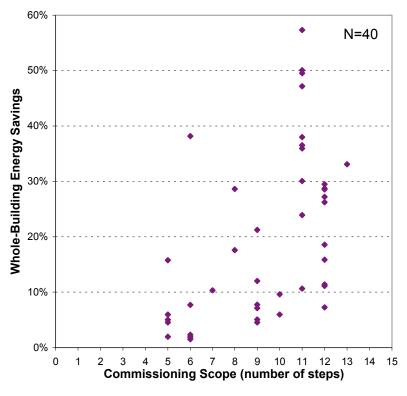

or physical systems. Less well attended to are process-oriented strategies such as commissioning. It is clear from our analysis that commissioning cannot only generate energy savings in its own right (e.g., by starting with "ordinary" buildings that are not particularly energy-efficient), but can also ensure the performance of energy-efficiency technologies. The latter is especially important for "emerging" technologies that tend to be more complex and less well-understood than status-quo technologies.

While providing many answers to long-standing questions about the cost-effectiveness of commissioning, this study has also identified a number of appropriate research and analytical opportunities, including:

- Create an improved and expanded set of performance metrics to use in evaluating commissioning experience.
- Improve the capture of deficiency data. We noted that there was a significant proportion of deficiencies categorized as "other" or "unknown", roughly one-half the total logged.
- Evaluate percentage whole-building savings for new-construction commissioning. None of the projects in the current compilation include such data.
- Analyze the energy savings and cost-effectiveness of specific commissioning measures. A considerable body of suitable data have been archived in our data base.
- Further explore the cost-benefit dynamics in smaller buildings, which exhibit a particularly wide range of results in our sample.
- Study "outlier" data-points to enhance understanding of both best and worst practices.
- Improve methods for identifying and quantifying non-energy impacts.
- Validate or refute the observed correlation of measurement of commissioning savings with deeper savings. Correlation may not equate to causation in this case.
- Develop methods for identifying and accounting for instances in which on-site personnel would have identified and corrected deficiencies without the contribution of commissioning providers.
- Reconcile the durability or persistence of commissioning measures—defining "measure life"—and the optimal frequency with which to commission. Only eighteen examples exist for existing buildings and only two for new construction.
- Develop better and more disaggregated estimates of the national savings potential, including a breakdown by building type and new versus existing. This exercise would benefit from further investigation into the pervasiveness of the types of building problems identified in this study (e.g., our current sample only contains one "food service" building).

A final important area of research is performance monitoring and diagnostics. One reason commissioning issues occur is that building operators are unaware that problems exist. An economizer damper may be stuck, or a variable-frequency drive control may be disabled limiting efficient operations and causing energy waste. New emerging technologies and ongoing research to develop performance monitoring and diagnostics tools offer the capability to detect and diagnose the root cause of such problems. Improved performance monitoring systems are needed to ensure critical measurements are available to detect problems. Numerous techniques for fault detection and diagnosis have been explored, including neural nets, physical dynamic models, and simple engineering rules. Research by Friedman and Piette (2001) examined a variety of tools currently in use. Further research is underway to develop performance monitoring specifications and robust diagnostic systems. New information technology and web-based energy information systems offer improved performance monitoring capabilities and platforms to host diagnostic tools (2003).

The Way Forward

Some see commissioning as a luxury and "added" cost, yet it is only a barometer of the cost of errors promulgated by other parties involved in the design, construction, or operation of buildings. Commissioning agents are just the "messengers"; they are only revealing and identifying the means to address pre-existing problems.

The fledgling field of commercial buildings commissioning has many innovative pioneers and, judging from the results of this study, their efforts have been effective. However, energy-oriented commissioning has attained a vanishingly small penetration rate. Future case-study research should be informed by market research designed to better understand what information decision-makers require, and how to best present it. Data-collection efforts should be focused on filling those information gaps, and better understanding the processes and reasoning by which commissioning recommendations are accepted or rejected in practice.

As buildings and the technologies within them become more complex and interconnected, the need for commissioning will increase. Education remains an important strategy for building the capacity for commissioning services in the marketplace and awareness among building owners and operators (Crabtree *et al.* 2004). For example, our samples of new and existing buildings alike showed that reduced equipment breakdown was the largest perceived non-energy benefit cited after commissioning was completed, yet it was never cited as a reason for originally embarking on the commissioning process.

Cost-benefit analyses such as those presented here will help program decision-makers weigh the cost-effectiveness of commissioning in their planning decisions, while enabling building owners to be more confident in undertaking the commissioning process. We invite others to contribute new case-study data to this compilation.²⁴

²⁴ Practitioners are invited to send data for inclusion in our database. Information can be entered into the spreadsheet available at http://eetd.lbl.gov/emills/PUBS/Cx-Costs-Benefits.html and addressed to <u>emills@lbl.gov</u>. The aforementioned California Commissioning Collaborative database (Friedman *et al.* 2004) is also accepting contributions or more in-depth case studies.

REFERENCES

Note: many of these references can be obtained through http://www.cacx.org/library

Altwies, J.E. 2002. "Information from a Commissioning Process Case History." Presentation to *Energy 2002*, Palm Springs, CA (PowerPoint).

Altwies, J.E. and I. B.D. McIntosh. 2001. "Quantifying the Cost Benefits of Commissioning." *Proceedings of the 9th National Conference on Building Commissioning*, May 9-11.

ASHRAE. 1989. "ASHRAE Guideline 1-1989: Guideline for Commissioning of HVAC Systems." American Society of Heating, Refrigerating and Air Conditioning Engineers, Atlanta, GA.

Bourassa, N., M.A. Piette, and N. Motegi. 2004. "Evaluation of Persistence of Savings from SMUD Retrocommissioning Program." Lawrence Berkeley National Laboratory Report No 54984.

Brady, R. 1995. "Commissioning Services Can Reduce Professional Liability Losses." *Proceedings of the Third National Conference on Building Commissioning* (Portland, OR: Portland Energy Conservation, Inc.,).

Caner, P. 1996. "Commissioning the Physics/Astronomy Building Control System." Bonneville Power Administration, DOE/BP-06602-01.

Caner, P. 1997. "Commissioning Four New Science Laboratory Buildings on a University Campus." Bonneville Power Administration.

Chen, A. and E. L. Vine. 1998. "A Scoping Study on the Costs of Indoor Air Quality Illnesses: An Insurance Loss Reduction Perspective." Lawrence Berkeley National Laboratory Report No. 41919. A briefer version is published in *Environmental Science & Policy*, 2 (1999): 457-464.

Claridge, D.E., Haberl, J., Liu, M., Houcek, J., and Athar, A., 1994. "Can You Achieve 150% of Predicted Retrofit Savings: Is It Time for Recommissioning?" *Proceedings of the ACEEE 1994 Summer Study on Energy Efficiency In Buildings*, Vol. 5, American Council for an Energy Efficient Economy, Washington, D.C., pp. 73-87, 1994.

Claridge, D.E., Liu, M., Zhu, Y., Abbas, M., Athar, A., and Haberl, J. 1996. "Implementation of Continuous Commissioning in the Texas LoanSTAR Program: 'Can You Achieve 150% of Estimated Retrofit Savings' Revisited." *Proceedings of the ACEEE 1996 Summer Study on Energy Efficiency In Buildings*, American Council for an Energy Efficient Economy, Washington, D.C., pp. 4.59-4.67, 1996.

Claridge, D.E., W.D. Turner, M. Liu, S. Deng, G. Wei, C. Culp, H. Chen, and S. Cho. 2002. "Is Commissioning Once Enough?" *Proceedings of the 25th World Energy Engineering Congress*, October 9-11, Atlanta, Georgia.

Cohan, D. and P. Willems. 2001. "Construction Costs and Commissioning." *Proceedings of the* 9th National Conference on Building Commissioning." May 9-11.

Cowan, A. 2004. "Review of Recent commercial Roof Top unit Field Studies in the Pacific Northwest and California." New Buildings Institute.

Cox, R. and A. Williams. 2000. "Quantifying Costs and Benefits of Commissioning." *Proceedings of the 8th National Conference on Building Commissioning*. May 2-5.

Crabtree, P. N. Kyriakopedi, E. Mills, P. Haves, R.J. Otto, M.A. Piette, P Xu, R.C. Diamond, J. Deringer, and C. Frost. 2004. "Developing a Next-Generation Community College Curriculum for Energy-Efficient High-Performance Building Operations." Proceedings of the 2004 ACEEE Summer Study on Energy Efficiency in Buildings, Asilomar, CA August 22 - 27.

Dorgan, C., R. Cox, and C. Dorgan. 2002. "The Value of the Commissioning Process: Costs and Benefits." *The Austin Papers: Best of the 2002 International Green Building Conference*, Compiled by Environmental Building News, p. 25-30.

Friedman, H, T. Haasl, and K. Gillespie. 2004. "Creating California's Online Commissioning Case Study Database: Case Studies Go High Tech." *Proceedings of the 2004 ACEEE Summer Study on Energy Efficiency in Buildings*, American Council for an Energy-Efficient Economy, Washington, D.C.

Friedman, H. and M.A. Piette. 2001. "Comparative Guide to Emerging Diagnostic Tools for Large Commercial HVAC Systems." LBNL Report 48629, Lawrence Berkeley National Laboratory, Berkeley, CA. <u>http://buildings.lbl.gov/hpcbs/pubs/LBNL-48629.pdf</u>

Friedman, H., A. Potter, T. Haasl, and D. Claridge. 2002. "Persistence of Benefits from New Building Commissioning." Portland Energy Conservation, Inc. *Proceedings of the 2002 ACEEE Summer Study on Energy Efficiency in Buildings*. American Council for an Energy-Efficient Economy, Washington, D.C.

Friedman, H., A. Potter, T. Haasl, and D. Claridge. 2003. "Strategies for Improving Persistence of Commissioning Benefits." <u>http://www.cacx.org/library</u>

Friedman, H., A. Potter, T. Haasl, D. Claridge and S. Cho. 2003. "Persistence of Benefits from New Building Commissioning." Portland Energy Conservation, Inc. *Proceedings of the 2003 National Conference on Building Commissioning*. Palm Springs, CA, May 20-22.

Giebler, T., G. Wei, S. Deng, M. Liu, D.E. Claridge, and D. Turner. 2000. "Optimization Measures for Sporting and Special Event Facilities: Design and Operation." *Proceedings of the 12th Symposium on Improving Building Systems in Hot and Humid Climates*. San Antonio, Texas, May 15 – 17.

Gregerson, J. 1997. "Commissioning Existing Buildings." *Tech Update*, (March), TU-97-3. E Source, Boulder, CO.

Gunn, R, G. Cullen, and T. Pasqual. 2004. "The Energy Conservation Potential for Retro-Commissioning." *Proceedings of the 12th National Conference on Building Commissioning*, May 18-20.

Interlaboratory Working Group. 1997. "Scenarios of U.S. Carbon Reductions: Potential Impacts of Energy-Efficient and Low-Carbon Technologies by 2010 and Beyond." Oak Ridge, TN and Berkeley, CA: Oak Ridge National Laboratory and Lawrence Berkeley National Laboratory. ORNL-444 and LBNL-40533.

International Performance Measurement & Verification Protocol. 2001. DOE/GO-102001-1187. http://www.ipmvp.org

Kahn, A., A. Potter, and T. Haasl. 2002. "Retrocommissioning of Two Long-Term Care Facilities in California." *Proceedings of the ACEEE 2002 Summer Study on Energy Efficiency in Buildings*, American Council for an Energy-Efficient Economy, Washington DC.

Leyard, T., L. Barbagallo, and E. Lionberger. 1999. "Commercial and Industrial O&M Market Segment Baseline Study: Final Report." Prepared by RLW Analytics for the NE/NJ Utility Consortium.

Liu, M., A. Athar, D. Claridge, J.S. Haberl, and E. White. 1994. "Reducing Building Energy Costs Using Optimized Operation Strategies for Constant Volume Air Handling Systems." *Proceedings of the Ninth Symposium on Improving Building Systems in Hot and Humid Climates,* Arlington, Texas, May 19-20, pp. 192-204.

Liu, M., J.K. Houcek, D.E. Claridge, and J.S. Haberl. 1993a. "Potential Operation and Maintenance (O&M) Savings at the Dunbar Middle and Sims Elementary Schools." *Energy Systems Laboratory Technical Report*, ESL-TR-93/04-08, Department of Mechanical Engineering, Texas A&M University, 76 pp.

Liu, M., A. Athar, D.E. Claridge, T.A. Reddy, and J.S. Haberl. 1993b. "Summary of UTMB O&M Project: Energy Conservation Potential in Five Buildings." *Energy Systems Laboratory Technical Report*, ESL-TR-93/10-03, Department of Mechanical Engineering, Texas A&M University, 23 pp.

Liu, M., A. Athar, D.E. Claridge, T.A. Reddy, and J.S. Haberl. 1993c. Potential Operation and Maintenance (O&M) Savings in the John Sealy North Building at UTMB, *Energy Systems Laboratory Technical Report*, ESL-TR-93/10-07, Department of Mechanical Engineering, Texas A&M University, 36 pp.

Liu, M., A. Athar, D.E. Claridge, T.A. Reddy, and J.S. Haberl. 1993d. "Potential Operation and Maintenance (O&M) Savings in the Clinical Science Building at UTMB." *Energy Systems Laboratory Technical Report*, ESL-TR-93/10-05 Department of Mechanical Engineering, Texas A&M University, 32 pp.

Liu, M., A. Athar, D.E. Claridge, T.A. Reddy, and J.S. Haberl. 1993e. "Potential Operation and Maintenance (O&M) Savings in the Basic Science Building at UTMB." *Energy Systems*

Laboratory Technical Report, ESL-TR-93/10-04, Department of Mechanical Engineering, Texas A&M University, 33 pp.

Liu, M., A. Athar, D.E. Claridge, T.A. Reddy, and J.S. Haberl. 1993f. "Potential Energy Savings from Optimized Schedule and Economizer Cycles in the Moody Library at UTMB." *Energy Systems Laboratory Technical Report,* ESL-TR-93/10-08, Department of Mechanical Engineering, Texas A&M University, 39 pp.

Liu, M., Y. Zhu, B.Y. Park, D.E. Claridge, D.K. Feary, and J. Gain. 1999. "Airflow Reduction to Improve Building Comfort and Reduce Building Energy Consumption – A Case Study." *ASHRAE Transactions-Research*, Vol. 105, Part I, pp. 384 – 390.

Liu, M., Y. Zhu, M. Abbas, R. de La Cruz, J. Perez, and D.E. Claridge, D. Feary, and J. Gains. 1996. "An O&M Story of an Old Building." *Proceedings of the 4th National Commissioning Conference*, St. Pete Beach, FL, April 29 – May 1, pp. 14.3.1 – 14.3.13.

Piette, M.A. and B. Nordman. 1996. "Costs and Benefits of Utility Funded Commissioning of Energy-Efficiency Measures in 16 Buildings." *ASHRAE Transactions*, Atlanta, GA, Vol. 102, Pt 1. February, LBL Report No. LBNL-37832.

Martinez, M.S. 1999. "Energy Efficient Retrofit Commissioning – Tricks of the Trade to Avoid Claims and Unhappy Customers." *Proceedings of the* 7th *National Conference on Building Commissioning*.

Mills, E. 2003. "The Insurance and Risk Management Industries: New Players in the Delivery of Energy-Efficient Products and Services." *Energy Policy* 31:1257-1272. http://eetd.lbl.gov/emills/PUBS/Insurance_Case_Studies.html

Mills, E. 2004. "Amplifying Real Estate Value through Energy & Water Management: From ESCO to 'Energy Services Partner'." *Proceedings of the 2004 ACEEE Summer Study on Energy Efficiency in Buildings*, Asilomar, CA August 22-27. LBNL-52768. http://eetd.lbl.gov/emills/PUBS/EnergyServicesPartners.html

Mills, E. and A. Rosenfeld. 1996. "Consumer Non-Energy Benefits as a Motivation for Making Energy-Efficiency Improvements." *Energy—The International Journal*, 21 (7/8):707-720. (Earlier version in *Proceedings of the 1994 ACEEE Summer Study on Energy Efficiency in Buildings*, pp. 4.201-4.213.)

Mills, E., D. Abell, G. Bell, J. Faludi, S. Greenberg, R. Hitchcock, M.A. Piette, D. Sartor, and K. Stum. 2002. "Design Intent Tool: User Guide." LBNL/PUB-3167.

Mills, E., S. Kromer, G. Weiss, and P.A. Mathew. 2004. "From Volatility to Value: Analysing and Managing Financial and Performance Risk in Energy Savings Projects." *Energy Policy*. (in press)

MNCEE. 2001a. "Re-commissioning of a Large Acute-Care Hospital." Center for Energy and Environment, Minneapolis, MN.

MNCEE. 2001b. "Re-commissioning of an Extended-Care Mental Health Facility." Center for Energy and Environment, Minneapolis, MN.

MNCEE. 2001c. "Re-commissioning of a Large Middle School." Center for Energy and Environment, Minneapolis, MN.

MNCEE. 2001d. "Re-commissioning of an Elementary School." Center for Energy and Environment, Minneapolis, MN.

MNCEE. 2001e. "Re-commissioning of an Elementary School with Unit Ventilators." Center for Energy and Environment, Minneapolis, MN.

MNCEE. 2001f. "Re-commissioning of an Office Building." Center for Energy and Environment, Minneapolis, MN.

Motegi, N., M.A. Piette, S. Kinney, and K. Herter. 2003. "Web-based Energy Information Systems for Energy Management and Demand Response in Commercial Buildings National Laboratory," LBNL Report 52510. http://buildings.lbl.gov/hpcbs/pubs/E5P2T1b5_LBNL52510.pdf

NEEA. NDa. "Beaverton School Benefits from Commissioning Process." Northeast Energy Efficiency Alliance – Better Bricks.

NEEA. NDb. "Commissioning Helps Portland State University." Northeast Energy Efficiency Alliance – Better Bricks.

NEEA. NDc. "School Commissioning Project Gets High Grade." Northeast Energy Efficiency Alliance – Better Bricks.

NEEA. NDd. "The Verdict is in on Ada County Courthouse." Northeast Energy Efficiency Alliance – Better Bricks.

NEEA. NDe. "Pursuing LEED Certification Yields Unexpected Benefits." Northeast Energy Efficiency Alliance – Better Bricks.

Nelson, N.L. 1999, "Avoiding Litigation through Proper Commissioning: My Experience as an Expert Witness." *Proceedings of the 7th National Conference on Building Commissioning*.

PECI 2000. "Retrocommissioning Final Report," January 13. Portland Energy Conservation Inc, Portland OR.

PECI 2000. "Retrocommissioning Final Report: Melvin Mark Companies Crown Plaza Building." January 13. Portland Energy Conservation Inc, Portland OR.

PECI 2002. "Retrocommissioning Report. La Mesa, California." Prepared with funding from San Diego Gas and Electric by PECI in Partnership with Architectural Energy Corporation. Final Report, March. Portland Energy Conservation Inc, Portland OR.

PECI and Boston Edison Co. 1998. "Retrocommissioning Report." December 23. Portland Energy Conservation Inc, Portland OR.

PECI and Sawtooth Technical Services. 2003. "City Hall Retrocommissioning: Final Report," "Interim Report 1/2002," and "Final Overview of Project 3/2003."

PECI and The McCarty Company. 2002a. "Final Commissioning Report." SBC 400/001-01-98 by PECI and The McCarty Company. Portland Energy Conservation Inc, Portland OR.

PECI. 1996a. "Operation and Maintenance Tune-up Report for Citizen's Plaza." Prepared with funding from US EPA/US DOE Assistance Agreement CX822837-01-0. December. Portland Energy Conservation Inc, Portland OR.

PECI. 1996b. "Operation and Maintenance Tune-up Report." Prepared with funding from US EPA/US DOE Assistance Agreement CX822837-01-0. December. Portland Energy Conservation Inc, Portland OR.

PECI. 1996c. "Operation and Maintenance Tune-up Report." Prepared with funding from US EPA/US DOE Assistance Agreement CX822837-01-0. December. Portland Energy Conservation Inc, Portland OR.

PECI. 1996d. "Operation and Maintenance Tune-up Report." Prepared with funding from US EPA/US DOE Assistance Agreement CX822837-01-0. December. Portland Energy Conservation Inc, Portland OR.

PECI. 1996e. "Operation and Maintenance Tune-up Report for Parkway Fountains." Prepared with funding from US EPA/US DOE Assistance Agreement CX822837-01-0. December. Portland Energy Conservation Inc, Portland OR.

PECI. 1997a. "What Can Commissioning do for Your Building?" Portland Energy Conservation Inc, Portland OR.

PECI. 1997b. "Final Report for the Commissioning Project." Prepared with funding from the State of Tennessee, Department of General Services. June 1997. Portland Energy Conservation Inc, Portland OR.

PECI. 1998. "National Strategy for Building Commissioning." Portland Energy Conservation, Inc. See http://www.peci.org/library/PECI_NatlStratBldgCx_2004.pdf

PECI. 1999. "Interim Report: Report of Findings and Implementation Activities for 1999." December 22. Portland Energy Conservation Inc, Portland OR.

PECI. 1999. "Retrocommissioning Report: Report of Findings from the Initial Assessment." August 16, 1999. Portland Energy Conservation Inc, Portland OR.

PECI. 2001a. "Retrocommissioning Report Nursing Center." Prepared with Funding from PG&E in partnership with Institute for Market Transformation by PECI. March Assessment Report. Portland Energy Conservation Inc, Portland, OR.

PECI. 2001b. "Retrocommissioning Report Nursing and Rehab Center." Prepared with Funding from PG&E in partnership with Institute for Market Transformation by PECI. March Assessment Report. Portland Energy Conservation Inc, Portland OR.

PECI. 2002a. "Trend Analysis Report." February 12. Portland Energy Conservation Inc, Portland OR.

PECI. 2002b. PECI, November 2002 Final report, "Final ALERT Retrocommissioning Report." Portland Energy Conservation Inc, Portland OR.

PECI. 2003. "Assessment of Load and Energy Reduction Techniques (ALERT) Retrocommissioning Case Study of Two National Renewable Energy Laboratory (NREL) Sites." *Proceedings of the International Conference for Enhanced Building Operations*. Portland Energy Conservation Inc, Portland OR.

Piette, M.A., B. Nordman, and S. Greenberg. 1995. "Commissioning of Energy-Efficiency Measures: Costs and Benefits for 16 Buildings." LBNL-36448. Berkeley, California: Lawrence Berkeley National Laboratory.

Piette, M.A., R. Diamond, B. Nordman, de Buen O., J.P. Harris, K. Heinemeier, and K. Janda. 1994. "Final Report on the Energy Edge Impact Evaluation of 28 New, Low-Energy Commercial Buildings." Report to the Bonneville Power Administration, LBNL-33708.

Quantum Consulting. 2004. "Marriott International Inks Major Deal with Quantum Consulting." News Release, April 30.

Ryan, J.D. and A. Nicholls. 2004. "Commercial Building R&D Program Multi-Year Planning: Opportunities and Challenges." *Proceedings of the ACEEE Summer Study on Energy Efficiency in Buildings*, American Council for an Energy-Efficient Economy, Washington: DC, pp. 4-307-4-319.

Savage, J. (no date.) "Commissioning a Materials Research Laboratory." Sandia National Laboratories (Presentation).

SBW Consulting and Skumatz Economic Research Associates. 2003. "Cost-Benefit Analysis for the Commissioning in Public Buildings Project." Northwest Energy Efficiency Alliance.

Stum, K., T. Haasl, and D. Krebs. 1994. "Costs and Savings of ECM Commissioning and Inspection: Case Studies from One Utility." *Proceedings of the Second National Conference on Building Commissioning*, St. Petersburg, FL, May 9-11, 1994. Portland Energy Conservation, Inc, Portland, OR.

Torcellini, P.A., M. Deru, B. Griffith, N. Long, S. Pless, R. Judkoff, and D.B. Crawley. 2004 "Lessons Learned from Field Evaluation of Six High-Performance Buildings." *Proceedings of the 2004 ACEEE Summer Study on Energy Efficiency in Buildings*, American Council for an Energy-Efficient Economy, Washington: DC, pp. 3-325-3-337. Tso, B, M. Baker, and A. Pekalski. 2002. "The Costs and Benefits of Commissioning in Oregon Public Buildings." *Proceedings of the ACEEE 2002 Summer Study on Energy Efficiency in Buildings* (p. 3.373)

Tuffo, M., H.S. Shick, and J. Volkman. 2004. "Building Performance Services: Engaging the Market to Encourage Better Commercial Building Operating Performance." *Proceedings of the 2004 ACEEE Summer Study on Energy Efficiency in Buildings*, American Council for an Energy-Efficient Economy, Washington, D.C.

Turner, D., S. Deng, J. Hood, and M. Butler. 2003 "Continuous Commissioning of the Matheson Courthouse in Salt Lake City, Utah." *Proceedings of ICEBO*.

Turner, W.D., D.E. Claridge, S. Deng, S. Cho, M. Liu, T. Hagge, C. Darnell, Jr., and H. Bruner, Jr., 2001. "Persistence of Savings Obtained from Continuous Commissioning." *Proceedings of the 9th National Conference on Building Commissioning*, Cherry Hill, NJ, May 9-11, 2001, Session 20, Paper 1, 13 pp. California Energy Commission, Public Interest Energy Research Program, HPCBS #E5P2.2T5a2.

Tyler, R.J., 1995. "Commissioning: A Legal Perspective." *Proceedings of the Third National Conference on Building Commissioning* (Portland, OR: Portland Energy Conservation, Inc.)

USDOE. (no date). "High-Performance Commercial Buildings: A Technology Roadmap." United States Department of Energy.

USDOE/EIA. 2004. "1999 Commercial Buildings Energy Consumption and Expenditures Survey." http://www.eia.doe.gov/emeu/cbecs/cbecs2003/introduction.html

USDOE. 2002. 2004 Building Energy Databook, Table 4.1.3. U.S. Department of Energy, Building Technologies Program, Washington DC.

Veltri, A. 2002. "Development of an Integrated Commissioning Strategy Cost Model." Proceedings of the 10th National Conference on Building Commissioning, May 8-10.

Wei, G., D.E. Claridge, W.D. Turner, and M. Liu. 2000. "Continuous Commissioning Report for the Pennsylvania State University." *Energy Systems Laboratory Technical Report*, Energy Systems Laboratory, Texas A&M University, 62 pp.

Wei, G., J.C. Baltazar, Z. Yiwen, D. Turner, and D. Claridge. 2001. "Continuous CommissioningSM of Texas Tech University, Final Report." *Energy Systems Laboratory Technical Report*, ESL-TR-01/09-02, Energy Systems Laboratory, Texas A&M University, 73 pp.

Wilkinson, R. 2000. "Establishing Commissioning Fees." ASHRAE Journal, (February), p 41.

Willems, P. 1999. "Public Building Commissioning in the Pacific Northwest, No. 1: Special Report – Enhanced Baseline." Quantum Consulting, Inc. Report #E99-032.

Yoder, R. 1994. "What Does it Cost to Commission a Building: Data from Three Year's of Energy FinAnswer Projects." *Proceedings of the Second National Conference on Building Commissioning*, St. Petersburg, FL, May 9-11, 1994. Portland Energy Conservation, Inc, Portland, OR.

Zachwieja, T.A. and W. Williams. 1994. "The Cost and Savings Benefits of Commissioning." *Proceedings of the Second National Conference on Building Commissioning*, St. Petersburg, FL, May 9-11, 1994. Portland Energy Conservation, Inc, Portland, OR.

Zhu, Y., J.C. Baltazar, and D.E. Claridge. 2003, "Baseline Energy Usage Modeling and Continuous Commissioning Energy Savings for the Matheson Courthouse Building in Salt Lake City, Utah." *Energy Systems Laboratory Technical Report*, Department of Mechanical Engineering, Texas A&M University, March 15 pp.

Zhu, Y., M. Liu, D.E. Claridge, D. Feary, and T. Smith. 1997. "A Continuous Commissioning Case Study of a State-of-the-Art Building." *Proceedings of the 5th National Commissioning Conference*, Huntington Beach, CA, April, pp. 13.1 - 13.10.

APPENDICES

Appendix A. Data Instrument

	efits Analysis Units	Notes	EXAMPLE
Version: November 15, 2004 PROJECT DESCRIPTION		10103	EAGUIT EL
Name of person completing this entry	text		John Do
Case Identifier	PECI-#, TAMU-#,	For internal tracking	Project 1-R
	LBNL-#, etc.	T OF Internal tracking	
Commissioning provider			Commissioners In
Existing building (RCx); New construction (Cx)	Cx; RCx	new	<u>(Seattle, WA</u> RC
Was the building previously commissioned?	Y: N	existing	N
Commissioning project leader's level of experience	number of projects	Applies to project leader, not	
	previously	firm. Do not include general	· · ·
	completed (number	"energy efficiency	
	only; no text)	experience": R/Cx only	
Building name and street address (if PUBLIC INFORMATION)			Courthous
		Data will be included in final	
	text	report	
		report	
Building name and street address (if CONFIDENTIAL)			
, ,			
		Data will be kept	
	text	confidential, I.e. not included	
	lexi	in final report	
		in ina report	
Leasting Other			Dele
Location - City	text		Bois
	ICAL		
Location - State	Postal Abbreviation		I
Building Ownership	Public; Private		Publ
Level of (retro)commissioning		E.g. if only the energy-	(
	Comprehensive,	efficiency measures were	
	Specific Systems		
Number of buildings	Number	would be "SE"	
Number of buildings	Number	When unknown, enter "1"	407
Year construction completed Total building construction cost (if new building) [\$]	Year (NNNN) \$	Use four-digit format If not known, est \$200/sf	197
Year commissioning project completed	NNNN	Use four-digit format	200
Year that (retro)commissioning costs reported below were		If multi-year project, list mid-	200
incurred [NNNN]	NNNN	point	200
Floor Area:		L'	
Entire building	square feet		23,21
Floor area served by commissioned systems	square feet		23,21
		Include "(p)" in code if data	
		include parking/garage	
Net or Gross; Parking areas	N(p); G(p)		I
Net or Gross; Parking areas	N(p); G(p)	spaces. Preferably, exclude	1
	N(p); G(p)		
Is the facility part of a campus with central heating and/or	N(p); G(p) Y; N	spaces. Preferably, exclude	
Is the facility part of a campus with central heating and/or cooling?		spaces. Preferably, exclude	I
Is the facility part of a campus with central heating and/or cooling? Building type(s)		spaces. Preferably, exclude	I Public Assembl
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education		spaces. Preferably, exclude	
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12	Y; N	spaces. Preferably, exclude parking areas.	I
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education	Y; N	spaces. Preferably, exclude parking areas.	I
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12	Y; N	spaces. Preferably, exclude parking areas.	I
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales	Y; N	spaces. Preferably, exclude parking areas.	I
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales Food Service	Y; N	spaces. Preferably, exclude parking areas.	I
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales Food Service Health Care	Y; N " " " " " " " " " " " " " " " " " " "	spaces. Preferably, exclude parking areas.	I
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales Food Sales Food Service Health Care Inpatient Outpatient Laboratory	Y; N " " " " " " " " " " " " " " " " " " "	spaces. Preferably, exclude parking areas.	I
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales Food Service Health Care Inpatient Outpatient Laboratory Lodging	Y; N " " " " " " " " " " " " " " " " " " "	spaces. Preferably, exclude parking areas.	
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales Food Service Health Care Inpatient Outpatient Laboratory Lodging Mercantile	Y; N	spaces. Preferably, exclude parking areas.	I
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales Food Sales Food Service Health Care Inpatient Outpatient Laboratory Lodging Mercantile Retail	Y; N " " " " " " " " " " " " " " " " " " "	spaces. Preferably, exclude parking areas.	I
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales Food Sales Food Service Health Care Inpatient Outpatient Laboratory Lodging Mercantile Retail Service	Y; N " " " " " " " " " " " " " " " " " " "	spaces. Preferably, exclude parking areas.	I
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales Food Service Health Care Inpatient Outpatient Laboratory Lodging Mercantile Retail Service Office	Y; N " " " " " " " " " " " " " " " " " " "	spaces. Preferably, exclude parking areas.	Public Assemb
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales Food Service Health Care Inpatient Outpatient Laboratory Lodging Mercantile Retail Service Office Public Assembly	Y; N " " " " " " " " " " " " " " " " " " "	spaces. Preferably, exclude parking areas.	Public Assemb
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales Food Sales Food Service Health Care Inpatient Outpatient Laboratory Lodging Mercantile Retail Service Office Public Assembly Public Order and Safety	Y; N " " " " " " " " " " " " " " " " " " "	spaces. Preferably, exclude parking areas.	Public Assembl
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales Food Sales Food Service Health Care Inpatient Outpatient Laboratory Lodging Mercantile Retail Service Office Public Assembly Public Order and Safety Religious Worship	Y; N " " " " " " " " " " " " " " " " " " "	spaces. Preferably, exclude parking areas.	Public Assembl
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales Food Sales Food Service Health Care Inpatient Outpatient Laboratory Lodging Mercantile Retail Service Office Public Assembly Public Order and Safety Religious Worship Service	Y; N " " " " " " " " " " " " " " " " " " "	spaces. Preferably, exclude parking areas.	
Is the facility part of a campus with central heating and/or cooling? Building type(s) Education K-12 Higher education Food Sales Food Sales Food Service Health Care Inpatient Outpatient Laboratory Lodging Mercantile Retail Service Office Public Assembly Public Order and Safety Religious Worship	Y; N " " " " " " " " " " " " " " " " " " "	spaces. Preferably, exclude parking areas.	Public Assembl

REASONS FOR (RETRO)COMMISSIONING	Place an "x" by the appropriate answer(s)	Put an "x" in this row if ANY value is checked in the column	х
Ensure system performance (energy and non-energy-related systems)	"		
Obtain energy savings	"		х
Ensure or improve thermal comfort	"		x
Extended equipment life			х
Train and increase awareness of building operators	"		
Smoother process and turnover (new construction)	"		
Increase occupant productivity	"		
Ensure adequate indoor air quality	"		>
Comply with LEED or other sustainability rating system	"		
Reduce liability	"		
Qualify for rebate, financing, or other services	"		
Research/demonstration/pilot	"		>
Participation in utility program	"		
Other	free text	Add brief description	
DEFICIENCIES & STRATEGIES	"Count" should agree with that in the "Measures" worksheet for the	"Measures" worksheet first. Definitions available on	
"Measures Tab" completed?	items that apply.	"Measures" Tab.	Y
Number of Problems Identified, by Component:			
HVAC (combined heating and cooling)	"	"	4
Cooling plant	"	"	4
Heating plant	"	"	
Air handling & distribution	"	"	2
Terminal units	"	"	
Lighting	"		2
Envelope	"		2 3 2 2 2 0
Plug loads	"		0
Facility-wide (e.g. EMCS or utility related)			2
Unknown			2
Other	"		0
Number of Measures Recommended To Resolve Problems:		Includes accepted as well as rejected measures.	
DESIGN, INSTALLATION, RETROFIT, REPLACEMENT		Tejecteu measures.	
Design change	"	"	C
Installation modifications	"		0
Retrofit/equipment replacement	"		
Other	"		2
OPERATIONS & CONTROL			0
	"		
Implement advanced reset	"		C
Start/Stop (environmentally determined) Scheduling (occupancy determined)	"		
	"		
Modify setpoint	"		0
Equipment staging	"		1
Modify sequence of operations	"		
Loop tuning			0
Behavior modification/manual changes to operations	"		2
Other			C
MAINTENANCE	"		
Calibration			0
Mechanical fix		"	3
Heat transfer maintenance		"	1
Filtration maintenance			0
Other			C
UNKNOWN Diagnostics and Automation Techniques	Text	List tools/methods used, e.g. WBD, ACRX, PacRat, Enforma	
Verification of Measure Installation	Yes-all; Yes-some; No; Unknown	Subsequent cost and savings data entered should exclude that for recommended measures known to have been rejected.	Yes-al

(RETRO)COMMISSIONING COST DATA		Give costs in year of original	
		data; do not correct for inflation	
Total commissioning cost [nominal \$]	\$ (in currency of	innation	45,351
	year reported above	Should include study costs.	
	as year	Should not include TAB.	
	commissioning was		
Of which, Cx Agent Fee [\$]	completed)		27,500
What % of total is represented by non-energy-related measures			10%
(e.g. security system cx), if cost and/or savings data are included	%		
below?			
Cost Paid By:)
Building owner	% (enter as decimal	Enter "0" if not applicable	50%
Utility (e.g. as rebate)	value) % (enter as decimal		100%
	value)	Enter "0" if not applicable	1007
Other (e.g. research grant)	% (enter as decimal	Enter "0" if not applicable	
	value)		
Cost Breakdown, by Phase:			
New Construction (Cx)	9/ of total cost		
Design Review Construction Observation	% of total cost % of total cost		
Acceptance Testing	% of total cost		
Warranty	% of total cost		
Existing Buildings (RCx)			100%
Investigation and Planning	% of total cost		15%
Implementation	% of total cost		63%
Verification & Persistance Tracking	% of total cost		12%
Reporting	% of total cost		10%
Labor	\$		19,126
Unpaid/unbilled labor	hours		
Supplies and equipment costs Utility rebate	\$ nominal\$		40
Travel	s s		20,070
Scope of (Retro)commissioning: Items Included in Reported	Ψ		510
Costs			
Commissioning (new buildings)			
Stage Commissioning Begun (new construction only)	Design,		
	Construction,	Enter: "D", "C", "A", or "S"	
	Acceptance, Startup	, _,,	
Cx Provider development of design intent documents	Y; N (do not leave		
ox r tovider development of design intent documents	blank unless	Complete only if new	
	unknown)	building	
Write Cx Specifications	"	Complete only if new	
		building	
Develop Cx Plan		Complete only if new	
Design Review (indicate # of review cycles)		building Complete only if new	
	"	building	
Develop Sequences of operation (if not well-developed by	"	Complete only if new	
mech or controls contractor)		building	
Review submittals		Complete only if new	
Construction observation		building Complete only if new	
Construction observation	"	building	
Verification checks/prefunctional testing	"	Complete only if new	
· •		building	
Functional testing	"	Complete only if new	
		building	
Cx Provider significantly involved in issue resolution		Complete only if new	
Oversee training		building Complete only if new	
	"	building	
Review O&M Manuals	"	Complete only if new	
		building	
Develop systems manual/recommissioning manual	"	Complete only if new	
Deferm trend englycia		building	
Perform trend analysis	"	Complete only if new building	
Evaluate energy cost savings	"	Complete only if new	
<i></i>		buildina	
Final Cx Report	"	Complete only if new	
		building	

Retro-commissioning (existing buildings)		Entor "v" if yoo	••
Document design intent or update current documentation	Y; N (do not leave blank unless	Enter "x" if yes Complete only if existing building	× Y
Develop RCx Plan	unknown) "	Complete only if existing	Y
Perform utility bill analysis, benchmarking		building Complete only if existing	
Perform trend analysis		building Complete only if existing	N
Building modeling		building Complete only if existing	
Document master list of findings		building Complete only if existing	,
Estimate energy cost savings for findings		building Complete only if existing	
	"	building	
Present a findings and recommendations report		Complete only if existing building	٢
Update system documentation (control sequences)	"	Complete only if existing building	1
Implement O&M improvements		Complete only if existing building	,
Implement capital improvements	"	Complete only if existing building	Ņ
Monitor fixes		Complete only if existing building	Y
Measure energy savings	"	Complete only if existing	١
Develop systems manual/recommissioning manual	"	building Complete only if existing	Ν
Final RCx Report		building Complete only if existing	Y
BASELINE ENERGY USE AND SAVINGS		building	
End uses included in following data [Whole Building, or finite set of end uses based on "Components" defined above]	WB or C	Do not include savings estimates for measures known not to have been implemented	WE
Are data weather-normalized? If yes, using what method?	Y;N		Dogroo day
	name method		Degree-day normalization
Year of Energy Cost Data	Year (NNNN)	If possible, do not use first post-commissioning year's data (savings often manifest slowly). Use year-2 or -3.	2001
Total Electricity usage:			400.000
Total Electricity usage: Before commissioning After commissioning (or as-commissioned, if new	kWh/year		
Before commissioning After commissioning (or as-commissioned, if new building)	kWh/year		327,80
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand	kWh/year kWh/year		327,80
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning	kWh/year kWh/year peak kW		327,80
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building)	kWh/year kWh/year peak kW peak kW		327,80
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings	kWh/year kWh/year peak kW	н	327,80
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning	kWh/year kWh/year peak kW peak kW	н 	327,80 154,19 1,20
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning	kWh/year kWh/year peak kW peak kW peak kW	ности на	327,80; 154,19; 1,20,
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning After commissioning After commissioning After commissioning After commissioning (or as-commissioned, if new building) Savings	kWh/year kWh/year peak kW peak kW peak kW Millon BTU/year		327,808 154,192 1,204 890
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning After commissioning After commissioning After commissioning After commissioning (or as-commissioned, if new building)	kWh/year kWh/year peak kW peak kW peak kW Millon BTU/year Million BTU/year	" Enter information here ONLY if it is not available separately for HW, CW, and Steam (in which case, add separately in the following three sub-sections)	482,000 327,808 154,192 1,204 890 314
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning After commissioning After commissioning After commissioning Total Fuel usage: Before commissioning After commissioning Thermal (Total chilled water, hot water, and steam) Before commissioning	kWh/year kWh/year peak kW peak kW peak kW Millon BTU/year Million BTU/year	Enter information here ONLY if it is not available separately for HW, CW, and Steam (in which case, add separately in the following	327,806 154,192 1,204 890
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning (or as-commissioned, if new building) Savings Thermal (Total chilled water, hot water, and steam) Before commissioning After commissioning After commissioning	kWh/year kWh/year peak kW peak kW Millon BTU/year Million BTU/year Million BTU/year Million BTU/year	Enter information here ONLY if it is not available separately for HW, CW, and Steam (in which case, add separately in the following	327,808 154,192 1,204 890
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning After commissioning After commissioning After commissioning After commissioning (or as-commissioned, if new building) Savings Thermal (Total chilled water, hot water, and steam) Before commissioning After commissioning (or as-commissioned, if new building) Savings	kWh/year kWh/year peak kW peak kW Millon BTU/year Million BTU/year Million BTU/year	Enter information here ONLY if it is not available separately for HW, CW, and Steam (in which case, add separately in the following	327,808 154,192 1,204 890
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Thermal (Total chilled water, hot water, and steam) Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Hot water	kWh/year kWh/year peak kW peak kW Millon BTU/year Million BTU/year Million BTU/year Million BTU/year	Enter information here ONLY if it is not available separately for HW, CW, and Steam (in which case, add separately in the following	327,800 154,193 154,200 1,200 890
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Thermal (Total chilled water, hot water, and steam) Before commissioning After commissioning (or as-commissioned, if new building) Savings Thermal (Total chilled water, hot water, and steam) Before commissioning (or as-commissioned, if new building) Savings Total Hot water Before commissioning After commissioning	kWh/year kWh/year peak kW peak kW Millon BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year MMBTU/year	Enter information here ONLY if it is not available separately for HW, CW, and Steam (in which case, add separately in the following	327,800 154,193 154,200 1,200 890
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Thermal (Total chilled water, hot water, and steam) Before commissioning (or as-commissioned, if new building) Savings Total Hot water Before commissioning	kWh/year kWh/year peak kW peak kW Millon BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year	Enter information here ONLY if it is not available separately for HW, CW, and Steam (in which case, add separately in the following	327,80 154,19 1,20 89
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Thermal (Total chilled water, hot water, and steam) Before commissioning (or as-commissioned, if new building) Savings Total Hot water Before commissioning (or as-commissioned, if new building) Savings Total Hot water Before commissioning (or as-commissioned, if new building) Savings Total Hot water Before commissioning (or as-commissioned, if new building) Savings Total Hot water	kWh/year kWh/year peak kW peak kW Millon BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year MIBTU/year MILIon BTU/year	Enter information here ONLY if it is not available separately for HW, CW, and Steam (in which case, add separately in the following	327,80 154,19 1,20 89
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Thermal (Total chilled water, hot water, and steam) Before commissioning (or as-commissioned, if new building) Savings Total Hot water Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Steam Before commissioning After commissioning After commissioning After commissioning	kWh/year kWh/year peak kW peak kW Millon BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year	Enter information here ONLY if it is not available separately for HW, CW, and Steam (in which case, add separately in the following	327,800 154,193 154,200 1,200 890
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Thermal (Total chilled water, hot water, and steam) Before commissioning (or as-commissioned, if new building) Savings Total Hot water Before commissioning (or as-commissioned, if new building) Savings Total Hot water Before commissioning (or as-commissioned, if new building) Savings Total Steam Before commissioning (or as-commissioned, if new building) Savings	kWh/year kWh/year peak kW peak kW Millon BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year MIBTU/year MIBTU/year	Enter information here ONLY if it is not available separately for HW, CW, and Steam (in which case, add separately in the following	327,800 154,193 154,200 1,200 890
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Thermal (Total chilled water, hot water, and steam) Before commissioning After commissioning (or as-commissioned, if new building) Savings Thermal (Total chilled water, hot water, and steam) Before commissioning (or as-commissioned, if new building) Savings Total Hot water Before commissioning (or as-commissioned, if new building) Savings Total Steam Before commissioning (or as-commissioned, if new building) Savings Total Steam Before commissioning (or as-commissioned, if new building) Savings Total Steam	kWh/year kWh/year peak kW peak kW Millon BTU/year Million BTU/year	Enter information here ONLY if it is not available separately for HW, CW, and Steam (in which case, add separately in the following	327,808 154,192 1,204 890
Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Electric Peak Demand Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Total Fuel usage: Before commissioning After commissioning (or as-commissioned, if new building) Savings Thermal (Total chilled water, hot water, and steam) Before commissioning (or as-commissioned, if new building) Savings Total Hot water Before commissioning (or as-commissioned, if new building) Savings Total Steam Before commissioning (or as-commissioned, if new building) Savings	kWh/year kWh/year peak kW peak kW Millon BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year Million BTU/year MILION BTU/year	Enter information here ONLY if it is not available separately for HW, CW, and Steam (in which case, add separately in the following	327,806 154,192 1,204 890

Total energy cost (electric, peak, fuel):	\$/year	No inflation competion	20 EC
Before commissioning	\$/year	No inflation correction	32,52
After commissioning (or as-commissioned, if new building)	\$/year	No inflation correction	22,67
Nominal Savings (current year prices, no inflation- correction)	\$/year-project	No inflation correction	9,85
Energy prices associated with cost estimates		Use values corresponding to cost data provided above	
electricity	\$/kWh		0.04
peak electricity demand	\$/kW-Month		
fuel	\$/million BTU		7.
purchased thermal energy (hot/cold water and/or steam) Hot water	\$/million BTU		
chilled water			
steam			
Energy Savings Determination [select answers that correspond to the energy data given in prior rows]	A; B; C; D; or E	If multiple methods are used, choose <u>ONE</u> of the following to reflect the most prevalent form of determination.	
Engineering Estimates/Simulations (no measurements) = "E"	Y;N		
Measured Savings - IPMVP Option A. Partially measured retrofit isolation	Y;N	IPMVP Category: See "M&V Options Tab for definitions"	
Measured Savings - IPMVP Option B. Retrofit isolation	Y;N	IPMVP Category: See "M&V Options Tab for definitions"	
Measured Savings - IPMVP Option C. Whole facility	Y;N	IPMVP Category: See "M&V Options Tab for definitions"	
Measured Savings - IPMVP Option D. Calibrated simulation	Y;N	IPMVP Category: See "M&V Options Tab for definitions"	
Do the preceeding savings data reflect all commissioning activities described and costed above?	Y;N		
If "no", list % increase in reported savings anticipated (for	0/	will be used to modify raw	
measures known to be slated for implementation)	%	savings data (if applicable)	
Persistence of Energy Savings (existing buildings) or Performance (new construction)	Persistence of Energy Savings or Performance (fraction of energy consumed relative to base year; normalized to floor area,) [electric; fuel]	If available, also provide notation on the persistence of individual measures, via the column provided in the "Measures" tab.	
Year 0 (pre-commissioning)	ratio (Electricity; Fuel; CHW; HW; Steam)	1.00; 1.00; 1.00; 1.00; 1.00	1.00; 1.
Year 1	ratio (Electricity; Fuel)	ratios	0.68; 0.
Year 2	ratio (Electricity; Fuel)	ratios	0.72; 0.
Year 3	ratio (Electricity; Fuel)	ratios	0.65; 0.
Year 4	ratio (Electricity; Fuel)	ratios	0.60; 0.
Year 5	ratio (Electricity; Fuel)	ratios	
Year 6	ratio (Electricity; Fuel)	ratios	
If one or more periods include changes in occupancy, schedules, equipment, energy prices, or occupied floor area, are these adjusted for in the preceding estimates?	Y/N		

NON-ENERGY IMPACTS			
First-Cost Savings			
Change orders and warranty claims	\$	Show reductions as a negative value; increases as a positive value	
Other first-cost	\$	"	
Ongoing (recurring) Cost Savings			
Ongoing Labor cost	O&M C, P, D, CO; IR, O	Reduction/increase (O&M, Complaints, Productivity, Downtime, Information Requests, Other):	
Labor	person-hours/year	Show reductions as a negative value; increases as a positive value	
Cost	\$/year	"	1,200
Other			
Thermal Comfort	Y;N	"	Y
	\$/year	"	
Indoor Air Quality	Y;N	"	<u> </u>
	\$/year	"	,
Productivity/Safety	Y;N		Ň
Tanant retartion, turnayor	\$/year		N
Tenant retention; turnover	Y;N		۲ ۲
Liability	\$/year Y;N		Ν
Liability	\$/year		I
Equipment life	Y;N	"	Ň
	\$/year	"	200
Other (or combination of above)	Y;N	"	
	\$/year		
OTHER			
Data Source(s)	text	Use, abbreviated citation here (e.g. "Claridge et al. 1999") and report full bibliographic info on the "Data Sources" Tab next to the row representing this project.	Smith, J. 2002 "Commissioning o the City Hall" Technical repor 12345
Comments (summarize concisely here; attach Tabs if desired)	text		

Firigg99.KK....: ExistinEgxEstinIdgings Enneggy00ast

Appendix B. Analytic Assumptions

1. New Building Construction	Cost	150 \$	2003/ft2 l	Jsed to estimate construction cost where only floor area is a	valiabit
2. Standardized energy price a Electricity	assumpt	0.0786 \$	/kWh	ers, \$2003)	
Gas		8.04 \$	/million BTU		
Hot/Chilled water; Steam			/million BTU		
Peak electrical demand			/kW-month		
Source for gas and electric: DOI	E/EIA htt	tp://www.eia.do	be.gov/emeu/s	tates/_states.html; and Monthly Energy Review	
Estimating range of prices for de	elivered I	hot water, chill	ed water, or st	eam: Examples using preceding energy feedstock prices	
Hot Water (gas fuel)	85% ao	eneration efficie			
	95% dis	stribution efficie			
Chilled Water (gas-absorptic	on cycle	e - electricity)			
		oduction efficie			
				ngle effect; 1.1 for double effect (most common)	
	95% als 10.57 \$/I	stribution efficie	ысу		
Steam: (steam boiler - natur					
-		enerator efficier			
		stribution efficie	ency		
	.16% \$/				
Cogeneration as source (natura		eistock) out to electricit	,		
				fuel price allocated to heat production, balance to power)	
		at recovered		·····, -··············	
		Author At a			
		stribution efficie	ency		
Lacking other data, building a	7.48 \$/I or cominge set to	MBTU missioning pr o 1 year prior to	oject ventage	cation of new-construction commissioning source documents	;
Lacking other data, building a Lacking year of energy data, v	7.48 \$/I or cominge set to	MBTU missioning pr o 1 year prior to to the date of o	oject ventage date of public completion of o	ation of new-construction commissioning source documents commissioning project	i
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$/I or cominge set to	MBTU missioning pr o 1 year prior to	oject ventage	cation of new-construction commissioning source documents	i
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$/f or cominge set to we set it	MBTU missioning pr o 1 year prior to to the date of o Energy	oject ventage date of public completion of o Cx Labor	cation of new-construction commissioning source documents commissioning project Construction	5
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$/I or cominge set to we set it Year 1970 1971	MBTU missioning pr o 1 year prior to to the date of o Energy	oject ventage date of public completion of o Cx Labor	cation of new-construction commissioning source documents commissioning project Construction costs [c] 0.21 0.24	5
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$/f or cominge set to we set it Year 1970 1971 1972	MBTU missioning pr o 1 year prior to to the date of o Energy	oject ventage date of public completion of o Cx Labor	cation of new-construction commissioning source documents commissioning project Construction 0.21 0.24 0.26	3
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or cominge set to we set it Year 1970 1971 1972 1973	MBTU missioning pr o 1 year prior to to the date of o Energy	oject ventage date of public completion of o Cx Labor	cation of new-construction commissioning source documents commissioning project Construction costs [c] 0.21 0.24 0.26 0.28	
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or comi ge set to we set it Year 1970 1971 1972 1973 1974	MBTU missioning pr o 1 year prior to to the date of o Energy	oject ventage date of public completion of o Cx Labor	cation of new-construction commissioning source documents commissioning project Construction 0.21 0.24 0.26 0.28 0.30	:
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or comminge set to we set it Year 1970 1971 1972 1973 1974 1975	MBTU missioning pr o 1 year prior to to the date of o Energy	oject ventage date of public completion of o Cx Labor	cation of new-construction commissioning source documents commissioning project Construction costs [c] 0.21 0.24 0.26 0.28 0.30 0.33	5
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or cominge set to we set it Year 1970 1971 1972 1973 1974 1975 1976	MBTU missioning pr o 1 year prior to to the date of o Energy	oject ventage date of public completion of o Cx Labor	cation of new-construction commissioning source documents commissioning project Construction 0.21 0.24 0.26 0.28 0.30 0.33 0.36	5
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or comminge set to we set it Year 1970 1971 1972 1973 1974 1975	MBTU missioning pr o 1 year prior to to the date of o Energy	oject ventage date of public completion of o Cx Labor	cation of new-construction commissioning source documents commissioning project Construction costs [c] 0.21 0.24 0.26 0.28 0.30 0.33	:
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or comi ge set to we set it 1970 1971 1972 1973 1974 1975 1976 1977	MBTU missioning pr o 1 year prior to to the date of o Energy	oject ventage date of public completion of o Cx Labor	cation of new-construction commissioning source documents commissioning project Construction 0.21 0.24 0.26 0.28 0.30 0.33 0.33 0.36 0.38	;
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or comi ge set to we set it Year 1970 1971 1972 1973 1974 1975 1977 1977	MBTU missioning pr o 1 year prior to to the date of o Energy	oject ventage date of public completion of o Cx Labor	cation of new-construction commissioning source documents commissioning project Construction 0.21 0.24 0.26 0.28 0.30 0.33 0.36 0.38 0.41	
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or comi ge set to we set it 1970 1971 1972 1973 1974 1975 1976 1977 1978 1977 1978 1979 1980	MBTU missioning pri 1 year prior to to the date of (Energy prices [a] 0.50 0.55	oject ventage date of public completion of o Cx Labor	cation of new-construction commissioning source documents commissioning project Construction costs [c] 0.21 0.24 0.26 0.28 0.30 0.33 0.36 0.38 0.41 0.45	3
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or comi ge set to we set it Year 1970 1971 1972 1973 1974 1975 1976 1977 1978 1977 1978 1979 1981 1981	MBTU missioning pr o 1 year prior to to the date of o Energy prices [a] 0.50 0.55 0.59	oject ventage date of public completion of o Cx Labor	cation of new-construction commissioning source documents commissioning project Construction 0.21 0.24 0.26 0.28 0.30 0.33 0.36 0.38 0.41 0.45 0.48 0.53 0.57	
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or comi ge set to we set it Year 1970 1971 1972 1973 1974 1975 1977 1977 1977 1978 1977 1978 1979 1980 1981 1982 1983	MBTU missioning pr o 1 year prior to to the date of o Energy prices [a] 0.50 0.55 0.59 0.61	oject ventage o date of public completion of o Cx Labor prices [b]	cation of new-construction commissioning source documents commissioning project Construction costs [c] 0.21 0.24 0.26 0.28 0.30 0.33 0.36 0.33 0.36 0.38 0.41 0.45 0.41 0.45 0.48 0.53 0.57 0.61	
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or coming ge set to we set it 1970 1971 1972 1973 1974 1975 1976 1977 1978 1977 1978 1979 1980 1981 1983 1984	MBTU missioning pro- o 1 year prior to to the date of o Energy prices [a] 0.50 0.55 0.59 0.61 0.63	oject ventage date of public completion of o Cx Labor prices [b]	cation of new-construction commissioning source documents commissioning project Construction costs [c] 0.21 0.24 0.26 0.28 0.30 0.33 0.36 0.33 0.36 0.38 0.41 0.45 0.48 0.53 0.57 0.61 0.62	;
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or comi ge set to we set it 1970 1971 1972 1973 1974 1975 1975 1976 1977 1978 1977 1978 1977 1978 1980 1981 1982 1983 1984 1985	MBTU missioning provided to the date of of Energy prices [a] 0.50 0.55 0.59 0.61 0.63 0.65	oject ventage date of public completion of o Cx Labor prices [b]	cation of new-construction commissioning source documents commissioning project Construction costs [c] 0.21 0.24 0.26 0.28 0.30 0.33 0.36 0.33 0.36 0.38 0.41 0.45 0.45 0.48 0.53 0.57 0.61 0.62 0.63	3
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or comi ge set to we set it Year 1970 1971 1972 1973 1974 1975 1976 1977 1978 1977 1978 1979 1980 1981 1981 1981 1983 1984	MBTU missioning pro- o 1 year prior to to the date of o Energy prices [a] 0.50 0.55 0.59 0.61 0.63 0.65 0.67	oject ventage date of public completion of o Cx Labor prices [b] 2.07 2.01 1.94	cation of new-construction commissioning source documents commissioning project Construction 0.21 0.24 0.26 0.28 0.30 0.33 0.36 0.38 0.41 0.45 0.48 0.53 0.57 0.61 0.62 0.63 0.64	3
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or comi ge set to we set it 1970 1971 1972 1973 1974 1975 1975 1976 1977 1978 1977 1978 1977 1978 1980 1981 1982 1983 1984 1985	MBTU missioning provided to the date of of Energy prices [a] 0.50 0.55 0.59 0.61 0.63 0.65	oject ventage date of public completion of o Cx Labor prices [b]	cation of new-construction commissioning source documents commissioning project Construction costs [c] 0.21 0.24 0.26 0.28 0.30 0.33 0.36 0.33 0.36 0.38 0.41 0.45 0.45 0.48 0.53 0.57 0.61 0.62 0.63	3
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or comi ge set to we set it Year 1970 1971 1972 1973 1974 1975 1976 1977 1977 1978 1977 1981 1982 1983 1984 1985 1986 1987	MBTU missioning pro- o 1 year prior to to the date of o Energy prices [a] 0.50 0.55 0.59 0.61 0.63 0.65 0.67 0.69	oject ventage o date of public completion of o Cx Labor prices [b] 2.07 2.01 1.94 1.88	cation of new-construction commissioning source documents commissioning project Construction costs [c] 0.21 0.24 0.26 0.28 0.30 0.33 0.36 0.33 0.36 0.38 0.41 0.45 0.41 0.45 0.41 0.45 0.48 0.53 0.57 0.61 0.62 0.63 0.64 0.66	
Lacking other data, building a Lacking year of energy data, v 4. Deflators	7.48 \$// or comi ge set to we set it Year 1970 1971 1972 1973 1974 1975 1977 1978 1977 1978 1977 1980 1981 1980 1981 1982 1983 1984 1985 1986 1987 1988 1989	MBTU missioning pro- 1 year prior to to the date of of Energy prices [a] 0.50 0.55 0.59 0.61 0.63 0.65 0.67 0.69 0.71 0.74 0.74 0.74	oject ventage date of public completion of o Cx Labor prices [b] 2.07 2.01 1.94 1.88 1.82 1.74	cation of new-construction commissioning source documents commissioning project Construction costs [c] 0.21 0.24 0.26 0.28 0.30 0.33 0.36 0.38 0.41 0.45 0.45 0.45 0.48 0.53 0.57 0.61 0.62 0.63 0.64 0.66 0.68 0.69 0.71	
Lacking year of energy data, v	7.48 \$// or comi ge set to we set it 1970 1971 1972 1973 1974 1975 1976 1977 1978 1976 1977 1978 1979 1980 1981 1982 1983 1984 1985 1986 1988 1988	MBTU missioning provide 1 year prior to to the date of of Energy prices [a] 0.50 0.55 0.59 0.61 0.63 0.65 0.67 0.69 0.71 0.74	oject ventage date of public completion of of Cx Labor prices [b] 2.07 2.01 1.94 1.88 1.82 1.74	cation of new-construction commissioning source documents commissioning project Construction costs [c] 0.21 0.24 0.26 0.28 0.30 0.33 0.36 0.33 0.41 0.45 0.48 0.53 0.57 0.61 0.62 0.63 0.64 0.68 0.69	

2000 2001 2002 0.98 0.98 1.04 2002 0.50 1.04 0.98 2003 1.00 1.00 1.00 [a] EIA, Annual Energy Review 2002, Oct. 2003, Appendix D, p. 353. (from BTS Core data book) [b] Construction Labor: http://www.bea.doc.gov/bea/dn1.htm [c] McGraw Hill - Engineering News Record, Construction Cost Index

0.83

0.85

0.87

0.88

0.90

0.91

0.93

0.95

0.97

1.52

1.47

1.40

1.36

1.30

1.24

1.19

1.13

1.07

0.78

0.81

0.82

0.84

0.87

0.88

0.91

0.93

0.95

http://enr.construction.com/features/conEco/costIndexes/constIndexHist.asp

1993

1994

1995

1996

1997

1998

1999

Appendix C. Measure Definitions

Design, Installation, Retrofit, Replacement	
Design, Installation, Retrofit, Replacement Design problems found and corrected during design review of a new building (Cx), a design problem physically corrected or circumvented (during Cx or RCx). [Problems with the design of control sequences are accounted for under "Control".]	<u>Code</u> D1
Installation modifications To address improper installation of equipment, sensors, distribution systems, etc.	D2
Retrofit/equipment replacement RCx strategies to improve the performance of a system, as distinct from a change in design [treated above].	D3
Other Other design, installation, retrofit, or replacement measures.	D4
Operations & Control	
Implement advanced reset Recommended modifications to reset schedules of HVAC processes. E.g., Supply Air Temperature reset based on Outside Air Temperature.	OC1
Start/Stop (environmentally determined) Recommendations that affect environmentally determined equipment control settings (e.g., chiller or boiler lockouts that based on out side air dry bulb temperature or seasonally determined equipment operation).	0C2
Scheduling (occupancy determined) Recommendations affecting the control of equipment availability as a function of building occupancy (e.g. lighting sweeps; temperature setbacks; morning warm-up).	OC3
Modify setpoint Recommendations that modify the setpoint of a control loop. E.g., Supply air temperature setpoint, thermostat setpoint, or static pressure setpoint.	OC4
Equipment staging	OC5
Recommendations that affect control settings for the availability or staging of duplicate equipment, e.g., Chiller staging and loading sequence or lead-and-lag pumping sequences.	
Modify sequence of operations Recommendations that propose changes significant enough to be considered a major modification to the building's existing sequence of operations.	OC6
Loop tuning Modify control loop parameters to improve control (reduce cycling, hunting, oscillations).	OC7
Behavior modification/manual changes to operations Recommendations that seek to modify the behavior of the building staff or occupants or instruct building staff or occupants on the proper use of equipment (e.g. turning off lights upon leaving a room, correctly manipulating the system in response to complaint calls).	OC8
Other Other operations & control measures.	OC9
Maintenance	
Calibration Recommendations that address calibration problems with equipment or systems.	M1
Mechanical fix Replacing belts, broken linkages, motor maintenance, etc.	M2
Heat transfer maintenance Coil cleaning, cooling tower water treatment, correcting refrigerant charge	M3
Filtration maintenance Changing filters, modifying filter racks, changing filter type, etc.	M4
Other Other maintenance measures.	M5

Appendix D. Performance Measurement & Verification Definitions

(Source: IPMVP 2001)

Table 1: Overview of M&V Options

M&V Option	How Savings Are Calculated	Typical Applications
A. Partially Measured Retrofit Isolation Savings are determined by partial field measurement of the energy use of the system(s) to which an ECM was applied, separate from the energy use of the rest of the facility. Measurements may be either short-term or continuous.	Engineering calculations using short term or continuous post-retrofit measurements and stipulations.	Lighting retrofit where power draw is measured periodically. Operating hours of the lights are assumed to be one half hour per day longer than store open hours.
Partial measurement means that some but not all parameter(s) may be stipulated, if the total impact of possible stipulation error(s) is not significant to the resultant savings. Careful review of ECM design and installation will ensure that stipulated values fairly represent the probable actual value. Stipulations should be shown in the M&V Plan along with analysis of the significance of the error they may introduce.		
B. Retrofit Isolation Savings are determined by field measurement of the energy use of the systems to which the ECM was applied, separate from the energy use of the rest of the facility. Short-term or continuous measurements are taken throughout the post-retrofit period.	Engineering calculations using short term or continuous measurements	Application of controls to vary the load on a constant speed pump using a variable speed drive. Electricity use is measured by a kWh meter installed on the electrical supply to the pump motor. In the baseyear this meter is in place for a week to verify constant loading. The meter is in place throughout the post-retrofit period to track variations in energy use.
C. Whole Facility Savings are determined by measuring energy use at the whole facility level. Short-term or continuous measurements are taken throughout the post-retrofit period.	Analysis of whole facility utility meter or sub-meter data using techniques from simple comparison to regression analysis.	Multifaceted energy management program affecting many systems in a building. Energy use is measured by the gas and electric utility meters for a twelve month baseyear period and throughout the post-retrofit period.
D. Calibrated Simulation Savings are determined through simulation of the energy use of components or the whole facility. Simulation routines must be demonstrated to adequately model actual energy performance measured in the facility. This option usually requires considerable skill in calibrated simulation.	Energy use simulation, calibrated with hourly or monthly utility billing data and/or end- use metering.	Multifaceted energy management program affecting many systems in a building but where no baseyear data are available. Post-retrofit period energy use is measured by the gas and electric utility meters. Baseyear energy use is determined by simulation using a model calibrated by the post-retrofit period utility data.

E . **Estimated.** Based on engineering calculations, only

M&V Option	How Baseline is Determined	Typical Applications
A. Partially Measured Retrofit Isolation Savings are determined by partial measurement of the energy use of the system(s) to which an ECM was applied, separate from the energy use of the rest of the facility. Some parameters are stipulated rather than measured.	Projected baseline energy use is determined by calculating the hypothetical energy performance of the baseline system under post-construction operating conditions.	Lighting system where power draw is periodically measured on site. Operating hours are stipulated.
B. Retrofit Isolation Savings are determined by full measurement of the energy use and operating parameters of the system(s) to which an ECM was applied, separate from the rest of the facility.	Projected baseline energy use is determined by calculating the hypothetical energy performance of the baseline system under measured post- construction operating conditions.	Variable speed control of a fan motor. Electricity needed by the motor is measured on a continuous basis throughout the M&V period.
C. Whole Facility Savings are determined at the whole-building level by measuring energy use at main meters or with aggregated sub-meters.	Projected baseline energy use determined by measuring the whole-building energy use of similar buildings without the ECMs.	New buildings with energy-efficient features are added to a commercial park consisting of buildings of similar type and occupancy.
D. Calibrated Simulation Savings are determined at the whole-building or system level by measuring energy use at main meters or sub-meters, or using whole-building simulation calibrated to measured energy use data.	Projected baseline energy use is determined by energy simulation of the Baseline under the operating conditions of the M&V period.	Savings determination for the purposes of a new building Performance Contract, with the local energy code defining the baseline.

Table 1: Overview of New Construction M&V Options

E . **Estimated.** Based on engineering calculations, only

Source: http://www.ipmvp.org

	Units	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
Existing building or new construction		existing				existing		existing								
Commissioning provider		TAMU/ESL	TAMU/ESL	TAMU/ESL	TAMU/ESL		TAMU/ESL	TAMU/ESL	TAMU/ESL		TAMU/ESL	TAMU/ESL	TAMU/ESL	TAMU/ESL	TAMU/ESL	TAMU/ESL
		College Station TX)	College	College Station TX)	College	College Station TX)	College Station TX)	College Station TX)	College Station TX)							
		Station TX)			Station TX)	Station TX)	Station TX)	Station TX)			Station TX)		Station TX)	Station TX)		
		-										0. 11 1			-	
Building name and location		Zachry; Texas A&M	Materials Research	Biology	Capitol Building	S.F. Austin	John H.	Insurance Building	Archives Building	Starr Building	Central Services	Capitol Extension	School of Public	Medical School	Texas Department	Sims Elementary
		University	Institute		Bulluling	Building & CP	Reagan Building	Building	Building	Building	Building	EXICIISION	Health	Building	of Health	School
			(MRI)													
Location - City		College	State	Lubbock	Austin	Austin	Austin	Austin	n Austir	n Austin	Austin	Austin	Houston	Houston	Austin	Fort Worth
		Station	College													
Location - State		TX	PA	TX	TX	TX		ТХ	(T)	🔶 тх	TX	TX			ТХ	TX
Number of buildings	#	1	1	1	1	1		1		1 1	1	1	1		1	1
Year construction completed		1969	1990	1967	1880	1973	1961	1961	1960	1946	1980	1992	1975	1974	1958	1988
Year commissioning project completed		1997	1998	2001	1996	1993	1996	1996	1996	6 1995	1996		1994	1994	1995	1994
Floor area served by commissioned systems	square	258,600	50,000	156,000	282,499	470,000	169,756	102,000	120,000	99,000	100,000	360,000	233,738	877,187	298,700	62,400
	feet		1.1.00		05	077	05	05		000	0/7	017				
Building type(s)		Higher Ed/Lab/Offic		Higher Education/L	Office	Office	Office	Office	e Office	e Office	Office	Office				Education: K
		Eu/Lab/Offic		ab/Office									Outpatient	Outpatient	Outpatient	. 12
		-														
						8			<u> </u>				3	-		· · · ·
Number of deficiencies identified	#/building	26	26	27	1	8	6	6	4	5		8	3	1	2	1
Number of measures recommended	#/building	26	27	27	1	8	6	6	4	5		9	3	1	2	1
					-	-	-	-				-	_		_	
Verification of Measure Installation	Yes-all;	Yes-all	Yes-all	Yes-all		Yes-all	Yes-all	Yes-al	l Yes-al	Yes-all		Yes-all	Yes-all	Yes-all	Yes-all	Yes-al
	Yes-some; No;															
	Unknown															
	-															
Commissioning cost	\$/ft2		2.20	0.49	0.12	0.09	0.21	0.34	0.29	0.28	0.20	0.11	0.15	0.05	0.11	0.50
Direct commissioning and an a fraction of total	(\$2003)															
Direct commissioning cost as a fraction of total construction cost (new construction only)	%															
Total energy savings [weather-normalized]	kBTU/ft2-		256.3	68.6						49.9						
	vear															
Total energy savings [weather-normalized]	%		27.2%	18.6%						33.1%						
Inflation-corrected energy savings, local energy prices,	\$/ft2-year		2.30	0.30	0.35	0.08	0.34	0.16	0.09	0.52	0.09	0.32	0.32	1.18	0.04	0.27
excluding non-energy impacts	(\$2003)															
Inflation-corrected savings, using standardized US	\$/ft2-year	0.22	3.34	0.77	0.83					0.65				2.03		
energy prices, including non-energy impacts if quantified	(\$2003)															
Payback time - [no normalizations] nominal values: raw	Years		1.0	1.8	0.3	0.9	0.5	1.6	2.4	0.5	1.9	0.3	0.4	0.0	2.1	1.4
nominal-price data (mixed dollars and prices), excluding non-energy impacts																
Payback time - Standardardized energy prices and	Years		0.7	0.6	0.1					0.4				0.0		
inflation-corrected commissioning costs, including non-																
energy impacts																
Energy savings determination [select answers that correspond to the energy data given in prior rows. See	A; B; C; D; or E	C	C	C	C	C	C	C		c	C	C	C	C	c c	C
Appendix D for definitions]	OFE															
Data Source(s)		TAMU	Penn	Wei, G.	TAMU	Claridge	Claridge	Claridge	Claridge	Lui et al.		Gregerson	Lui 1993;	Lui 1993;	TAMU	Lui
. /		LoanStar	State	Texas	LoanStar	et al	et al	et al	et al	1996; Lui et		1997; Zhu	TAMU	TAMU	LoanStar	1993a;
		file documen	CC Report	Tech CC Final	file documen	1994; Lui et al.	1994; Claridge	1994; Claridge	1994; Claridge	al, 1999; Gregerson	file documen	et al. 1997;	LoanStar	LoanStar file	file document	Claridge et al
		documen ts	(TAMU	Report,	documen ts	et al. 1994:	et al	et al	et al	1997; TAMU	ts	LoanStar file	documen			1994;
			files); 2.	October		Claridge	1996;	1996;	1996;	LoanStar file		documents	ts	s	-	Claridge
			Wei et	2001;		et al	Gregerso	Gregerso		documents						et al
			al 2000; Giebler	TAMU LoanStar		1996; TAMU	n 1997; Lui 1999;	n 1997; TAMU	n 1997; Zhu et al.				1			1996; TAMU
			et al.	file		LoanStar	TAMU	LoanStar								LoanStar
	1	1	2000	documen		file	LoanStar		TAMU	1	1		1		1	file

ID Evicting building or new construction	Units	16	17	18	19	20	21	22 evicting	23	24	25	26	27	28	29	30
Existing building or new construction		existing						existing								existing
Commissioning provider		TAMU/ESL College	College	TAMU/ESL College	TAMU/ESL College	TAMU/ESL College	TAMU/ESL College	TAMU/ESL College	College							
		Station TX)	Station TX)	Station TX)		Station TX)	Station TX)	Station TX)	Station TX)		Station TX)	Station TX)	Station TX)		Station TX)	Station TX)
		,	,	,	,	,	,	, ,	,	,	, ,	, ,	,	,	,	,
Building name and location		Dunbar	Boiler Room	Pacia	Old Clinic &	Now Clinic	John Sealy	Clinical	Basic	Moody	John Sealy	Kleberg;	Harrington	Richardson	Vot Mod	Blocker:
Building name and location		Middle	BUIIEI RUUIII	Research	Lutheran	New Clinic	North	Sciences	Sciences	Memorial	South	Texas A&M		Petroleum:	Center	Texas A&M
		School		1 toobaron	Pavillion			00.011000		lineinei	Couli	University	Texas A&M	Texas A&M	Addition-	University
												-	University	University	Research	
															Tower; Texas A&M	
															University	
Location - City		Fort Worth	Houston	Houston	Houston	Houston	Galveston	Galveston	Galvestor	Galveston	Galveston					College
												Station				Station
Location - State Number of buildings		TX 1	TX	C TX		TX		-		TX						
Year construction completed	#	1982	1954		1970	1980	1978	1970	1971							1978
		1002	1004	1000		1000		10/0	1071	1000	10/0	1000	1070	1000	10000	10/0
Year commissioning project completed		1993	1994	1994	1994			1995				1996				1997
Floor area served by commissioned systems	square feel	92,884	412,872	120,376	499,013	276,466	54,494	124,870	137,856	67,380	373,085	165,031	130,844	113,700	114,666	257,953
Building type(s)	ICCI	Education: K	Healthcare:	Healthcare:	Healthcare:	Healthcare:	Healthcare:	Higher	Higher	Warehouse	Healthcare:	Higher	Office	Higher	Higher	Higher
Ballang ()po(o)		12	Outpatient	Outpatient						and	inpatient			Education/L	Education/O	Education/O
								ab	ab/Office	e Storage		Lab/Office	•	ab/Office	ffice	ffice
Number of deficiencies identified	#/building	1	3				3	3	2	3	4	23	5	11	3	14
	_															
Number of measures recommended	#/building	1	3				3	3	2	3	4	23	5	11	3	16
Verification of Measure Installation	Yes-all;	Yes-al	Yes-all				Yes-all	Yes-all	Yes-al	Yes-all	Yes-all	Yes-al	Yes-al	Yes-all	Yes-all	Yes-al
	Yes-some							100 4								100 4
	No;															
	Unknown															
Commissioning cost	\$/ft2	0.41	0.10	0.29	0.08	0.12	0.56	0.27	0.26	0.44	0.11	0.29	0.15	0.27	0.27	0.12
	(\$2003)	-				-		-		-	-				-	-
Direct commissioning cost as a fraction of total	%															
construction cost (new construction only) Total energy savings [weather-normalized]	kBTU/ft2-											356.8	96.5	234.9	184.1	56.2
Total energy savings [weather-normalized]	vear											330.0	50.5	234.9	104.1	50.2
Total energy savings [weather-normalized]	%											49.5%		50.1%		30.1%
Inflation-corrected energy savings, local energy prices,	\$/ft2-year	0.15	0.44	2.04	0.94	0.87	4.33	0.22	2.65	0.61	0.64	1.87	0.54	1.23	0.98	0.35
excluding non-energy impacts	(\$2003)															
Inflation-corrected savings, using standardized US	\$/ft2-year											3.23	1.00	2.13	1.74	0.70
energy prices, including non-energy impacts if quantified	(\$2003)											0.20				0.10
Payback time - [no normalizations] nominal values: raw	Years	2.0	0.2	0.1	0.1	0.1	0.1	1.0	0.1	0.6	0.1	0.1	0.2	0.2	0.2	0.3
nominal-price data (mixed dollars and prices), excluding non-energy impacts																
Payback time - Standardardized energy prices and	Years											0.1	0.1	0.1	0.2	0.2
inflation-corrected commissioning costs, including non-												_	-			
energy impacts		0	С		c	0	0	C		с С	C				С	
Energy savings determination [select answers that correspond to the energy data given in prior rows. See	A; B; C; D; or E			C				U	C			c c	C	C	L C	С
Appendix D for definitions]	012															
Data Source(s)		Lui	TAMU	Lui	Lui	Lui	Lui	Lui	Claridge	Lui	Lui	Turner	Turner et			Turner et
		1993a; Claridae	LoanStar file	1993b; TAMU	1993b; Lui	1993b; Lui	1993b; Lui	1993b; Lui	et al 1994: Lu	1993b; i Lui	1993b; Lui 1993c	et al. 2001:	al. 2001; TAMU	al. 2001; TAMU	al. 2001; TAMU	al. 2001; TAMU
		Claridge et al	documen		1993d;	Lui 1993e;	1993f;	1993c;	et al.	1993f:	Claridge	2001; CC	LoanStar	LoanStar		LoanStar
		1994;	ts	file	TAMU	TAMU	Claridge	Claridge	1994;	Claridge	et al	Report	file	file	file	file
		Claridge		documer	LoanStar	LoanStar	et al	et al	Claridge	et al	1994;		documen	documen		documen
		et al 1996:		tS	file documen	file documen	1994; Claridge	1994; Claridge	et al 1996;	1994; Claridge	Claridge et al		ts	ts	ts	ts
		TAMU			ts	ts	et al	et al	Liu,	et al	1996					
		LoanStar					1996	1996;	TAMU	1996			1			
	1	file	1	1	1	1	1	TAMU	LoanStar	1	1	1	1	1		

ID	Units	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45
Existing building or new construction		existing			existing											
Commissioning provider		TAMU/ESL College	TAMU/ESL College	TAMU/ESL College	TAMU/ESL College	TAMU/ESL College	TAMU/ESL College	College	TAMU/ESL College	College	College	TAMU/ESL College	TAMU/ESL College	TAMU/ESL College	TAMU/ESL College	College
		Station TX)	Station TX)	Station TX)	Station TX)	Station TX)	Station TX)	Station TX)	Station TX)	Station TX)	Station TX)	Station TX)	Station TX)	Station TX)	Station TX)	Station TX
		olulion my	oldion 17ty			chanter inty		oladon ny					olulion my			olulion m
B 11 11																
Building name and location		Eller O&M Texas A&M	Koldus; Texas A&M	G.R. White Coliseum;	Wehner; Texas A&M				Chemistry North		Matheson Complex	Reed McDonald	Large Animal	Research Facility	Heep Center	Small Animal
		University	University	Texas A&M	University				North		Complex	IVICDUIIaiu	Animai	raciiity	Center	Animai
		Chirolony	Chinesency	University	erniterency											
Location - City		College	College	College	College	Lubbock	Lubbock	Lubbock	Lubbock	Lubbock	Salt Lake	TAMU	TAMU		TAMU	TAM
Econtori Oity		Station		Ststion	Station	Labbook	Labbook	Labbook	Labbook	Labbook	City		in une	17	17 4010	17 40
Location - State		TX			TX	TX	TX	ТХ	TX	TX			TX	К ТХ	ТХ	T
Number of buildings	#		1	1	1	1	1	1	1		1	1	1	1	1	
Year construction completed		1973	1980	1960	1992	1966	1970	1970	1960	1968	1997					
Year commissioning project completed		1997	1997	1997	1996	2001	2001	2001	2001	2001	2002	1996	1996	5 1996	1996	199
Floor area served by commissioned systems	square		110,272	177,838	192,001	205,000	118,000	129,000	48,000	48,000	370,000	77,435			158,979	150.000
	feet				102,001	200,000		120,000	10,000	10,000	0.0,000		110,000	,	100,010	,
Building type(s)		Higher	Office	Public Order	Higher	Higher	Higher	Higher	Higher	Higher						
		Education/L		and Safety	Education/O	Education/	Education	Education/	Education/	Education/			l	Education	Education	
		ab/Office			ffice	Office	Office	Office	Office	Office	Safety	1				
Number of deficiencies identified	#/building	16	14	5	10	56	15	18	15	17	23					
Number of measures recommended	#/building	g 16	14	5	10	58	15	18	15	17	23					
Verification of Measure Installation	Yes-all:	: Yes-al	Yes-all	Yes-all	Yes-all	Yes-all	Yes-al	Yes-all	Yes-all	Yes-all	Yes-all					
vernication of measure installation	Yes-some		103-01	103-01	103-01	103-01	103-01	103-01	103-01	103-01	103-01					
	No															
	Unknown	ו														
Commissioning cost	\$/ft2	2 0.22	0.24	0.11	0.05	0.48	0.49	0.48	0.48	0.48		0.42	0.23	0.28	0.21	0.05
Commissioning cost	(\$2003)	0.22	0.24	0.11	0.05	0.48	0.49	0.48	0.48	0.48		0.42	0.23	0.28	0.21	0.05
Direct commissioning cost as a fraction of total	(\$2000)	2														
construction cost (new construction only)																
Total energy savings [weather-normalized]	kBTU/ft2-		111.9	145.3	51.4	31.1	16.1	59.7	25.0	144.2	35.9					
Total energy savings [weather-normalized]	vear	r 38.0%	36.5%	57.3%	23.9%	28.6%	11.4%	26.2%	7.3%	15.9%	28.7%					
Inflation-corrected energy savings, local energy prices,	\$/ft2-year		0.62	0.77	0.28	0.19	0.04	0.29	0.07	0.49	0.21	0.58	1.81	1.42	0.46	0.19
excluding non-energy impacts	(\$2003)	0.05	0.02	0.77	0.20	0.19	0.04	0.29	0.07	0.49	0.21	0.56	1.01	1.42	0.40	0.18
Inflation-corrected savings, using standardized US	\$/ft2-year	r 1.36	1.15	1.36	0.50	0.43	0.14	0.68	0.22	1.51	0.44					
energy prices, including non-energy impacts if quantified	(\$2003))														
Payback time - [no normalizations] nominal values: raw	Years	0.3	0.3	0.1	0.2	2.8	14.7	1.9	7.3	1.1		0.6	0.1	0.2	0.4	0.2
nominal-price data (mixed dollars and prices), excluding	rears	5 0.3	0.3	0.1	0.2	2.8	14.7	1.9	1.3	1.1		0.6	0.1	0.2	0.4	0.4
non-energy impacts																
Payback time - Standardardized energy prices and	Years	s 0.2	0.2	0.1	0.1	1.1	3.6	0.7	2.2	0.3						
inflation-corrected commissioning costs, including non-																
energy impacts																
Energy savings determination [select answers that correspond to the energy data given in prior rows. See	A; B; C; D; or E		C	C C	С	С	C	c C	С	С						
Appendix D for definitions]	012	-														
Data Source(s)		Turner et	Turner et	Turner et	Turner et	Wei, G.	Wei, G.	Wei, G.	Wei, G.	Wei, G.	Turner	Gregerso	Gregerso	Gregerso	Gregerso	Greger
. /		al. 2001;	al. 2001;	al. 2001;	al. 2001;	Texas	Texas	Texas	Texas	Texas	et al.	n 1997	n 1997	n 1997	n 1997	on 199
		TAMU	TAMU	TAMU	TAMU	Tech	Tech	Tech	Tech	Tech	2003;					
		LoanStar	LoanStar file	LoanStar file	LoanStar file	CC Final	CC Final	CC Final	CC Final	CC Final	Zhu 2003					
		documen	documen		documen	Report,	Report,	Report,	Report,	Report,	2003					
				ts	ts	October	October	October	October	October	1		1	1		
		ts	ts	ເຮ	15	October		0000001	0000000	October		1				
		ts	ts	is	15	2001	2001	2001	2001	2001						
		ts	ts	is	is											

	Units	46	47	48	49	50	51	52	53	54	55	56	57	58	59
Existing building or new construction		existing													
Commissioning provider		PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)
Building name and location															
Location - City		Clearlake	Stockton	La Mesa	Sudbury	Hillsboro	Portland	Portland	i Golden	Nashville	Portland	Seattle	Chattanooga	Portland	South Glen
Location - State		CA		CA	MA	OR	OR	OR	co	TN	OR	WA	TN	I OR	C C
Number of buildings	#	1 1991	2	1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	3 1960; 1968;	4	1 1970	1 1997	7	1985	1 1994	1933	1960	1 1978	197
Year construction completed			1986		1985	1980; 1992; 1993; 1997									
Year commissioning project completed		2001	2001	2002			2000							1996	
Floor area served by commissioned systems	square feet	30,244	45,372	125,000	230,400	805,000	261,000	489,700	275,200	250,000	185,500	233,500	175,000	224,000	120,000
Building type(s)		Lodging	Lodging	Office	Lab/Office	Office	Office	Office	e Higher education/Re tail/Office/W arehouse and Storage		Lodging	Office	Office	Office	Reta
Number of deficiencies identified	#/building	9	9	8	6	2	30	21	5	18	23	15	38	19	22
Number of measures recommended	#/building	10	9	9	6	2	30	21	2	18	23	15	38	21	22
Verification of Measure Installation	Yes-all; Yes-some; No; Unknown	Yes-all	Yes-all	Yes-some		Yes-some	Yes-some	Yes-some	Yes-all	Yes-some	Yes-some	Yes-all	Yes-al	Yes-some	Yes-a
Commissioning cost	\$/ft2 (\$2003)	1.58	1.20	0.60	0.21	0.13	0.14	0.34	0.14	0.13	0.17	0.16	0.85	0.08	0.13
Direct commissioning cost as a fraction of total construction cost (new construction only)	%														
Total energy savings [weather-normalized]	kBTU/ft2-	12.4	15.8	7.0	129.8	19.2	16.6	7.9	22.7		11.5			36.4	
Total energy savings [weather-normalized]	vear %	6.0%	9.6%	10.7%	38.2%	10.3%	17.6%	11.1%	6.0%		7.7%				
Inflation-corrected energy savings, local energy prices,	\$/ft2-year	0.33	0.30	0.18	0.49	0.13	0.03	0.16	0.14	0.17	0.14	0.06	0.38	0.06	0.13
excluding non-energy impacts	(\$2003)														
Inflation-corrected savings, using standardized US energy prices, including non-energy impacts if quantified	\$/ft2-year (\$2003)	0.27	0.25	0.16	0.58	0.26	0.06	0.17	0.29		0.12				
Payback time - [no normalizations] nominal values: raw nominal-price data (mixed dollars and prices), excluding non-energy impacts	Years	4.6	3.9	3.3	0.4	0.9	4.5	1.4	1.2	0.6	1.3	2.5	1.8	1.6	0.8
Payback time - Standardardized energy prices and inflation-corrected commissioning costs, including non- energy impacts	Years	5.8	4.7	3.7	0.4	0.5	3.2	2.0	0.5		1.4				
Energy savings determination [select answers that correspond to the energy data given in prior rows. See Appendix D for definitions]	A; B; C; D; or E	E	E	D	E	E	E	E	E			E	E	A	
Data Source(s)		PECI 2001a; Kahn et al. 2002	PECI 2001b; Kahn et al. 2002	PECI, 2002a	PECI and Boston Edison Co. 1998	PECI, 1999	PECI 1999; PECI 2000	PECI, 2003- 2004 interim report and internal spreadsh eets	PECI 2002b; PECI 2003	PECI 1996	PECI interim report (Jan 2002) and master findings spreadshe et (Dec 2002)	PECI internal files, 1997- 1999	PECI 1997b	PECI 1996b	PECI 1996c

	Units	60	61	62	63	64	65	66	67	68	69	70	71	72
Existing building or new construction		existing	existing				existing					existing	existing	existin
Commissioning provider		PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	Facility Dynamics (Baltimore, MD)	Quantum Energy Services and Technologies, Inc QuEST (Oakland, CA)	Nexant (San Francisco, CA)	Quantum Energy Services and Technologies, Inc QuEST (Oakland, CA)						
Building name and location						<u>(•••••••</u> , •••,	((Office1	Office2	Lab1
Location - City		Auburn	Phoenix				Oakland					Cordova		
Location - State		MA	AZ				CA						CA	. Ci
Number of buildings	#	t 1	1	1		18	2	2			2	1	1	100
Year construction completed		1992	1986		1999		1911	1993	5	1980	1939/1985		1984	199
Year commissioning project completed		1996	1996	2003								2000	2000	200
Floor area served by commissioned systems	square feel		80,000	23,210	1,014,133	371,343	317,000	750,000	226,383	210,406	467,685	150,000	383,200	94,000
Building type(s)		Retail	Office	Public Assembly	Office	Higher Education	Service/Office	Lodging/Public Assembly				Office	Office	Lab/Offic
Number of deficiencies identified	#/building	20	14	18	13	1	7	7	1	13	7	11	8	8
Number of measures recommended	#/building	20	14	16	5	1	4	8	1	15	8	11	8	8
Verification of Measure Installation	Yes-all; Yes-some; No; Unknown		Yes-some	Yes-all								Yes-some	Yes-some	Yes-som
Commissioning cost	\$/ft2 (\$2003)	0.16	0.25	2.03	0.08	0.30	0.22	0.09	0.27	0.24	0.17	0.20	0.12	0.41
Direct commissioning cost as a fraction of total	(\$2003)))												
construction cost (new construction only) Total energy savings [weather-normalized]	kBTU/ft2-			36.2	2.6	15.3	5.0	8.1	22.4	9.3	6.5	5.4	15.7	33.2
Total energy savings [weather-normalized]	vear	r		29.5%	4.6%	5.0%	1.9%	2.3%	15.8%	2.0%	1.5%	4.5%	21.2%	28.6%
Inflation-corrected energy savings, local energy prices, excluding non-energy impacts	\$/ft2-year (\$2003)	0.09	0.23	0.44	0.07	0.32	0.08	0.11	0.36	0.40	0.20	0.11	0.24	0.64
Inflation-corrected savings, using standardized US	\$/ft2-year			0.63	0.05	0.21	0.06	0.09	0.25	0.21	0.11	0.12	0.26	0.76
energy prices, including non-energy impacts if quantified	(\$2003)			0.03	0.00	0.21	0.00	0.03	0.23	0.21	0.11	0.12	0.20	0.70
Payback time - [no normalizations] nominal values: raw nominal-price data (mixed dollars and prices), excluding non-energy impacts	Years	1.6	0.9	4.6	1.3	0.9	2.6	0.9	0.8	0.6	0.9	1.8	0.5	0.6
Payback time - Standardardized energy prices and inflation-corrected commissioning costs, including non- energy impacts	Years	\$		3.2	1.8	1.5	3.4	1.0	1.1	1.1	1.5	1.6	0.5	0.5
Energy savings determination [select answers that correspond to the energy data given in prior rows. See Appendix D for definitions]	A; B; C; D; or E		E	D	E	E	E	E	E	E	E	С	С	(
Data Source(s)		PECI 1996d	PECI 1996e	PECI and Sawtooth Technical Services 2003	Quantum Energy Services and Technologi es project files	Quantum Energy Services and Technologie s project files	Quantum Energy Services and Technologie s project files	Technologies		Quantum Energy Services and Technologi es project files	Quantum Energy Services and Technologie s project files	Bourassa et al. 2004	Bourassa et al. 2004	Bourassa et al. 200

ID	Units	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87
Existing building or new construction		existing	existing	existing	existing	existing	existing								existing	existin
Commissioning provider								Herzog/Wh eeler	Sieben Energy	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	PECI (Portland, OR)	
Building name and location		Hospital1	Office3	Office4	Office5	Office6	Office H: Port of Portland Building, 700 N.E. Multnomah	High-Tech Research Facility	203 N. LaSalle St.			Nordstrom				Nampa City Hall
Location - City		Sacramento	Sacramento	Sacramento	Sacramento	Sacramento	Portland	1								Nampia
Location - State		CA	CA	CA	CA	CA	OF	2	IL	. CA	CA	CA	CA	CA	CA	
Number of buildings	#	1		1	1	1	1	1	1	1	1		1	1	1	
Year construction completed		1996	1991	1990	1995	1965	5									1982
Year commissioning project completed							1993		1995						1994	
Floor area served by commissioned systems	square feet	300,000	400,000	324,000	352,000	308,360	312,000	44,000	623,000	146,000	152,000		48,000	50,000	120,000	23,000
Building type(s)		Healthcare: Inpatient and Outpatient/Lab		e Office	Office	Food Service/Office		e Lab	Office	Retai	Service	Retai	Office	Office	Office	Office
Number of deficiencies identified	#/building	19	5	9	9	10	7		640			21				19
Number of measures recommended	#/building	19	5	9	9	10	7									
Verification of Measure Installation	Yes-all; Yes-some; No; Unknown	Yes-some	Yes-some	Yes-some	Yes-some	Yes-some	e Yes-al									
Commissioning cost	\$/ft2 (\$2003)	0.13	0.06	0.11	0.09	0.10	0.13	0.64	0.18	0.42	0.43	0.45	0.51	0.64	0.20	2.43
Direct commissioning cost as a fraction of total construction cost (new construction only)	%															
Total energy savings [weather-normalized]	kBTU/ft2-	(14.9)	3.8	4.0	6.0	5.5										45.8
Total energy savings [weather-normalized]	vear %	-7.4%	5.1%	7.1%	12.0%	7.7%										
Inflation-corrected energy savings, local energy prices, excluding non-energy impacts	\$/ft2-year (\$2003)	(0.09)	0.08	0.09	0.13	0.16	0.03	2.15	0.28	0.18	0.09	0.29	0.40	0.26	0.04	0.73
Inflation-corrected savings, using standardized US energy prices, including non-energy impacts if quantified	\$/ft2-year (\$2003)	(0.13)	0.09	0.09	0.14	0.15	0.04									0.79
Payback time - [no normalizations] nominal values: raw nominal-price data (mixed dollars and prices), excluding non-energy impacts	Years	(1.5)	0.8	1.2	0.7	0.6	3.7	0.2	0.5	1.9	3.7	1.2	1.0	2.0	4.6	3.4
Payback time - Standardardized energy prices and inflation-corrected commissioning costs, including non- energy impacts	Years	(1.0)	0.7	1.2	0.6	0.6	2.8		-							2.4
Energy savings determination [select answers that correspond to the energy data given in prior rows. See Appendix D for definitions]	A; B; C; D; or E	С	C	c	С	C	E		E	E	E	E	E	E	E	E
Data Source(s)		Bourassa et al. 2004	Bourassa et al. 2004	Bourassa et al. 2004	Bourassa et al. 2004	Bourassa et al. 2004	Piette et al. 1995; Piette and Nordman 1996	Gregers on 1997		Greger son 1997	Gregers on 1997		Gregers on 1997	Greger son 1997		SBW and Skumatz 2003

ID	Units	88	89	90	91	92	93	94	95	96	97	98	99	100	101	102
Existing building or new construction		existing		existing				existing			existing	existing	existing	existing	existing	existin
Commissioning provider			Facility		KeithlyWels		Northwest		TAMU/ESL	TAMU/ESL						
			Improvemen		n	West	Engineering Service, Inc.		College Station TX)	College Station TX)						
			Corporation			Engineers (Eugene, OR)	Service, Inc.		Station IX)	Station TA)						
			(Great Falls,			Lugene, Or	'I									
			MT)													
Building name and location		Army		University of	Beaverton	DAS Public	Portland	Clover	Acute-care	In-patient	Middle	Elementary	Elementary			
		Aviation	Middle	Montana -	School	Services	State	Park	hospital	mental health		school	School (unit			
		Support	School	Gallagher Hall	District -	Building	University -	Elementar					ventilators)			
		Facility			Sexton	-	Science	y School								
					Mountain		Building									
					Elementary											
					School											
Location - City		Helena	Helena	Missoula	Beaverton	Salem	Portland	Lakewood	Minneapolis	5						
Location - State		MT	МТ	мт	OR	OR	OR	WA	MN	I MN	MN	MN	MN	MN	WA	WA
		IVI I	MI	MI	UR	UR		2 VVA			IVIN		IVIN	IVIN	VVA	VV/
Number of buildings	#	1999	1999	1997	1	1955	1	2	1982	1962	1959	1	1965	1	1	
Year construction completed		1999	1999	1997		1955			1982	1962	1959		1965			
Year commissioning project completed	1	2001	2002	2002	1999	2000	2000	2002	1999	1998	2000	1999	2001	2001	1993	1993
Floor area served by commissioned systems	square		64,000	110,380	65,000	172,400	213,000		600,000		220,000	105,625	93,900	59,000	95,000	11,232
. Ison alou berved by commissioned systems	feet		04,000	110,000	00,000	1/2,400	210,000	55,405	000,000	07,000	220,000	100,020	55,500	00,000	00,000	
Building type(s)			Education: K	Higher	Education:	Office	Higher	Education:	Healthcare	Healthcare	Education: K	Education: K	Education:	Office	Office	Retai
Ballanig (Jpo(o)		, total	12	Education			Education						K-12			
Number of deficiencies identified	#/building	112	103	249	37	22	55	19	14	14	481	131	30	6		
Number of measures recommended	#/building								15	23	481	167	31	6		
Verification of Measure Installation	Yes-all:								Yes-some							
venification of measure installation	Yes-some:								165-50116							
	No:															
	Unknown															
Commissioning cost	\$/ft2	0.35	0.44	0.31	0.41	0.42	0.11	1.00	0.41	1.33		0.30		0.85	0.03	0.57
-	(\$2003)															
Direct commissioning cost as a fraction of total	%															
construction cost (new construction only)														17.0		
Total energy savings [weather-normalized]	kBTU/ft2-	57.1	3.7	15.6	10.9	0.3	3.0	5.4	34.1	131.6				17.0		3.0
Total energy savings [weather-normalized]	vear %	-							13.5%							10.0%
Inflation-corrected energy savings, local energy prices,	\$/ft2-year	0.61	0.04	0.22	0.20	0.04	0.04	0.08	0.33					0.20		0.02
excluding non-energy impacts	(\$2003)	0.01	0.04	0.22	0.20	0.04	0.04	0.06	0.55	1.55				0.20		0.02
excluding non-energy impacts	(\$2003)															
Inflation-corrected savings, using standardized US	\$/ft2-year	0.61	0.03	0.23	0.21	0.03	0.03	0.08	0.40	1.63			1	0.31		
energy prices, including non-energy impacts if quantified	(\$2003)							2.50								
Payback time - [no normalizations] nominal values: raw	Years	0.5	12.2	1.4	1.8	10.0	2.7	12.9	1.2	0.9				4.2		20.7
nominal-price data (mixed dollars and prices), excluding																
non-energy impacts																
Payback time - Standardardized energy prices and	Years	0.3	10.4	0.5	-	7.5	-	6.8	1.0	0.8				0.1		8.4
inflation-corrected commissioning costs, including non-																
energy impacts		E	-	E	-		E	F	C					-		E
Energy savings determination [select answers that	A; B; C; D; or E		E		E	E	- E	E	L	' A				E	E	
correspond to the energy data given in prior rows. See Appendix D for definitions]	OIE															
Data Source(s)		SBW and	SBW and	SBW and	SBW and	SBW and	SBW and	SBW and	MNCEE	MNCEE 2001b	MNCEE	MNCEE	MNCEE	MNCEE	Stum et al	Stum et al
		Skumatz	Skumatz	Skumatz 2003	Skumatz	Skumatz 2003;			2001a		2001c	2001d	2001e	2001f	1994	1994
		2003	2003	Citamate 2000		Tso et al (no		2003	20010		20010	20010	20010	20011		1.001
					al (no date);	date).	al (no date);									
					NEEA (no		NEEA (no									
					date-a)		date)	1		1						
								1		1						
								1		1						
	1															

D	Units	103	104	105	106
Existing building or new construction		existing	existing		
Commissioning provider				HEC (ESCO)	HEC (ESCO)
Building name and location				Capital High School	Special Care Facility
Location - City				Charleston	Charleston
and the Otate		WA	WA	wv	WV
Location - State Number of buildings	#		1 VVA	1	1
Year construction completed		'		1988	1986
Year commissioning project completed		1993	1993	1993	1989
Floor area served by commissioned systems	square		32,800	253,000	123,500
Building type(s)	feet	Office	Office	Education: K-12	Healthcare: Inpatient
Number of deficiencies identified	#/building				
Number of measures recommended	#/building				
Verification of Measure Installation	Yes-all; Yes-some; No; Unknown				
Commissioning cost	\$/ft2 (\$2003)	0.83	0.11	0.70	3.86
Direct commissioning cost as a fraction of total construction cost (new construction only)	%				
Total energy savings [weather-normalized]	kBTU/ft2- year		1.2		
Total energy savings [weather-normalized]	%		31.0%		
Inflation-corrected energy savings, local energy prices, excluding non-energy impacts	\$/ft2-year (\$2003)		0.01	0.30	0.89
Inflation-corrected savings, using standardized US energy prices, including non-energy impacts if quantified	\$/ft2-year (\$2003)				
Payback time - [no normalizations] nominal values: raw nominal-price data (mixed dollars and prices), excluding non-energy impacts	Years		9.8	1.8	3.0
Payback time - Standardardized energy prices and inflation-corrected commissioning costs, including non- energy impacts	Years		4.0		
Energy savings determination [select answers that correspond to the energy data given in prior rows. See Appendix D for definitions]	A; B; C; D; or E	E	E	E	E
Data Source(s)		Stum et al 1994	Stum et al 1994	Zachwieja and Williams 1994	Zachwieja and Williams 1994

APPENDIX E. Catalog of Projects (summary) NEW CONSTRUCTION

ID	Units	1	2	3	4	5	6	7	8	9	10	11	12	13	14
Existing building or new construction		new						new	new	new	new	new	new	new new	/ ne
Commissioning provider		PECI	PECI	PECI	PECI	Affiliated Engineers, Inc	Affiliated Engineers, Inc								
Building name and location						Alameda County Med. Ctr. Highland Hospital Campus New Critical Care and Chiller Building	Mission Bay Building 24B		Office B	Office C: City of Portland Water Control Center and Water Quality Laboratory, N. Interstate Ave.	Office D: Regency Building, 2749 E. Parley's Way	Office E: Towers Building, 10600 S. Towne	Office F: Utah Human Services Building	Office G: Metro Service District Headquarters	Theater I: Cannes Cinema Center, 1026 12th Ave.
Location - City		Vancouver	Gresham	Portland		Oakland	I San Francisco		1	Portland	Salt Lake City		Salt Lake City		Seasio
Location - State		WA	OR	OR	TN	CA				OR					0
Number of buildings	#		1	1	1	2	2 1	1	1	1	1	1	1	1	1
/ear construction completed		1997	2001	1998	2001	2003	3 2002	1992	1993	1993	1993	1993	1993	1993	199
ear commissioning project completed		1997	2002	1998	2002	2003	3 2002	1994	1994	1994	1993	1994	1994	1994	
Floor area served by commissioned systems	square feet	84,000	180,000	87,000	20,000	324,000	450,000	19,860	21,776	24,842	34,800	66,000	66,473	84,060	12,50
Building type(s)		Healthcare: Outpatient	Office/Servi ce/Wareho use & Storage	Inpatient &		Healthcare Inpatient & Outpatient/Lab/C ffice	Assembly/W		Office	Laboratory	Office	Office	Office	Office	e Publ Assemb
Number of deficiencies identified	#/building	112	30	33	202	128	705	4	3	3	15	7	8	13	:
Number of measures recommended	#/building	112	30	33	57	128	705	4	3	3	15	7	8	13	:
Verification of Measure Installation	Yes-all; Yes-some; No; Unknown		Yes-all	Yes-all	Yes-all			Yes-all	Yes-all	Yes-all	Yes-all	Yes-al	Yes-al	Yes-al	I Yes-a
Commissioning cost	\$/ft2 (\$2003)	0.50	0.59	0.16	4.77	2.13	1.22	0.11	0.49	0.24	0.67	0.11	0.10	0.26	0.3
Direct commissioning cost as a fraction of total construction cost (new construction only)	%	0.3%	0.4%	0.1%	2.1%	0.6%	0.3%	0.1%	0.3%	0.2%	0.4%	0.1%	0.1%	0.2%	0.2
Total energy savings [weather-normalized]	kBTU/ft2- year	-						0.1	3.7	2.2	5.0	1.5	1.6	11.8	1.8
Total energy savings [weather-normalized]	%														
Inflation-corrected energy savings, local energy prices, excluding non-energy impacts	\$/ft2-year (\$2003)							0.00	0.10	0.02	0.06	0.03	0.03	0.17	0.0
Inflation-corrected savings, using standardized US energy prices, including non-energy impacts if quantified	\$/ft2-year (\$2003)							0.00	0.09	0.03	0.06	0.04	0.05	0.26	0.04
Payback time - [no normalizations] nominal values: raw nominal-price data (mixed dollars and prices), excluding non-energy impacts	Years	;						24.6	4.1	10.6	8.8	3.6	2.3	1.3	10.
Payback time - Standardardized energy prices and inflation-corrected commissioning costs, including non- energy impacts	Years	•						31.5	5.4	7.8	10.4	2.9	2.0	1.0	7.
Energy savings determination [select answers that correspond to the energy data given in prior rows. See Appendix D for definitions]	A; B; C; D; or E			С				E	E	E	E	E	E	E	
Data Source(s)		Project binder issues logs and project budget information.	PECI 2002	PECI - Kaiser Interstate Medical South Commissioni ng Final Report	PECI and The McCarty Company 2002	Affiliated Engineers, Inc., project files	Affiliated Engineers, Inc., project files	Piette et al. 1995; Piette and Nordman 1996	Piette et al. 1995; Piette and Nordman 1996	Piette et al. 1995; Piette and Nordman 1996	Piette et al. 1995; Piette and Nordman 1996	Piette et al. 1995; Piette and Nordman 1996		Piette et al. 1995 Piette and Nordman 1996	; Piette et a 1995; Piet and Nordman 1996

ID	Units	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29
Existing building or new construction		new	new	new	new new	new new	/ new	new	new	new new	new new	new	new new	/ new	/ new	/ nev
Commissioning provider																
																L
Building name and location		Retail J: Pine Crest Fabrics.	Retail K: Jack Tedsen	Food Value	Hospital M: Columbia	Motel N: Best Western Rama	Grocery O: United	Hotel P: Governor	Mental Hospital	University Classroom	University Classroom	University Lab/Classr			University	
		9707 N.E. Colfax			Memorial	Inn	Grocers	Hotel, 10th		Classicolli	Classicolli	oom		sroom	oom	
			Mall,	#8, 1121 N.W.	Hospital		Price-Less	Ave. and								
			Washington	Newport Ave.	Building		Foods Store	Alder St.								
			Blvd.													
Location - City		Portland	Crescent City	Bend	Astoria	Redmond	Roseburg	Portland								
			,				_									
Location - State		OR	CA	OR	CF OF			-	MT	MT	MT	MT	MT	MT	MT	MT
Number of buildings	#	1	1	1	1	1	1	2	1	1	1	1	1	1	1 1	1
Year construction completed		1993	1993	1993	1993	1993	3 1993	1993	1996	1996	1996	1996	1996	i 1996	1996	s 1996
Year commissioning project completed		1993	1993	1993	1994	1993	3 1993	1993	1996	1997	1997	1997	1997	1999	1999	1998
Floor area served by commissioned systems	square	14,879	17,050	19,400	22,954	29,371	38,500	64,500	63,526	1,072	110,380	110,303	32,268	44,966	140,700	4,523
B 111 () ()	feet			5 101			E 101					-	015		·	015
Building type(s)		Warehouse and Storage			Healthcare Inpatient		Food Sales	Lodging	Healthcare: Inpatient		Higher	Food Sales/Lodg		e Lab	Lab	Office
		Otorage	Outpatient	L	inpatien				inpatient		Luucation	ng				
Number of deficiencies identified	#/building	2	2	7		4	10	2							-	
Number of deliciencies identified	#/building	2	2	1		4	10	2								
Number of measures recommended	#/building	2	2	7		4	10	2								
	-															
Verification of Measure Installation	Yes-all;	Yes-al	Yes-al	Yes-al	l Yes-al	Yes-al	l Yes-all	Yes-al								
	Yes-some; No;															
	Unknown															
Commissioning cost	\$/ft2	0.20	0.62	0.52	0.26	0.95	0.28	0.25	0.42	18.20	0.81	1.02	0.62	1.79	1.55	2.08
Direct commissioning cost as a fraction of total	(\$2003)	0.1%	0.4%	0.3%	0.2%	0.6%	0.2%	0.2%	0.3%		0.6%	0.7%	3.4%	1.1%	2.3%	1.4%
construction cost (new construction only)	70	0.170	0.470	0.570	0.2/0	0.070	0.270	0.270	0.570	1	0.070	0.770	J 3.470	1.17	2.57	1.470
Total energy savings [weather-normalized]	kBTU/ft2-	0.4		14.9		0.7	8.7	0.1								
	vear															<u> </u>
Total energy savings [weather-normalized] Inflation-corrected energy savings, local energy prices,	% \$/ft2-year	0.01		0.25		0.01	0.16	0.00		-					-	
excluding non-energy impacts	(\$2003)	0.01		0.25		0.01	0.10	0.00								
oxolaaling holf onolgy impacto	(\$2000)															
Inflation-corrected savings, using standardized US	\$/ft2-year	0.01		0.35		0.02	0.25	0.00								
energy prices, including non-energy impacts if quantified	(\$2003)															
Payback time - [no normalizations] nominal values: raw	Years	19.4		1.6		62.9	1.4	136.1								
nominal-price data (mixed dollars and prices), excluding	i cais	15.4		1.0		02.9	1.4	150.1								
non-energy impacts																
Payback time - Standardardized energy prices and	Years	20.5		1.5		59.4	1.1	105.0								
inflation-corrected commissioning costs, including non- energy impacts																
Energy savings determination [select answers that	A; B; C; D;	E		E	E	E	E	E								+
correspond to the energy data given in prior rows. See	or E		-	-				-								
Appendix D for definitions]																
Data Source(s)			Piette et al.	Piette et al.	Piette et al.	Piette et al. 1995;		Piette et al.		Wilkinson	Wilkinson	Wilkinson	Wilkinson	Wilkinson	Wilkinson	Wilkinson
		Piette and Nordman 1996	1995; Piette and Nordman	1995; Piette and Nordman 1996	and Nordman	Piette and Nordman 1996	1995; Piette and Nordman	1995; Piette and	2000	2000	2000	2000	2000	2000	2000	2000
		nationali 1990	1996	Noruman 1390	1996	internationali 1990	1996	Nordman								
								1996								
	1	1	1	1	1	1	1	1		1	1	1	1	1	1	1

ID	Units	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44
Existing building or new construction		new	new	new new	new	new	new	new	/ new	new	new	new	new	new	new new	v ne
Commissioning provider																
Building name and location		Lab/Classroom Addition	Juvinile	Mental		Prison	Prison	Prison	Prision			Student Union	Physics/	Project B	Project C	Project D
		Addition	Detention	Hospital								Building	Astronomy Building			
													Dulluling			
Location - City													Seattle	Seattle	Seattle	e Seatt
Location - City													Seallie	Seallie	Seallie	Seam
Location - State		MT	MT	MT	MT	MC	MO	MC	MO	MO	WA	WA	WA WA	WA	WA	w.
Number of buildings	#	¢ 1	1	1	1	1	1	1	1 1	1	1	1	1	1		1
Year construction completed		1996	1996	1996	1996	1996	1996	1996	6 1996	1996	1996	1996	5 1994	1994	1994	1 199
Year commissioning project completed		1999	1999	1999	2001	1998	2001	2001	2001	2000	2001	2001	1994	1994	1994	199
Floor area served by commissioned systems	square			79,130	202,648	245,000	381,000	380,891	685,000	76,000	51,000	30,000		108,000	233,000	
	feet		10,010	10,100	202,010	2.0,000	001,000	000,001	000,000	. 0,000	01,000	00,000	200,000	100,000	200,000	201,000
Building type(s)		Lab					Public					Highe	r Higher	Higher	Highe	r Highe
			Order and	Inpatient	Assembly			Order and	d Order and		Inpatient	t Education	Education/L	Education	Education/L	Education/
			Safety	1		Safety	Safety	Safety	/ Safety	r			ab/Office	Lab/Office	ab/Office	e ab/Offic
Number of deficiencies identified	#/building	3														
	48 3 8															
Number of measures recommended	#/building	9														
Verification of Measure Installation	Yes-all;															
	Yes-some	2														
	No;															
	Unknown	ו														
Commissioning cost	\$/ft2	2 0.93	1.27	1.66	0.57	1.62	1.36	1.09	1.27	3.82	1.32	1.00	0.86	3.19	1.43	4.14
Commissioning cost	(\$2003)		1.27	1.00	0.57	1.02	1.50	1.03	1.27	5.02	1.52	1.00	0.00	5.15	1.45	4.1-
Direct commissioning cost as a fraction of total	%	0.8%	0.7%	1.0%	0.8%	0.5%	0.8%	0.6%	0.7%	1.3%	0.9%	1.0%	0.4%	0.8%	0.8%	1.8
construction cost (new construction only)																
Total energy savings [weather-normalized]	kBTU/ft2-												26.2			
Total energy savings [weather-normalized]	vear %															-
Inflation-corrected energy savings, local energy prices,	\$/ft2-year												0.09			-
excluding non-energy impacts	(\$2003)															
Inflation-corrected savings, using standardized US	\$/ft2-year (\$2003)												0.24			
energy prices, including non-energy impacts if quantified	(\$2003)	, ,														
Payback time - [no normalizations] nominal values: raw	Years												7.5			
nominal-price data (mixed dollars and prices), excluding																
non-energy impacts																
Payback time - Standardardized energy prices and inflation-corrected commissioning costs, including non-	Years	3											3.6			
energy impacts																
Energy savings determination [select answers that	A; B; C; D;												E			-
correspond to the energy data given in prior rows. See	or E												-			
Appendix D for definitions]																
Data Source(s)		Wilkinson 2000	Wilkinson 2000	Wilkinson 2000	Caner 1996; 1997	Caner 1997	Caner 1997	Caner 1997								
			2000	2000	2000	2000	2000	2000	2000	2000	2000		1391			

ID Existing building or now construction	Units	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59
Existing building or new construction Commissioning provider		new				Farnsworth	new Farnsworth	CH2M Hill	new	Western	new			new	new	nev Keithly/We
Commissioning provider		Farnsworth Group		Farnsworth Group	Group	Group	Group	(Portland		Montana		Environmenta I and				sch
		Group	Group	Group	Group	Croup	Oroup	OR)		Engineering		Engineering				Associates
										Engineering		Services, Inc.				Inc (Burien
																WA)
Building name and location		Supermarket	Science		Vivarium	Science	Elementary	Ada	Boise State		Beaverton	Courthouse	Lane	North	Salem-	Bainbridge
			Center			Building	School	County	University	Building -	Library	Square		Clackamas	Keizer	Island
								Courthous	Recreation	State Prison		Transit	College -	High School	School District -	School District -
								e	Center			Facility	Day Care Center		Marion F.	B.I. High
													Center		Miller	School
															Elementary	0011001
															School	
Location - City								Boise	e Boise	Deer Lodge	Beaverton	Salem	Eugene	Clackamas	Salem	Bainbridge
										_						Island
Location - State		WI	CO	CC	NC NC	AL	IN	I ID	D ID	MT	OR	OR		OR	OR	WA
Number of buildings	#	1	1	1	1	1	1	1	1	1	1	1	4	1	1	1
Year construction completed		1999						2001	2002	2002		2001	2000	2000		2000
Year commissioning project completed		2000						2001	2002	2003	2000	2001	2000	2000	2000	2000
Floor area served by commissioned systems	square		84,427	365,850	196,996	344,743	77,391	340,000		23,300	69,500	160,000	18,300	250,000	49,000	144,000
	feet		01,121	000,000			,	0.0,000	00,110	20,000	00,000		10,000	200,000		,
Building type(s)		Food Sales	Public	Healthcare	Lab	Lab	Education: K	E Public	Public	Public Order	Public	Public	Education:	Education:	Education:	Education
			Assembly	Inpatient	t		12			and Safety	Assembly	Assembly	K-12	K-12	K-12	K-12
								Safety	/							
Number of deficiencies identified	#/building	4						97	183	71	57	101	6	75	74	148
	mounding	-						01	100		07		l .	10	'*	140
Number of measures recommended	#/building	7														
Verification of Measure Installation	Yes-all;															
	Yes-some;															
	No; Unknown															
	OTIKITOWI															
Commissioning cost	\$/ft2	2.04	2.13	0.88	1.78	1.18	0.48	0.75	0.82	1.43	1.73	0.49	0.92	0.52	1.15	0.39
	(\$2003)	-	_								_					
Direct commissioning cost as a fraction of total	%	1.4%	1.4%	0.6%	1.2%	0.8%	0.3%	0.5%	0.5%	1.1%	1.2%	0.3%	0.6%	0.4%	0.8%	0.3%
construction cost (new construction only)																
Total energy savings [weather-normalized]	kBTU/ft2-							4.2	7.8	4.8	2.9	7.9	1.9	2.9	(0.6)	9.3
Total energy savings [weather-normalized]	vear %															
Inflation-corrected energy savings, local energy prices,	\$/ft2-year							0.08	0.13	0.05	0.01	0.11	0.04	0.03	0.03	0.19
excluding non-energy impacts	(\$2003)							0.00	0.15	0.00	0.01	0.11	0.04	0.05	0.05	0.13
	(+=+++)															
Inflation-corrected savings, using standardized US	\$/ft2-year							0.08	0.13	0.05	(0.00)	0.12	0.04	0.03	0.04	0.21
energy prices, including non-energy impacts if quantified	(\$2003)															
														1.5.0		
Payback time - [no normalizations] nominal values: raw nominal-price data (mixed dollars and prices), excluding	Years	-	-	-	-	-	-	9.7	6.5	29.0	303.1	4.2	21.3	15.0	33.7	1.8
non-energy impacts																
Payback time - Standardardized energy prices and	Years		-	-	-	-	-	4.6	2.4	22.2		1.2	16.5	16.7	37.8	0.9
inflation-corrected commissioning costs, including non-																
energy impacts																
Energy savings determination [select answers that	A; B; C; D;							E	E E	E	E	E	E	E	E	E
correspond to the energy data given in prior rows. See	or E															
Appendix D for definitions] Data Source(s)		Altweis and	Dorgan et al	Dorgan et al	Dorgon et al	Dorgan et al	Dorgan et al	SBW and	SBW and	SBW and	SBW and	SBW and	SBW and	SBW and	SBW and	SBW and
Data Source(s)				2002	2002	2002	2002	Skumatz	Skumatz	Skumatz 2003		Skumatz 2003;	Skumatz	Skumatz	Skumatz	Skumatz
		Altweis 2002						2003	2003	2.000		Tso et al (no		2003; Tso et		2003; NEEA
								1	1		al (no date).	date); NEEA		al (no date).	al (no date).	(no date-c)
					1							(no date-e)				
					1			1								1

ID	Units	60	61	62	63	64	65	66	67	68	69
Existing building or new construction		new	new	new		new	new		new	new	nev
Commissioning provider					Test Comm LLC (Spokanne, WA)		HEC (ESCO)	HEC (ESCO)			
Building name and location		Cheney Cowles Museum	DOC - Women's Correctional Center	Othello Community Hospital	Spokanne Community College - Health Sciences Building	Processing and Environmental Technology Laboratory (PETL)	Women and Children's Hospital Addition	CAMC Memorial Surgery Replaceme nt Addition			Industrial (electronics tech.)
Location - City		Spokane	Gig Harbor	Othello	Spokane	Albuquerque					
Location - State		WA	WA	WA	WA	. NM	WV	WV	WA	WA	WA
Number of buildings	#			1	1	1	1	1	1	1	
Year construction completed		2002	2001	2000	2003	2000	1988	1994			
Year commissioning project completed		2002	2001	2000	2003	2003	1993	1994	1993	1993	1993
Floor area served by commissioned systems	square feet	78,000	58,000	51,000	60,000	151,000	43,000	122,000	42,000	32,000	60,000
Building type(s)		Public Assembly	Public Order and Safety		Higher Education		Healthcare: Inpatient	Healthcare: Inpatient	Education: K-12	Office	Othe
Number of deficiencies identified	#/building	45	26	39	43						
Number of measures recommended	#/building										
Verification of Measure Installation	Yes-all; Yes-some; No; Unknown										
Commissioning cost	\$/ft2 (\$2003)	1.52	1.71	1.80	1.66	7.46	9.08	5.42	0.15	0.11	1.01
Direct commissioning cost as a fraction of total construction cost (new construction only)	%	0.7%	1.1%	1.2%	1.4%	3.9%	5.9%	1.9%			
Total energy savings [weather-normalized]	kBTU/ft2- year	18.1	2.4	21.2	3.4				0.8	0.6	19.2
Total energy savings [weather-normalized]	%										
Inflation-corrected energy savings, local energy prices, excluding non-energy impacts	\$/ft2-year (\$2003)		0.02	0.29	0.05	2.03	3.84	1.23	0.01	0.00	0.14
Inflation-corrected savings, using standardized US energy prices, including non-energy impacts if quantified	\$/ft2-year (\$2003)	0.21	0.02	0.30	0.05						
Payback time - [no normalizations] nominal values: raw nominal-price data (mixed dollars and prices), excluding non-energy impacts	Years	7.0	77.1	5.6	36.0	3.3	1.9	3.6	19.6	18.1	5.6
Payback time - Standardardized energy prices and inflation-corrected commissioning costs, including non- energy impacts	Years	6.0	74.7	4.8	25.8	-			7.9	7.3	2.3
Energy savings determination [select answers that correspond to the energy data given in prior rows. See Appendix D for definitions]	A; B; C; D; or E	E	E	E	E	E	E	E	E	E	E
Data Source(s)		SBW and Skumatz 2003	SBW and Skumatz 2003	SBW and Skumatz 2003	SBW and Skumatz 2003	Savage (no date)	Zachwieja and Williams 1994	Zachwieja and Williams 1994	Stum et al 1994	Stum et al 1994	Stum et al 1994